VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE.
INIT_____ DATE_____

DWG NO. 900-D-397 SH 2

REVISIONS

ZONE	REV	DESCRIPTION	BY	CHK	DATE	APPROVED
	1	REVISED & REDRAWN PER DFC #219	DAS		3/1/85	E.P.H.
	2	REVISED & REDRAWN PER DFC #244	DAS		4/12/85	E.P.H.
	3	REVISED PER DFC #373	DAS		10/2/85	RJR PMP
	4	REVISED & REDRAWN PER ECN #999	DAS		9/11/86	PMP 11/12/86
	5	REVISED & REDRAWN PER ECN # 1336	CEB		1/9/87	
	6	REVISED PER ECN 1633	CEB		5/15/87	
C.1-6	7	REVISED PER ECN 2345	DAS		4/24/88	5/17/88
B3 C8,D8	8	REVISED PER ECN 2635	CEB		9/12/88	10/26/88
	9	REV./ECN 4142	RMS	JHB	1-25-91	

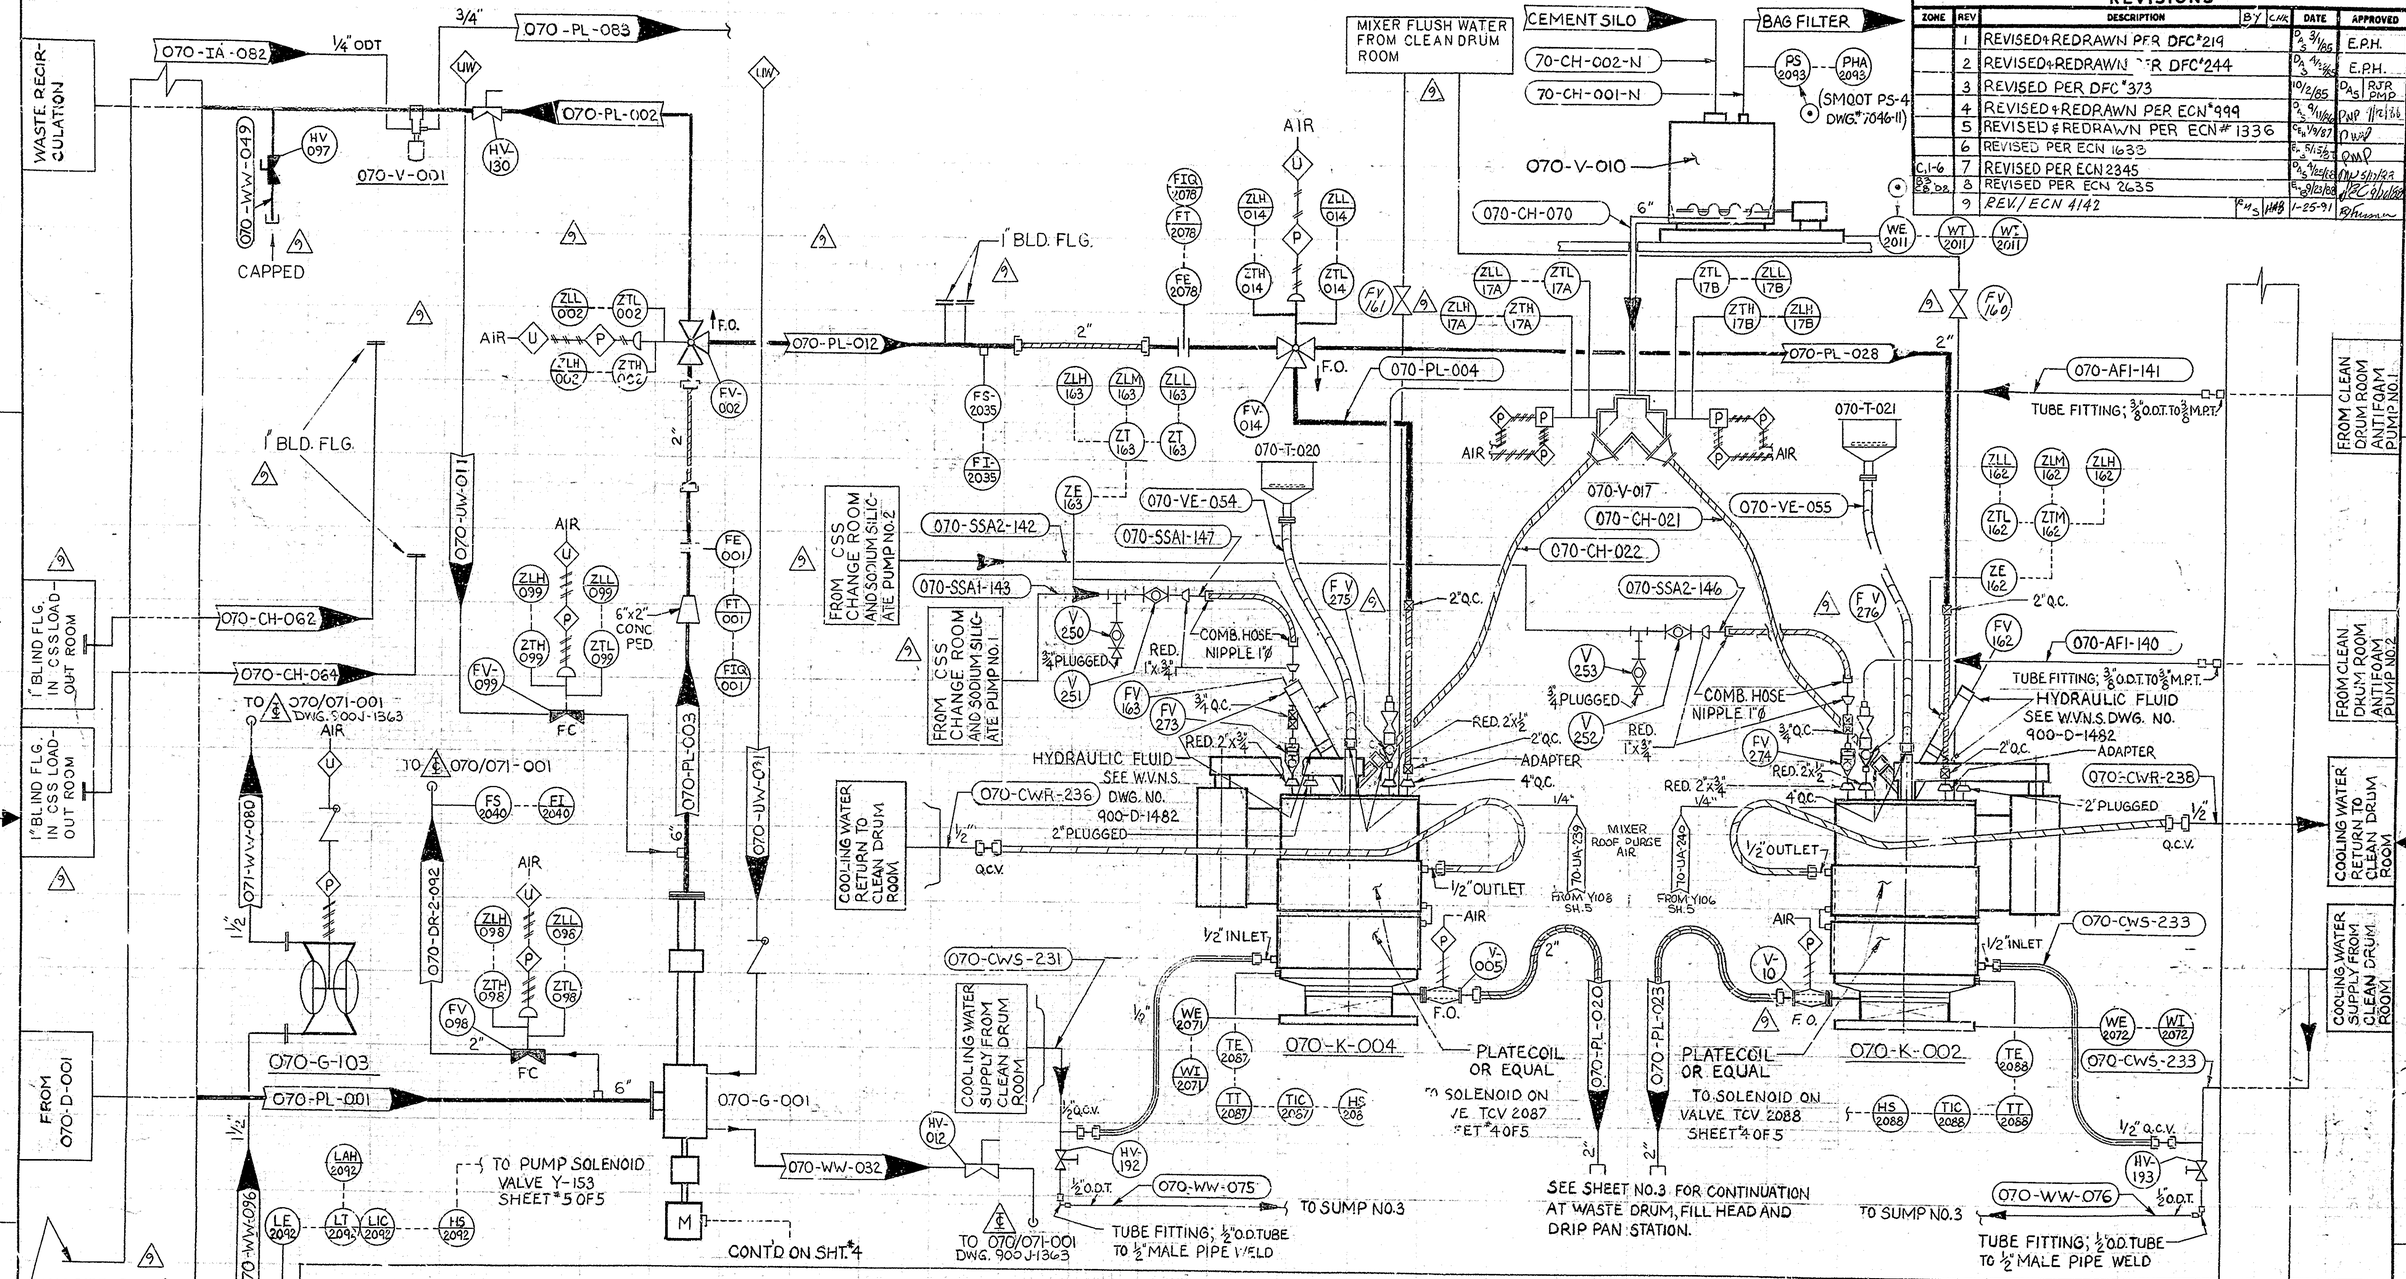

070-G-103

SUMP PUMP NO. 3
SAME TYPE OF PUMP AS SUMP PUMP NO. 1

070-G-103

SLURRY SAMPLER
ISOLOK MODEL M-57-A SAMPLER, 10CC CAPACITY PER CYCLE. UNIT IS ESSENTIALLY A PNEUMATICALLY OPERATED SAMPLING INSTRUMENT UTILIZING AN APPROPRIATE MANUAL CYCLE CONTROL.

070-G-001

WASTE DISPENSING VESSEL PUMP
MOYNO PUMP MODEL NO. 2 FOGSI-SSB-XAC MOTOR IS A WESTINGHOUSE GEARMOTOR, FR. 21D, TYPE U SCOOP MOUNTING, WITH 213T MOTOR, 7½ H.P., 230 RPM OUTPUT, 3 PH.-60 HZ.-460 V, TEFC ENCLOSURE CLASS 2. CONN'S. 6"-150# ANSI-F.F., SUCTION AND DISCHARGE. DWG. NO. 3832502

PROCESS ROOM

070-K-004

HIGH SHEAR MIXER NO. 1
WVNS DWG. NO. 900-D-1236, HIGH SHEAR MIXER BY COLCRETE CO., KENT, ENGLAND, PART NO. D-1670-M. WESTINGHOUSE MOTOR 3 PHASE, 60 CYCLE, 460 VOLT, MODEL TUFC, STYLE NO. 80B25-801.

007-V-017

DIVERTER VALVE
PEBCO MODEL # TNJ-6-P0: TWO-WAY NON-JAMMING GATE VALVE, 6"x6" OPENING, PNEUMATICALLY OPERATED. INLET IS VERTICAL AND DISCHARGE LEGS ARE AT 30° FROM VERTICAL.

070-K-002

HIGH SHEAR MIXER NO. 2
SAME AS HIGH SHEAR MIXER NO. 1

070-V-010

GRAVIMETRIC CEMENT FEEDER
ACRISON MODEL 403B-12000 (400)-1400-BDF-2-M LOSS-IN-WEIGHT FEEDER, WITH MICRODATA 403 CONTROLLER.

NOTE:
ALL INSTRUMENTS, VALVES, ETC, DESIGNATIONS ARE PRECEEDED BY 070 NOT SHOWN FOR CLARITY

QTY REQD	ITEM NO.	NOMENCLATURE OR DESCRIPTION	PART OR IDENTIFYING NO.	MATERIAL OR SPEC

PARTS LIST

UNLESS OTHERWISE SPECIFIED
TOLERANCES – DO NOT SCALE
2 PL DEC ± | 3 PL DEC ± | ANGLES ±
FRACTIONS ±
D. SPEC. NO.
NEXT ASSEMBLY

		DATE
DRAFTER	David G. Schmidt	7-29-85
CHECKER	D.H. Williams	8-5-86
ENGR.	V.M. Pilcher	8-5-86
FACILITIES M.F. SALISBURY		5-1-85
COG. MGR. APPVL J.C. CWYNAR		4-24-85
E&OS APPVL R. KEEL		4-22-85
Q.A. APPVL A.E. BAKER		5-85
DFTG. SUPR. D.H. GARLAND		4-24-85

A/E CONTRACT NO. | CODE IDENT. NO.

FOR
West Valley Nuclear Services Co., Inc.
West Valley, New York

C.S.S. CEMENT SOLIDIFICATION SYSTEM BUILDING 01-14, PIPING AND INSTRUMENTATION DIAGRAM

DWG SIZE D | SCALE NONE | WEIGHT NONE | DWG NO. 900-D-397 | REV 9
A/E DWG NO. | SHEET 2 OF

REPRODUCIBLE