VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE.
INIT_____ DATE_____

DWG NO. 900D-2438 SH 1

REVISIONS

ZONE	REV	DESCRIPTION	CH	BY	DATE	APPROVED
	0	ER1495			[illegible]	[illegible]
ALL	1	REV. PER ECN. 2955	CHKD [illegible]	GW	5-15-89	[illegible]
	2	REV/ECN 6550	[illegible]	RMS	7-27-93	[illegible]
	3	REV. PER ECN 6970	[illegible]	WJC	[illegible]	[illegible]
	4	REV PER FCN NOX-0111	[illegible]	WJC	9-26-94	[illegible]

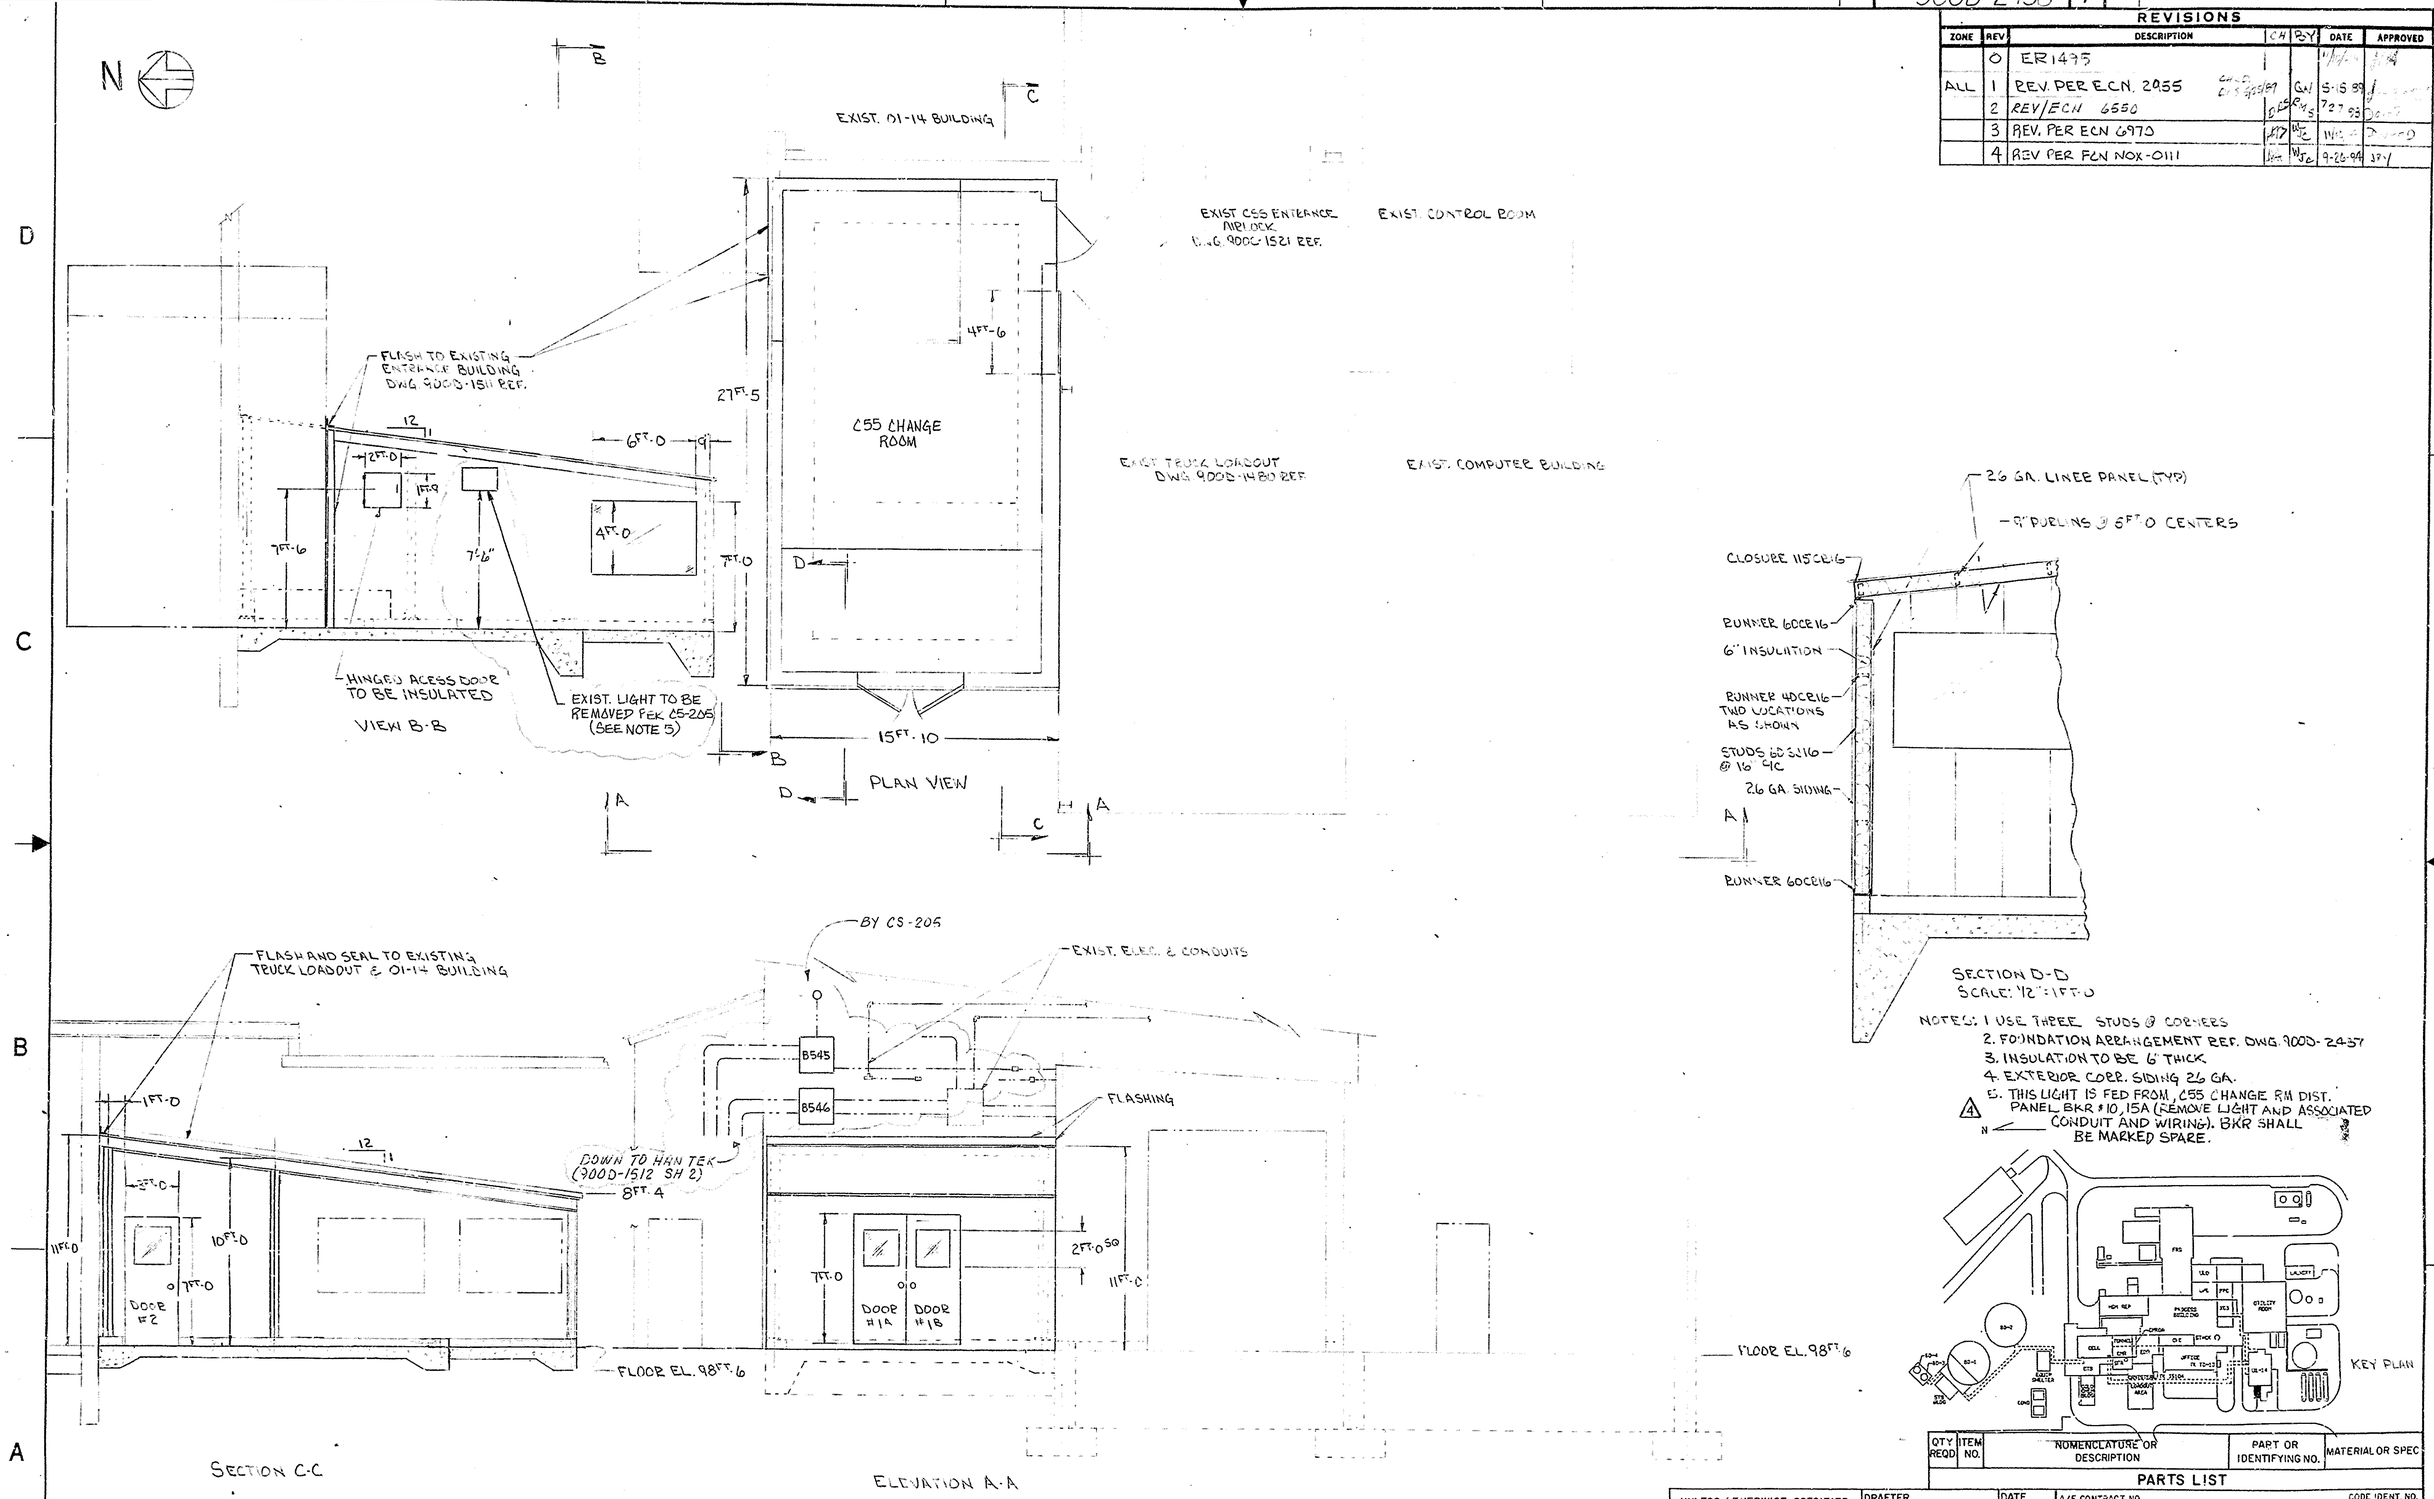

NOTES: 1. USE THREE STUDS @ CORNERS
2. FOUNDATION ARRANGEMENT REF. DWG. 900D-2437
3. INSULATION TO BE 6" THICK
4. EXTERIOR CORR. SIDING 26 GA.
5. THIS LIGHT IS FED FROM, C55 CHANGE RM DIST. PANEL BKR #10, 15A (REMOVE LIGHT AND ASSOCIATED CONDUIT AND WIRING). BKR SHALL BE MARKED SPARE.

QTY REQD	ITEM NO.	NOMENCLATURE OR DESCRIPTION	PART OR IDENTIFYING NO.	MATERIAL OR SPEC

PARTS LIST

UNLESS OTHERWISE SPECIFIED	DRAFTER C. WRIGHT	DATE 10-13-88	A/E CONTRACT NO. / CODE IDENT. NO.
ALL DIMENSIONS IN FT & INCHES	CHECKER [illegible]	DATE [illegible]	FOR West Valley Nuclear Services Co., Inc. West Valley, New York
TOLERANCES—DO NOT SCALE	ENGR. [illegible]	DATE [illegible]	
2 PL DEC ± N/A; 3 PL DEC ± N/A; ANGLES ± 30'; AA ✓	COG. MGR. APPVL [illegible]	DATE [illegible]	CSS CHANGE ROOM & TANK STORAGE BUILDING ENCLOSURE
FRACTIONS ± 1/8	E&OS APPVL N/A	DATE	
D. SPEC. NO. 1322	Q.A. APPVL N/A	DATE	DWG SIZE D; SCALE 1/4" = 1FT.0; WEIGHT; DWG NO. 900D-2438; REV 4
NEXT ASSEMBLY	DFTG. SUPR. [illegible]	DATE [illegible]	A/E DWG NO.; SHEET 1 OF 1

RELEASED FOR BID
S. R. Barnard
Mgr. Construction Projects
8/12/93
Date