905-D-045 S13

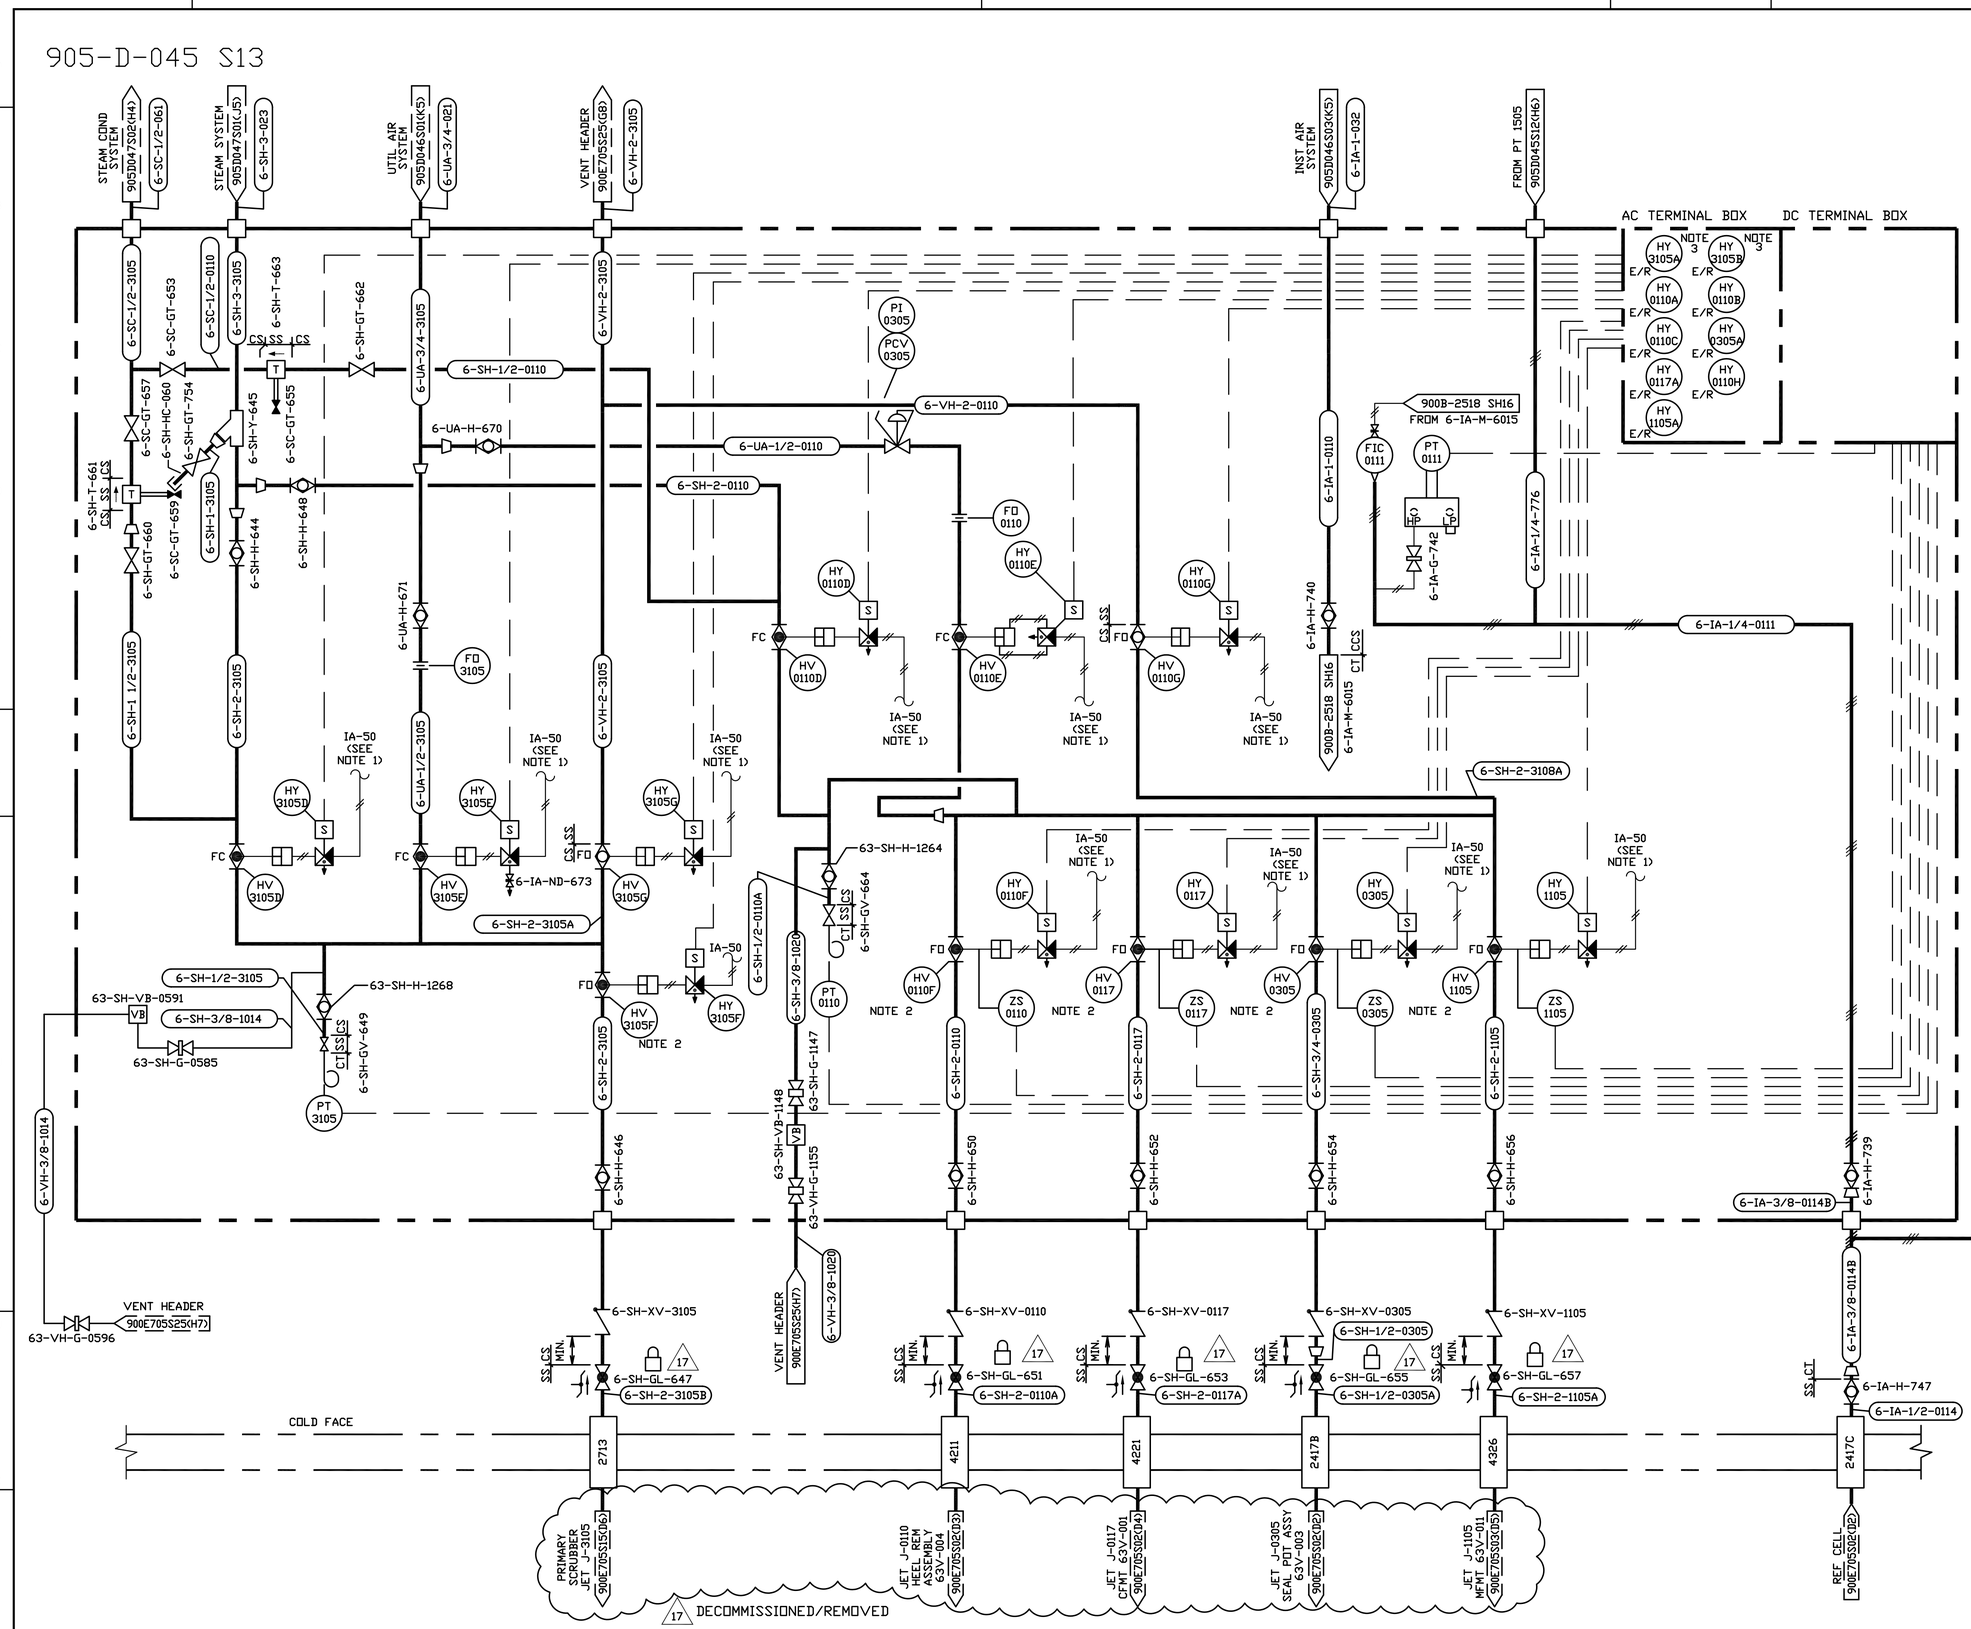

NO.	DATE	REVISIONS	DR	CH	APPROVED		
B	6-15-88	GENERAL REVISIONS INCLUDING TA 767	BFR	RJL	RJL SN	AJD	MDW
C	2-16-89	GENERAL REVISIONS	RJS	JJV	RJL	FJE FSK	FJES
0	6-12-89	ER 1631			JRH		
15	03/02/2000	ECN 12318	BP	HAB			
16	6/26/2000	ECN 12690	MJC	HAB			
17	2/7/05	ECN 26189	DAK	HAB			
10	8/16/95	REV PER ECN 9157	MJL	GLS			
11	1/26/96	ECN 9497	JHS	HAB			
12	2/21/97	ECN 10520	LRP	DRS			
13	2/4/99	ECN 11876	JLH	HAB			
14	12/3/99	ECN 11949	DDD	HAB			

NOTES:

1. IA-50 AIR SERVICE FROM MANIFOLD 6-IA-M-6015. SEE DETAIL ON 900B-2518 SHEET 16
2. FIELD MODIFY FAIL ACTION OF VALVES HV3105F, HV0110F, HV0117, HV0305, AND HV1105 FROM FAIL CLOSE TO FAIL OPEN. (TD-0038)
3. ELECTROMAGNETIC RELAYS HY-3105A AND HY-3105B DISCONNECTED AND ABANDONED IN TERMINAL BOX AND REMAIN AS SPARES

17 LOCKED AND TAGGED 'OUT OF SERVICE'

VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE
INIT _____ DATE _____

FOR DRAWING INDEX SEE DRAWING NO. _____

APPRVD WVNS CO.		EBASCO SERVICES INCORPORATED
PROJECT MGR M.D. WEINGART	02-25-88	A/E D.F.S. NO. 2388 FOR TASK ORDER 009
ENGINEER SUPV A.J. DIFILIPPO	02-25-88	WEST VALLEY NUCLEAR SERVICES COMPANY, INC WEST VALLEY, NEW YORK
LEAD DISC ENGR S. NATH	02-25-88	WEST VALLEY DEMONSTRATION PROJECT
DESIGN M. KHUSHALANI	02-25-88	P & ID VITRIFICATION FACILITY INSTRUMENT RACK 3W6
CHECKED R.J. LEWKO	02-25-88	
DRAWN T.J. KITZ	DATE 02-25-88	

DE-AC07-81NE44139
PROJECT NO. 19-CWV-02275
SUBCONTRACT NO.
ISSUED FOR CONSTRUCTION

SIZE	INDEX CODE NUMBER					DRAWING NO.	REV.
	AREA	DR. TYP	CL	ORIG			
D						905D-045	17

SCALE: NONE
SPEC. CODES
A/E SHEET NO. 905-D-045 S13 C

CAD DRAWING - DO NOT REVISE THIS ORIGINAL

149765 1=1.00