905-D-045 S14

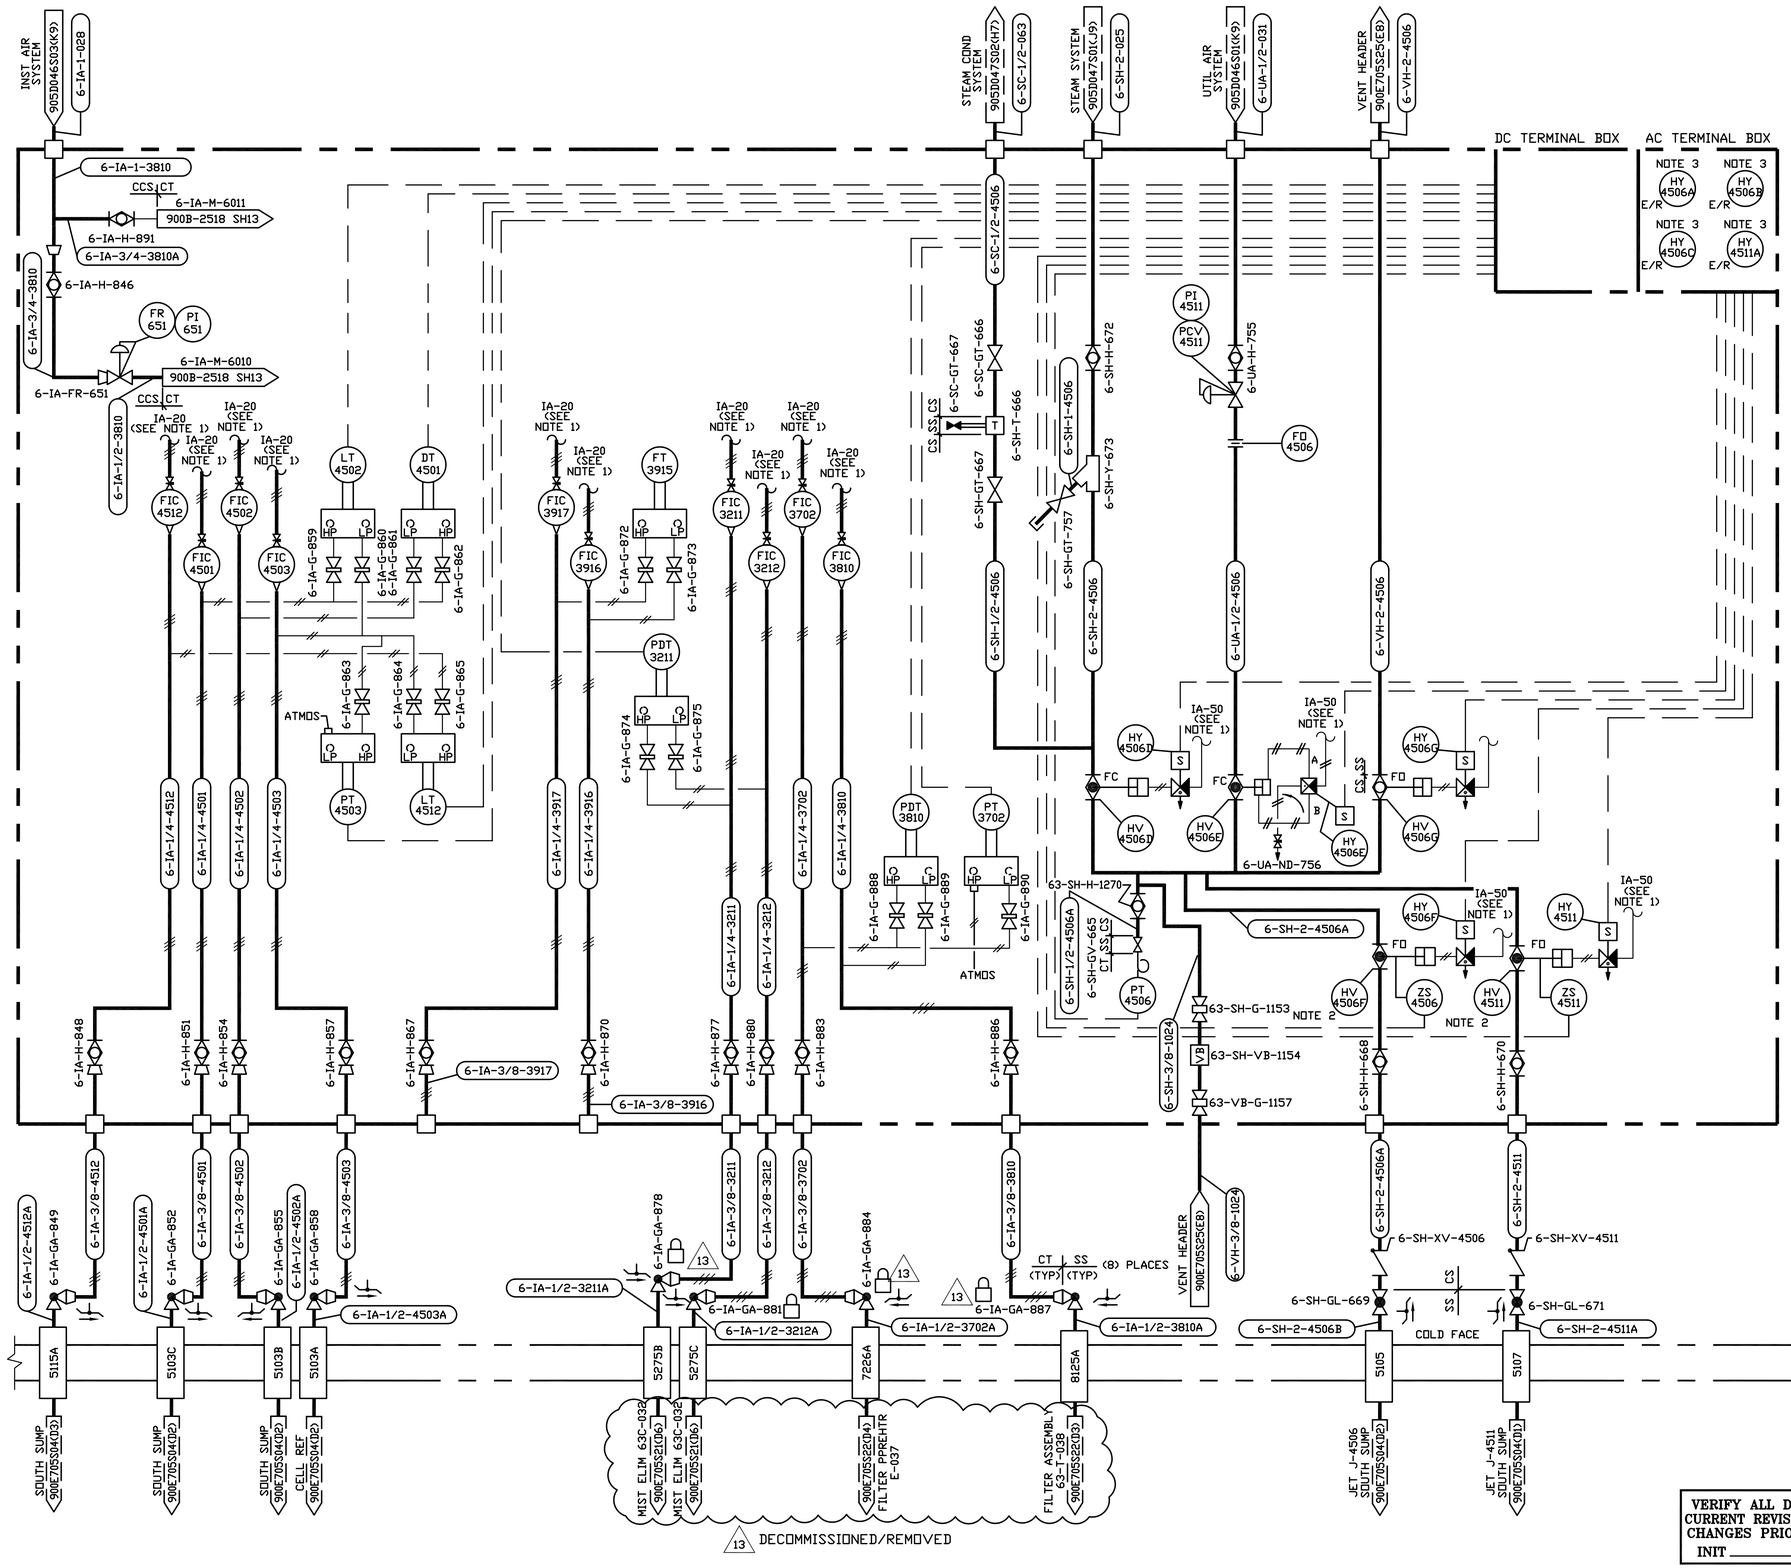

NO.	DATE	REVISIONS	DR	CH	APPROVED		
B	6-15-88	GENERAL REVISIONS INCLUDING TA 767	BFR	RJL	RJL SN	AJD	MDW
C	2-16-89	GENERAL REVISIONS	RJS	JJV	RJL	FJE FSK	FJES
0	6-12-89	ER 1631			JRH		
11	03/02/2000	ECN 12318	BP	HAB			
12	6/26/2000	ECN 12690	MJC	HAB			
13	2/7/05	ECN 26189	DAK	HAB			
4	12/31/93	REV PER ECN 7324	SRD	KQ	PAN		
5	11/01/94	REV PER ECN 7953	DJN	DRS	EHB		
6	2/6/95	REV PER ECN 8579	MJL	KQ	RAA		
7	5/16/95	REV PER ECN 8911	RAS	KQ			
8	8/16/95	REV PER ECN 9157	MJL	GLS			
9	9/25/98	ECN 11498	CGR	HAB			
10	2/4/99	ECN 11786	JLH	HAB			

NOTES:

1. IA-20 AND IA-50 AIR SERVICE FROM MANIFOLDS, 6-IA-M-6010 AND 6-IA-M-6011. SEE DETAIL ON 900B-2518 SH13.
2. FIELD MODIFY FAIL ACTION OF VALVES HV-4506F AND HV-4511 FROM FAIL CLOSE TO FAIL OPEN. (TO-0038)
3. ELECTROMAGNETIC RELAYS DISCONNECTED AND ABANDONED IN TERMINAL BOX AND REMAIN AS SPARES.

13 LOCKED AND TAGGED 'OUT OF SERVICE'

VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE
INIT _____ DATE _____

FOR DRAWING INDEX SEE DRAWING NO._____

APPRVD WVNS CO.		EBASCO SERVICES INCORPORATED
PROJECT MGR M.D. WEINGART	03-04-88	A/E O.F.S. NO. 2388 TASK ORDER 009
ENGINEER SUPV A.J. DIFILIPPO	03-04-88	FOR WEST VALLEY NUCLEAR SERVICES COMPANY, INC WEST VALLEY, NEW YORK
LEAD DISC ENGR S.NATH	03-04-88	WEST VALLEY DEMONSTRATION PROJECT
DESIGN M. KHUSHILANJ	03-04-88	P & ID VITRIFICATION FACILITY INSTRUMENT RACK 3W3
CHECKED R.J. LEWKO	03-04-88	
DRAWN T.J. KITZ	DATE 03-04-88	

DE-AC07-81NE44139	SIZE	INDEX CODE NUMBER				DRAWING NO.	REV.
PROJECT NO. 19-CWV-02275	D	AREA	DR. TYP	CL	ORIG	905D-045	13
SUBCONTRACT NO.							
ISSUED FOR CONSTRUCTION	SCALE: NONE		SPEC. CODES			A/E SHEET NO. 905-D-045 S14	C

CAD DRAWING - DO NOT REVISE THIS ORIGINAL

149767 1=1.00