905-D-045 S04

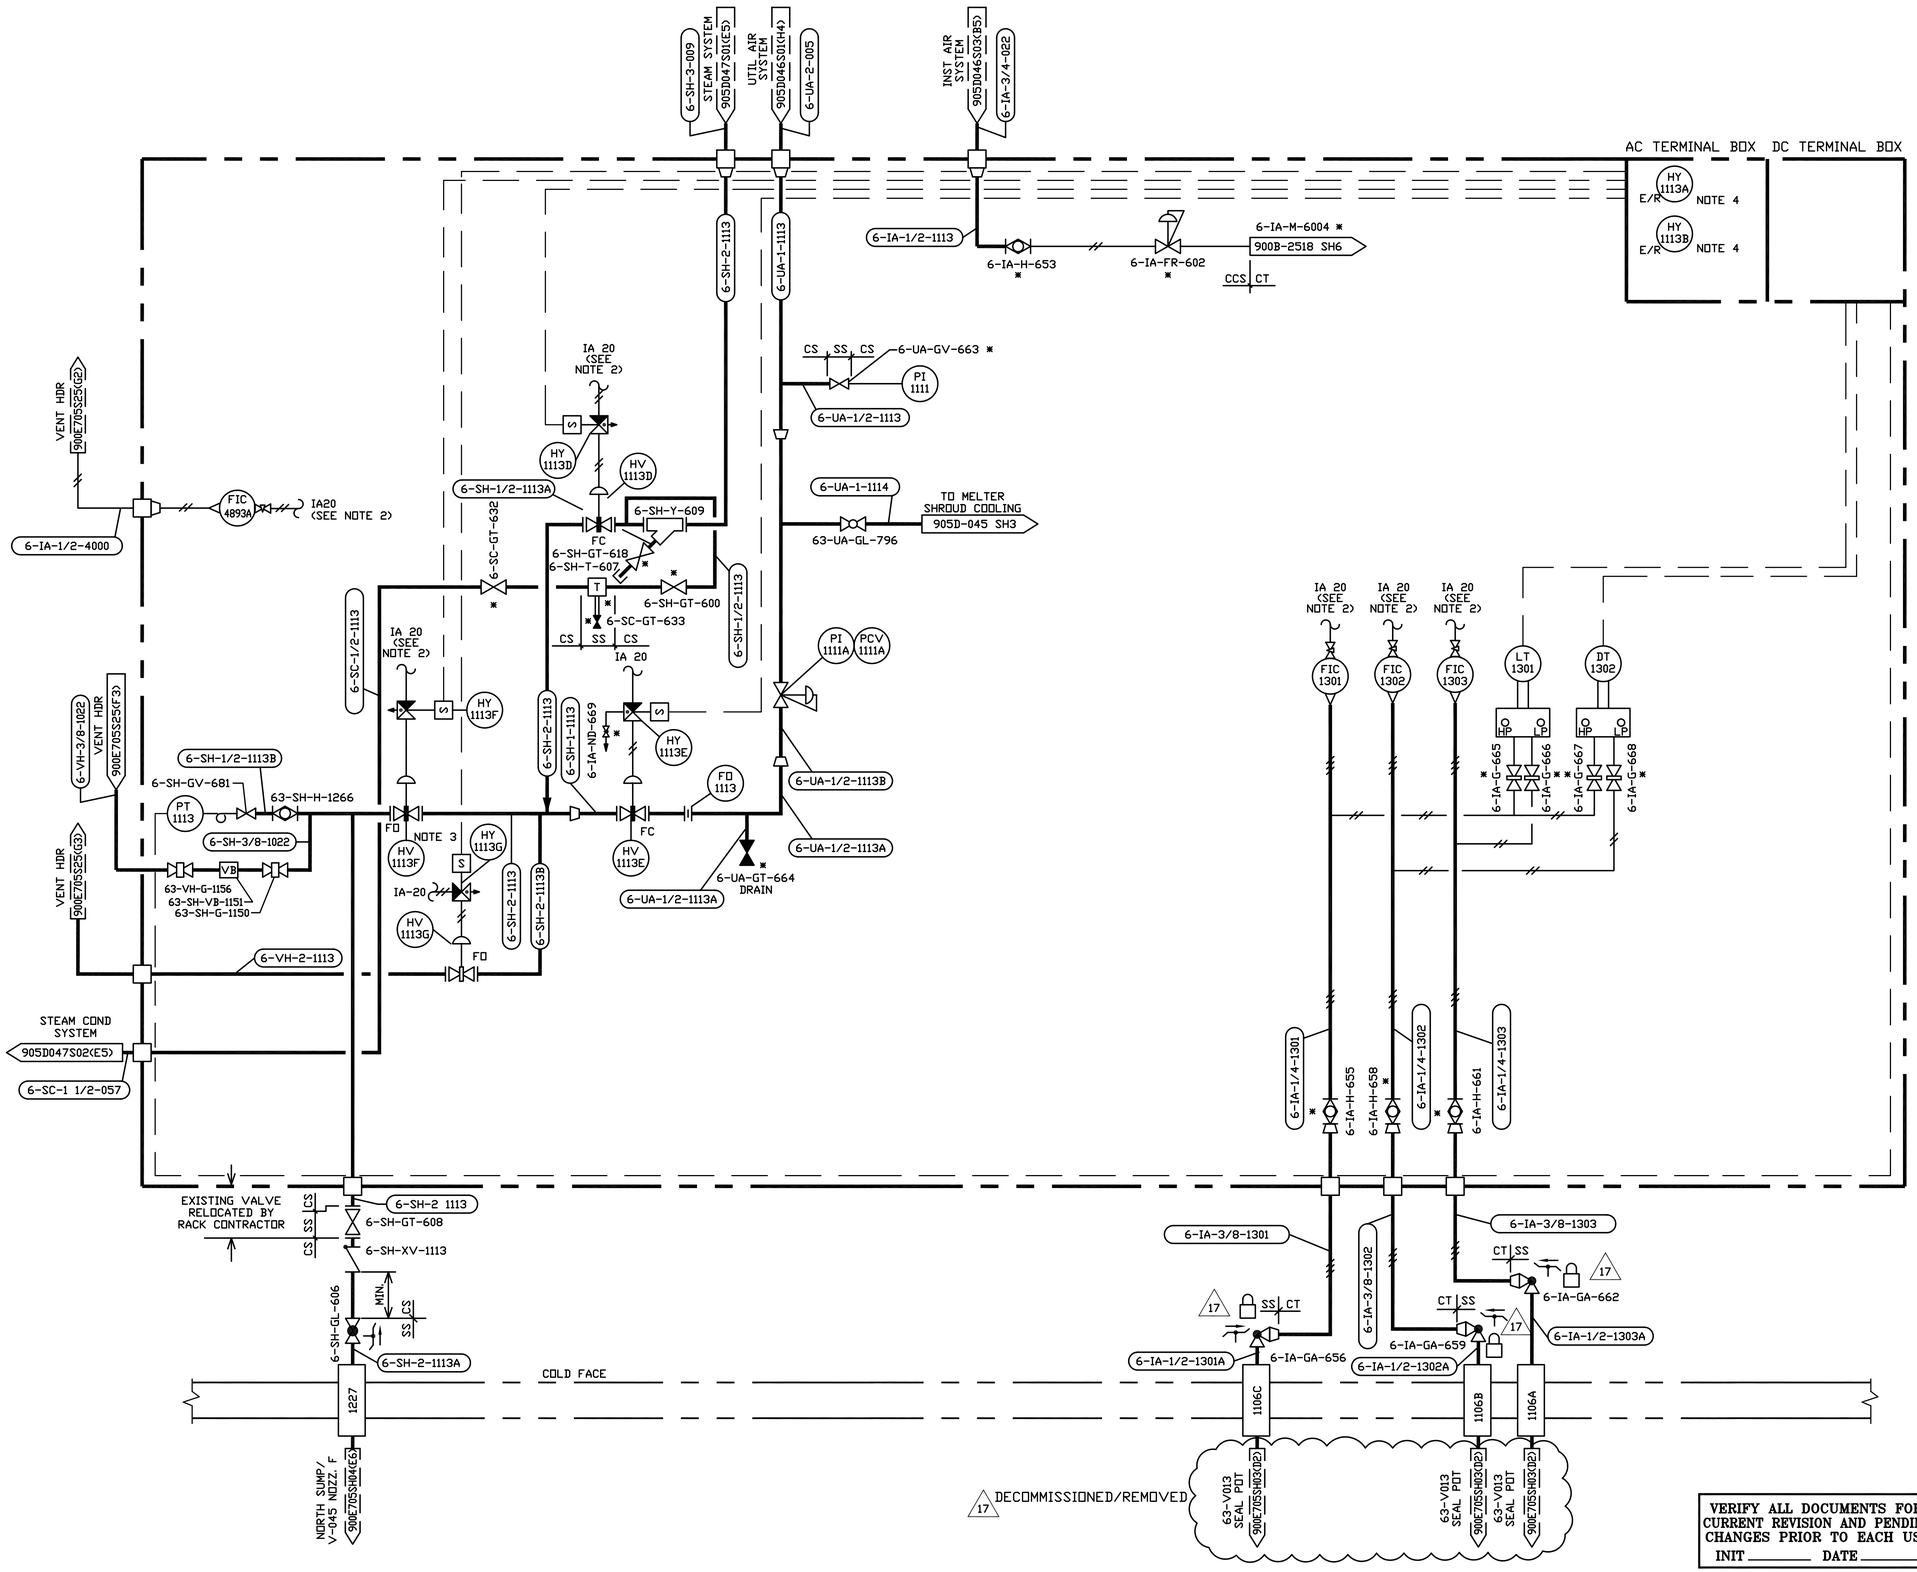

NO.	DATE	REVISION	DR	CH	APPROVED		
B	02-02-88	REVISION PER EBAR 1075A	TJK	RJL	MIK SN	AJD	MDW
C	06-15-88	GENERAL REVISION INCLUDING TA 767	TJK	RJL	RJL SN	AJD	MDW
D	10/31/88	GENERAL REVISION	PJS	RJL	RJL	FJE FSK	FJES
E	4/13/89	GENERAL REVISION	RJL	JJV	RJL	FJE FSK	FJES
0	6/12/89	ER 1631			JRH		
10	5/15/95	ECN 8911	RAS	KQ			
11	8/16/95	REV PER ECN 9157	MJL	GLS			
12	3/8/96	REV PER ECN 9639	SRD	DRS			
13	2/4/99	ECN 11876	JLH	HAB			
14	10/7/99	REV PER ECN 10756A	CAM	DRS			
15	03/02/2000	ECN 12318	BP	HAB			
16	6/26/2000	ECN 12690	MJC	HAB			
17	2/7/05	ECN 26189	DAK	HAB			
9	2/6/95	REV PER ECN 8579	MJL	HAB	RWM		

NOTES:

1. NEW INSTRUMENTS & VALVES TO BE INSTALLED ON THIS EXISTING RACK ARE MARKED WITH A SINGLE ASTERISK (*).
2. IA 20 AIR SERVICE FROM MANIFOLD 6-IA-M-6004. SEE DWG. 900B-2518 SH6.
3. FIELD MODIFY FAIL ACTION OF VALVE HV-1113F FROM FAIL CLOSE TO FAIL OPEN. (TD-0038)
4. ELECTROMAGNETIC RELAYS DISCONNECTED AND ABANDONED IN TERMINAL BOX AND REMAIN AS SPARES.

17 LOCKED AND TAGGED 'OUT OF SERVICE'

VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE
INIT _____ DATE _____

FOR DRAWING INDEX SEE DRAWING NO._____

APPRVD VVNS CO.		EBASCO SERVICES INCORPORATED
PROJECT MGR M.D. WEINGART	11-20-87	A/E D.F.S. NO. 2388 FOR TASK ORDER 009
ENGINEER SUPV A.J. DIFILIPPO	11-20-87	WEST VALLEY NUCLEAR SERVICES COMPANY, INC WEST VALLEY, NEW YORK
LEAD DISC ENGR S. NATH	11-20-87	
DESIGN M. KHUSHALANI	11-20-87	WEST VALLEY DEMONSTRATION PROJECT
CHECKED A. ZILG	11-20-87	P & ID VITRIFICATION FACILITY INSTRUMENT RACK 2N6-5
DRAWN T.J. KITZ	DATE 11-20-87	
DE-AC07-81NE44139 PROJECT NO.		SIZE D; INDEX CODE NUMBER: AREA, DR. TYP, CL, DRIG; DRAWING NO. 905D-045; REV. 17
19-CWV-02275 SUBCONTRACT NO.		
ISSUED FOR CONSTRUCTION		SCALE: NONE; SPEC. CODES; A/E SHEET NO. 905-D-045 S04 E

CAD DRAWING - Do not revise this original.

149881 1=1.00