905-D-045 S05

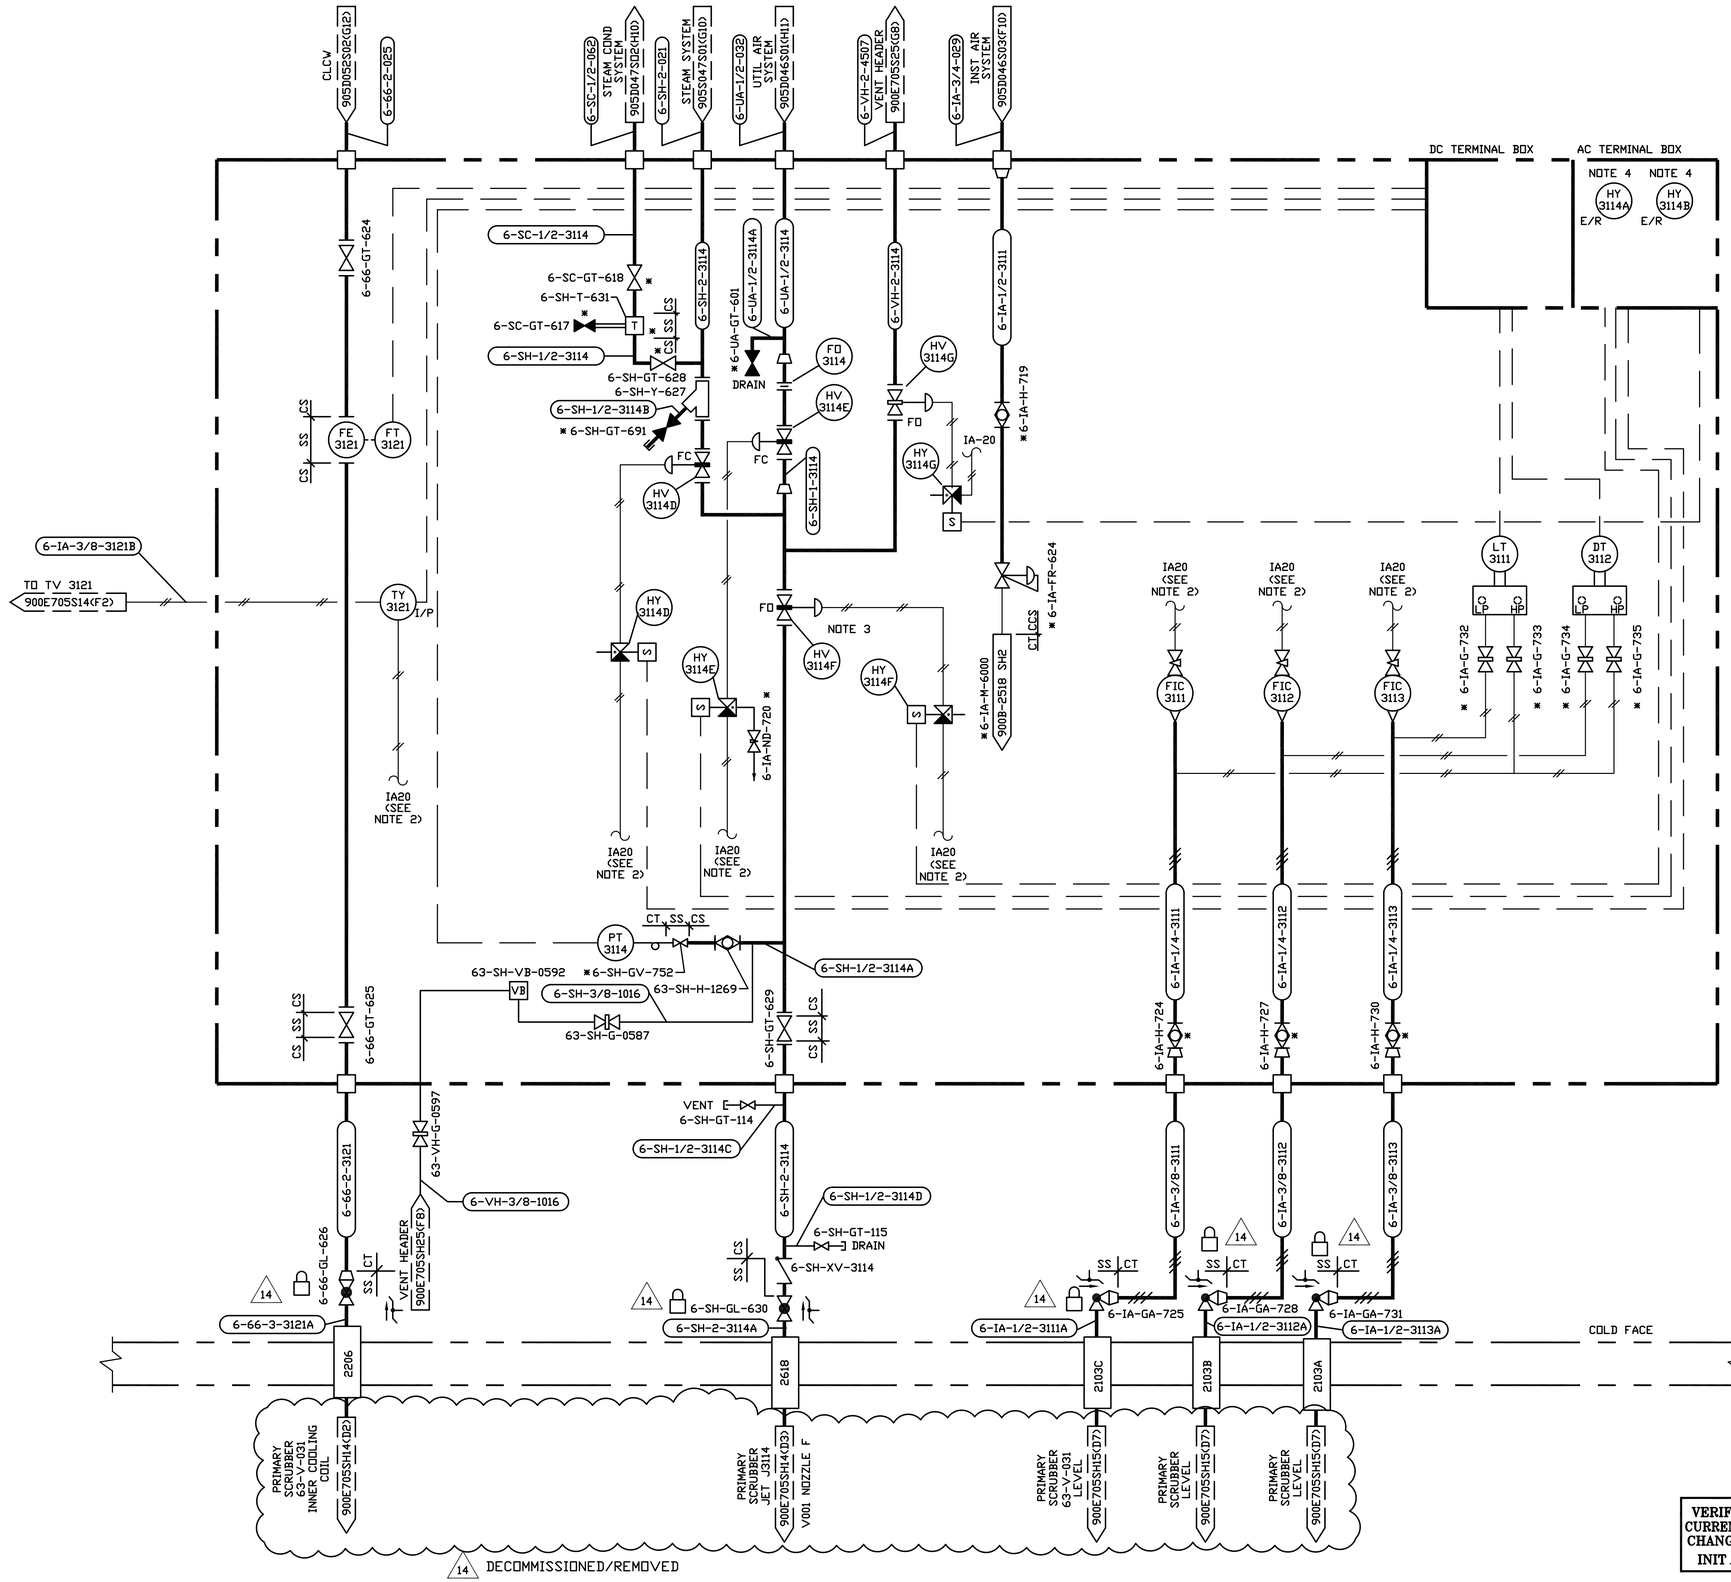

NO.	DATE	REVISION	DR	CH	APPROVED		
B	06-15-88		TJK	RJL	RJL SN	AJD	MDW
GENERAL REVISION INCLUDING TA 767							
C	10/31/88		PJS	RJL	RJL	RJL	FJES
GENERAL REVISION							
D	4/13/89		RJL	JJV	RJL	FJE FJE	FJES
GENERAL REVISION							
0	06/12/89	ER 1631			JRH		
8	5/15/95	ECN 8911	RAS	KQ			
9	7/14/95	REV PER ECN 9075	AAJ	GLS			
10	6/17/96	REV PER ECN 9987	SRD	DRS	ERB		
11	2/20/97	ECN 10520	LRP	DRS			
12	03/02/2000	ECN 12318	BP	HAB			
13	6/26/2000	ECN 12690	MJC				
14	2/7/05	ECN 26189	DAK	HAB			

NOTES:

1. NEW VALVES TO BE INSTALLED ON THIS EXISTING RACK ARE MARKED WITH A SINGLE ASTERISK (*).
2. IA 20 AIR SERVICE FROM MANIFOLD 6-IA 20-M-6000. SEE DRAWING 900B-2418 SH2.
3. FIELD MODIFY FAIL ACTION OF VALVE HV-3114F FROM FAIL CLOSE TO FAIL OPEN. (TD-0038)
4. ELECTROMAGNETIC RELAYS DISCONNECTED AND ABANDONED IN TERMINAL BOX AND REMAIN AS SPARES.

14 LOCKED AND TAGGED 'OUT OF SERVICE'

VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE
INIT _____ DATE _____

FOR DRAWING INDEX SEE DRAWING NO._____

APPRVD WVNS CO.	
PROJECT MGR M.D. WEINGART	01-07-88
ENGINEER SUPV A.J. DIFILIPPO	01-07-88
LEAD DISC ENGR S. NATH	01-07-88
DESIGN A. ZILG	01-07-88
CHECKED B.F. REYNOLDS	01-07-88
DRAWN T.J. KITZ	DATE 01-07-88
DE-AC07-81NE44139 PROJECT NO.	
19-CWV-02275 SUBCONTRACT NO.	
ISSUED FOR CONSTRUCTION	

EBASCO SERVICES INCORPORATED
A/E O.F.S. NO. 2388 FOR TASK ORDER 009
WEST VALLEY NUCLEAR SERVICES COMPANY, INC
WEST VALLEY, NEW YORK

WEST VALLEY DEMONSTRATION PROJECT

P & ID
VITRIFICATION FACILITY
INSTRUMENT RACK 2W2-1B

SIZE	INDEX CODE NUMBER					DRAWING NO.	REV.
	AREA	DR. TYP	CL	ORIG			
D						905D-045	14

SCALE: NONE
SPEC. CODES
A/E SHEET NO. 905D-045 S05 D

CAD DRAWING - Do not revise this original.

149757 1=1.00