VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE.
INIT_____ DATE_____

905-D-518

REV NO	DATE	REVISION	DR.	CH	APPROVED
1	5/31/89		JG	AV	RDL
GENERAL REVISION AS CIRCLED					
0	7/11/89	ISSUED			9/1/89
11	4-7-94	REV/FCN VF-28-1887, 1903, 2144 NEW 1993 1024	KWZ	HJS	HAJ
12	5-23-94	REV/FCN VF-28-1887, 1903, 2144	MJC	HJS	HAJ
13	6-7-94	REV/FCN VF-28-2173	JH	HJS	HAJ
14	6-16-94	REV/FCN VF-28-2173/2141	MJC	HJS	HAJ
15	7-15-94	REV/FCNS VF-28-2200 2232 & 2371	PD	ARA	HAJ
16	9-1-94	REV PER RN VF-28-2592, & 2589	GW	ARA	HAJ
17	9-16-94	REV/FCN VF-28-2614	PD	ARA	HAJ
18	10-13-94	REV/FCN VF-28-2763/2800	MJC	HJS	HAJ
9	2-9-94	REV/ECN 7258	PD	DCS	[illegible]
10	3-24-94	REV/FCN VF-28-1887 & VF-28-1925	KWZ	HJS	HAJ

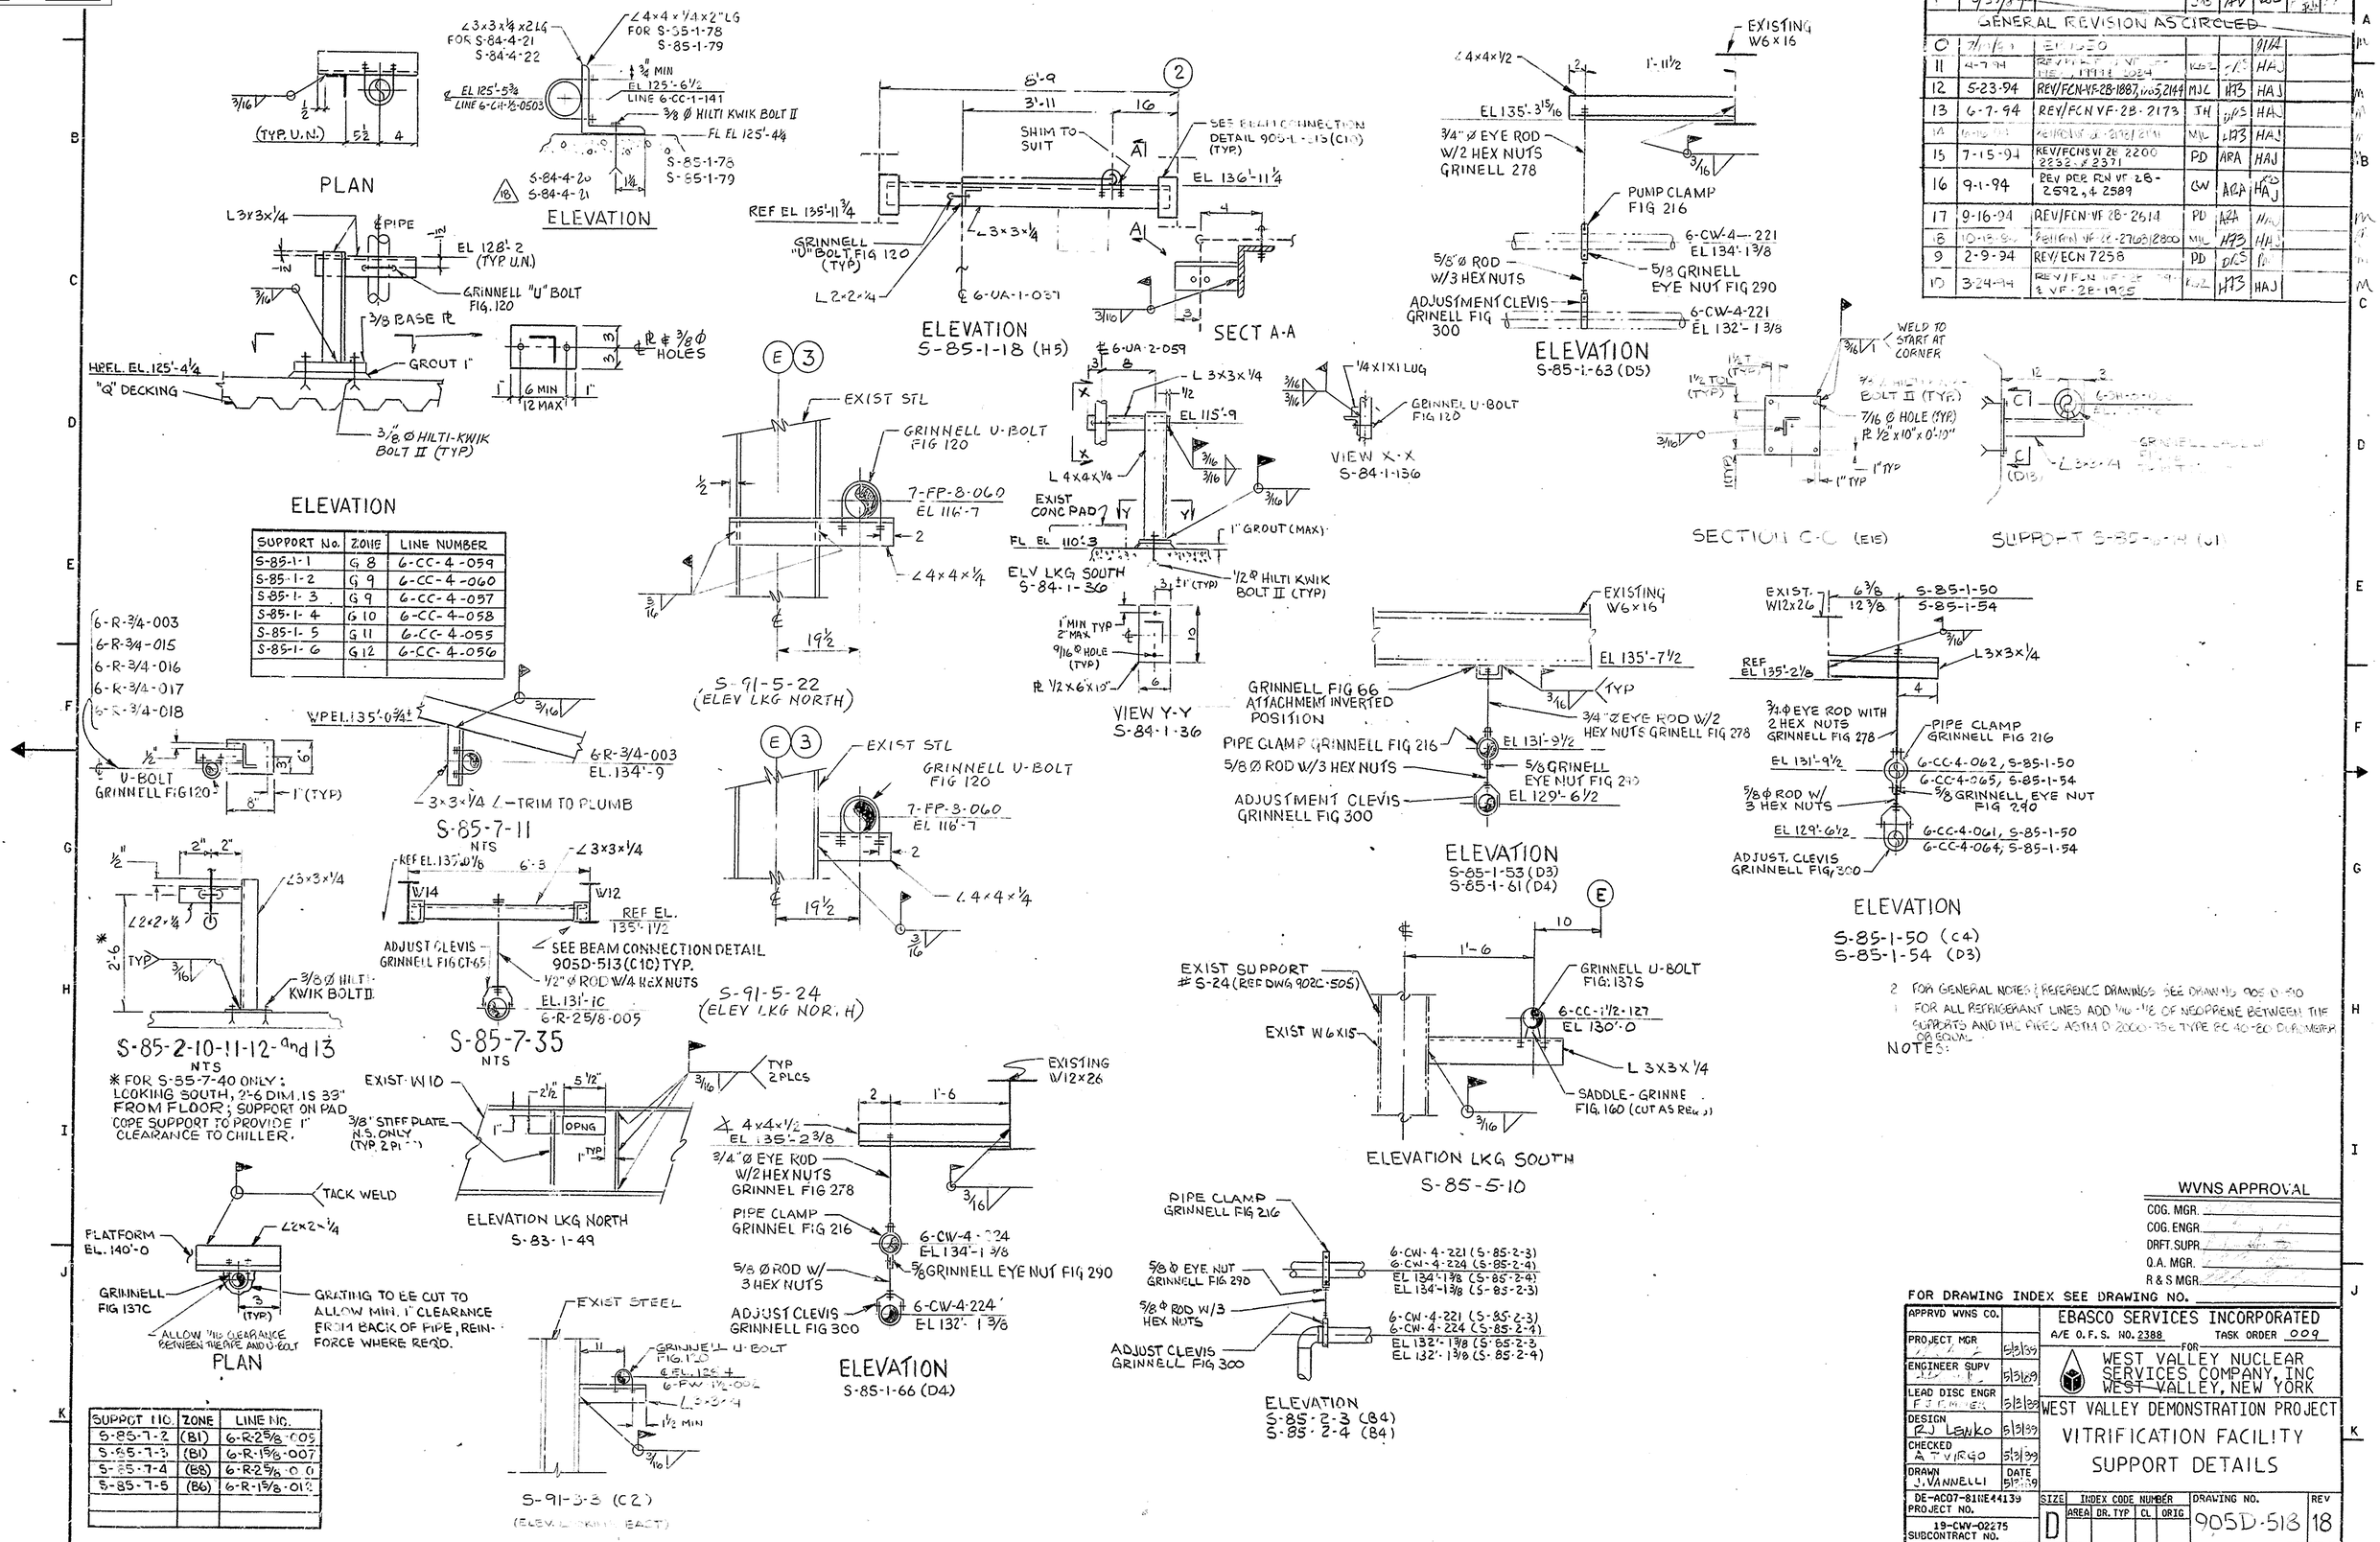

SUPPORT No.	ZONE	LINE NUMBER
S-85-1-1	G 8	6-CC-4-059
S-85-1-2	G 9	6-CC-4-060
S-85-1-3	G 9	6-CC-4-057
S-85-1-4	G 10	6-CC-4-058
S-85-1-5	G 11	6-CC-4-055
S-85-1-6	G 12	6-CC-4-056

SUPPORT NO.	ZONE	LINE NO.
S-85-7-2	(B1)	6-R-2 5/8-005
S-85-7-3	(B1)	6-R-1 5/8-007
S-85-7-4	(B8)	6-R-2 5/8-0 0
S-85-7-5	(B6)	6-R-1 5/8-012

* FOR S-85-7-40 ONLY: LOOKING SOUTH, 2'-6 DIM. IS 33" FROM FLOOR; SUPPORT ON PAD COPE SUPPORT TO PROVIDE 1" CLEARANCE TO CHILLER.

2 FOR GENERAL NOTES & REFERENCE DRAWINGS SEE DRAWING 905-D-510

1 FOR ALL REFRIGERANT LINES ADD 1/16-1/8 OF NEOPRENE BETWEEN THE SUPPORTS AND THE PIPES ASTM D 2000-73C TYPE BC 40-60 DUROMETER OR EQUAL.

NOTES:

WVNS APPROVAL
COG. MGR.
COG. ENGR.
DRFT. SUPR.
Q.A. MGR.
R & S MGR.

FOR DRAWING INDEX SEE DRAWING NO.

APPRVD WVNS CO.		EBASCO SERVICES INCORPORATED A/E O.F.S. NO. 2388 TASK ORDER 009
PROJECT MGR	5/31/89	FOR WEST VALLEY NUCLEAR SERVICES COMPANY, INC WEST VALLEY, NEW YORK
ENGINEER SUPV	5/31/89	WEST VALLEY DEMONSTRATION PROJECT
LEAD DISC ENGR F.J. FLEMMER	5/31/89	VITRIFICATION FACILITY
DESIGN R.J. LENKO	5/31/89	SUPPORT DETAILS
CHECKED A.T. VIRGO	5/31/89	
DRAWN J. VANNELLI	DATE 5/31/89	
DE-AC07-81NE44139 PROJECT NO.	SIZE D	INDEX CODE NUMBER: AREA / DR. TYP / CL / ORIG	DRAWING NO. 905D-518	REV 18
19-CWV-02275 SUBCONTRACT NO.				
ISSUED FOR CONSTRUCTION	SCALE NONE	SPEC. CODES	A/E SHEET NO. 905-D-518 SH B	