VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE.
INIT_____ DATE_____

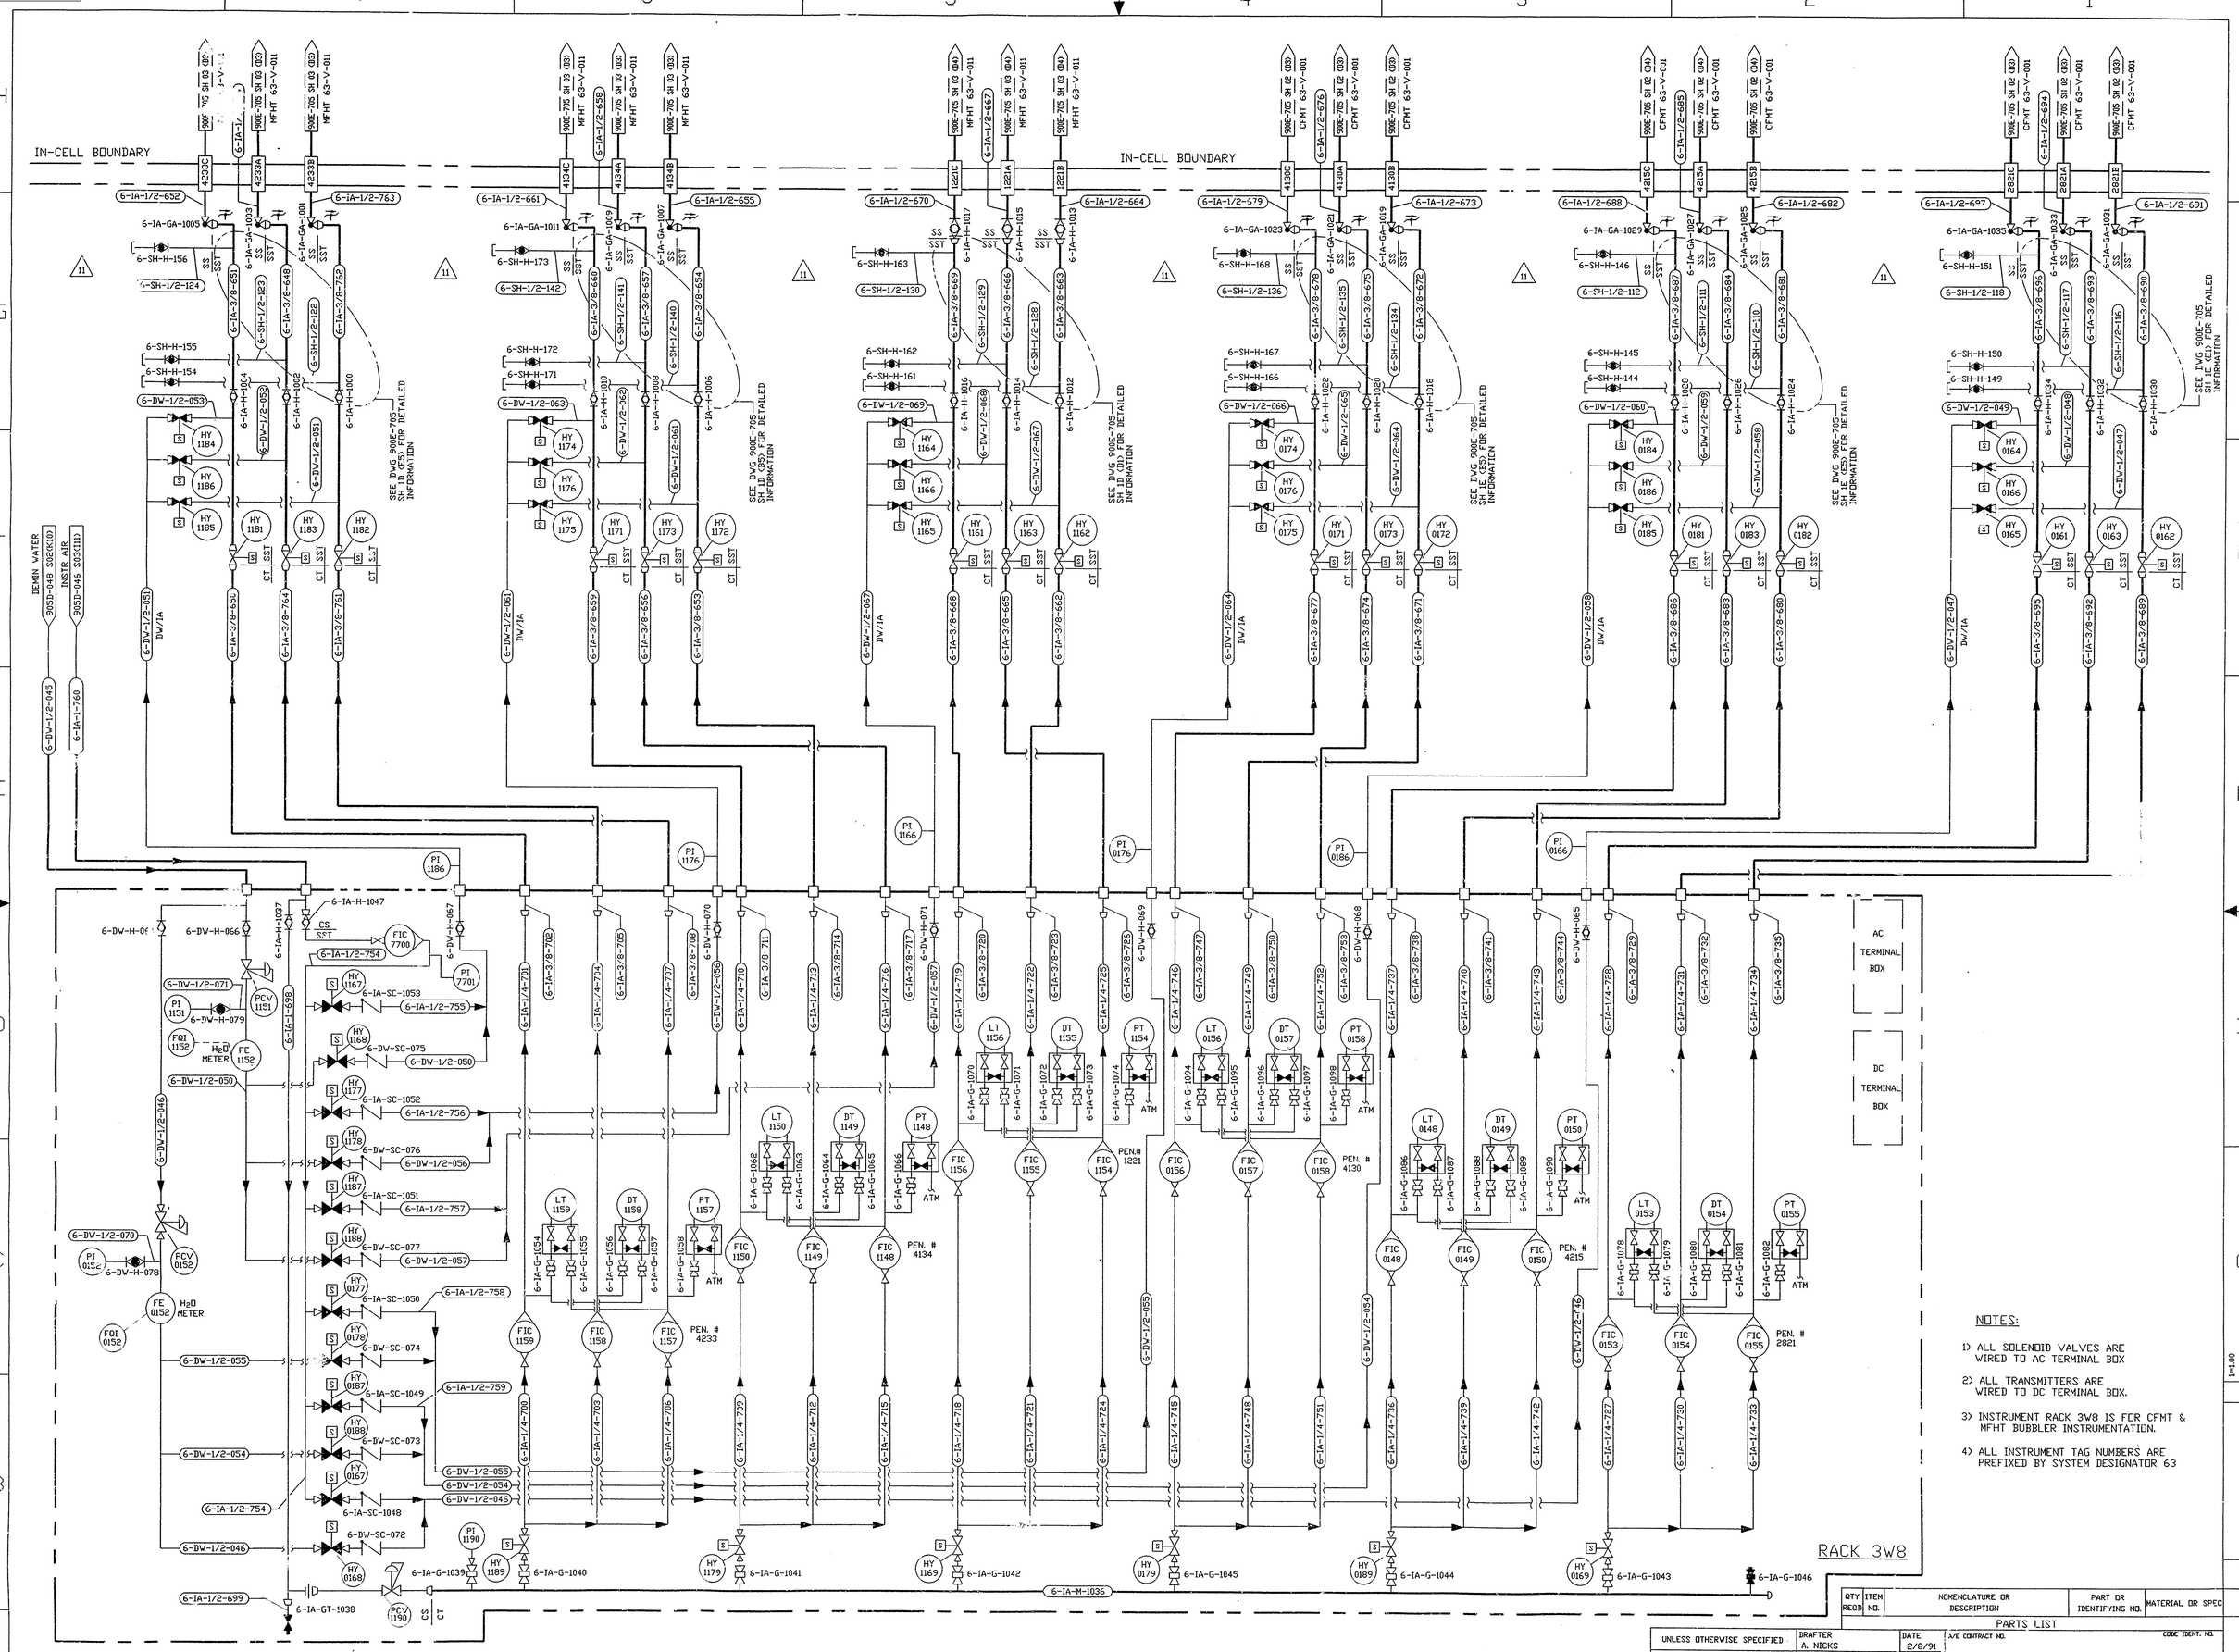

NOTES:

1) ALL SOLENOID VALVES ARE WIRED TO AC TERMINAL BOX
2) ALL TRANSMITTERS ARE WIRED TO DC TERMINAL BOX.
3) INSTRUMENT RACK 3W8 IS FOR CFMT & MFHT BUBBLER INSTRUMENTATION.
4) ALL INSTRUMENT TAG NUMBERS ARE PREFIXED BY SYSTEM DESIGNATOR 63

QTY REQD	ITEM NO.	NOMENCLATURE OR DESCRIPTION	PART OR IDENTIFYING NO.	MATERIAL OR SPEC

PARTS LIST

UNLESS OTHERWISE SPECIFIED	DRAFTER A. NICKS	DATE 2/8/91	A/E CONTRACT NO. / CODE IDENT. NO.
ALL DIM IN INCHES	CHECKER D. SHAFFER	DATE 4/10/91	FOR WEST VALLEY NUCLEAR SERVICES CO.,INC. WEST VALLEY, NEW YORK
TOLERANCES-DO NOT SCALE	ENGR. B. GERMONO	DATE 4/11/91	
2 PL DEC ± N/A; 3 PL DEC ± N/A; ANGLES ± N/A; N/A	COG.MGR.APPVL D. BURNS	DATE 4/11/91	VITRIFICATION FACILITY INSTRUMENT RACK 3W8 P & I D
FRACTIONS ± N/A	SYS.ENGR.APPVL P. SZALINSKI	DATE 4/19/91	
D.SPEC.NO. 1790	Q.A.APPVL P. WILLIAMS	DATE 4/11/91	DWG SIZE E; SCALE NONE; WEIGHT; DWG NO. 905E-045; REV 11
NEXT ASSEMBLY 905D-329	DFTG.SUPR. J. HORTON	DATE 4/19/91	A/E DWG NO.; SHEET 21 OF

REVISIONS

REV	DESCRIPTION	APVD
0	ER#2067 04/19/91	JRH
1	ECN 4647 SRC 01/07/92	DRS/DJR
2	ECN 6399 SRD 07/08/93	DRS/DJR
3	ECN 6891 MJL 11/12/93	DRS/LEP
4	ECN 8206 MJL 8/25/94	ARA/GGT
5	ECN 8579 MJL 8/22/95	KO/RAA
6	ECN 9188,9243 MJL 8/22/95	DRS
7	ECN 9610 AAJ 2/12/96	HAB
8	ECN 10117 DAK 8/5/96	EJS
9	ECN 10489 LRP 2/26/97	DRS
10	ECN 10625 RHW 6/12/97	DRS
11	ECN 12228 CAM 10/9/97	

CAD DRAWING-DO NOT REVISE THIS ORIGINAL

1=100 E045E021

Tue Oct 12 11:42:21 1999 HAB