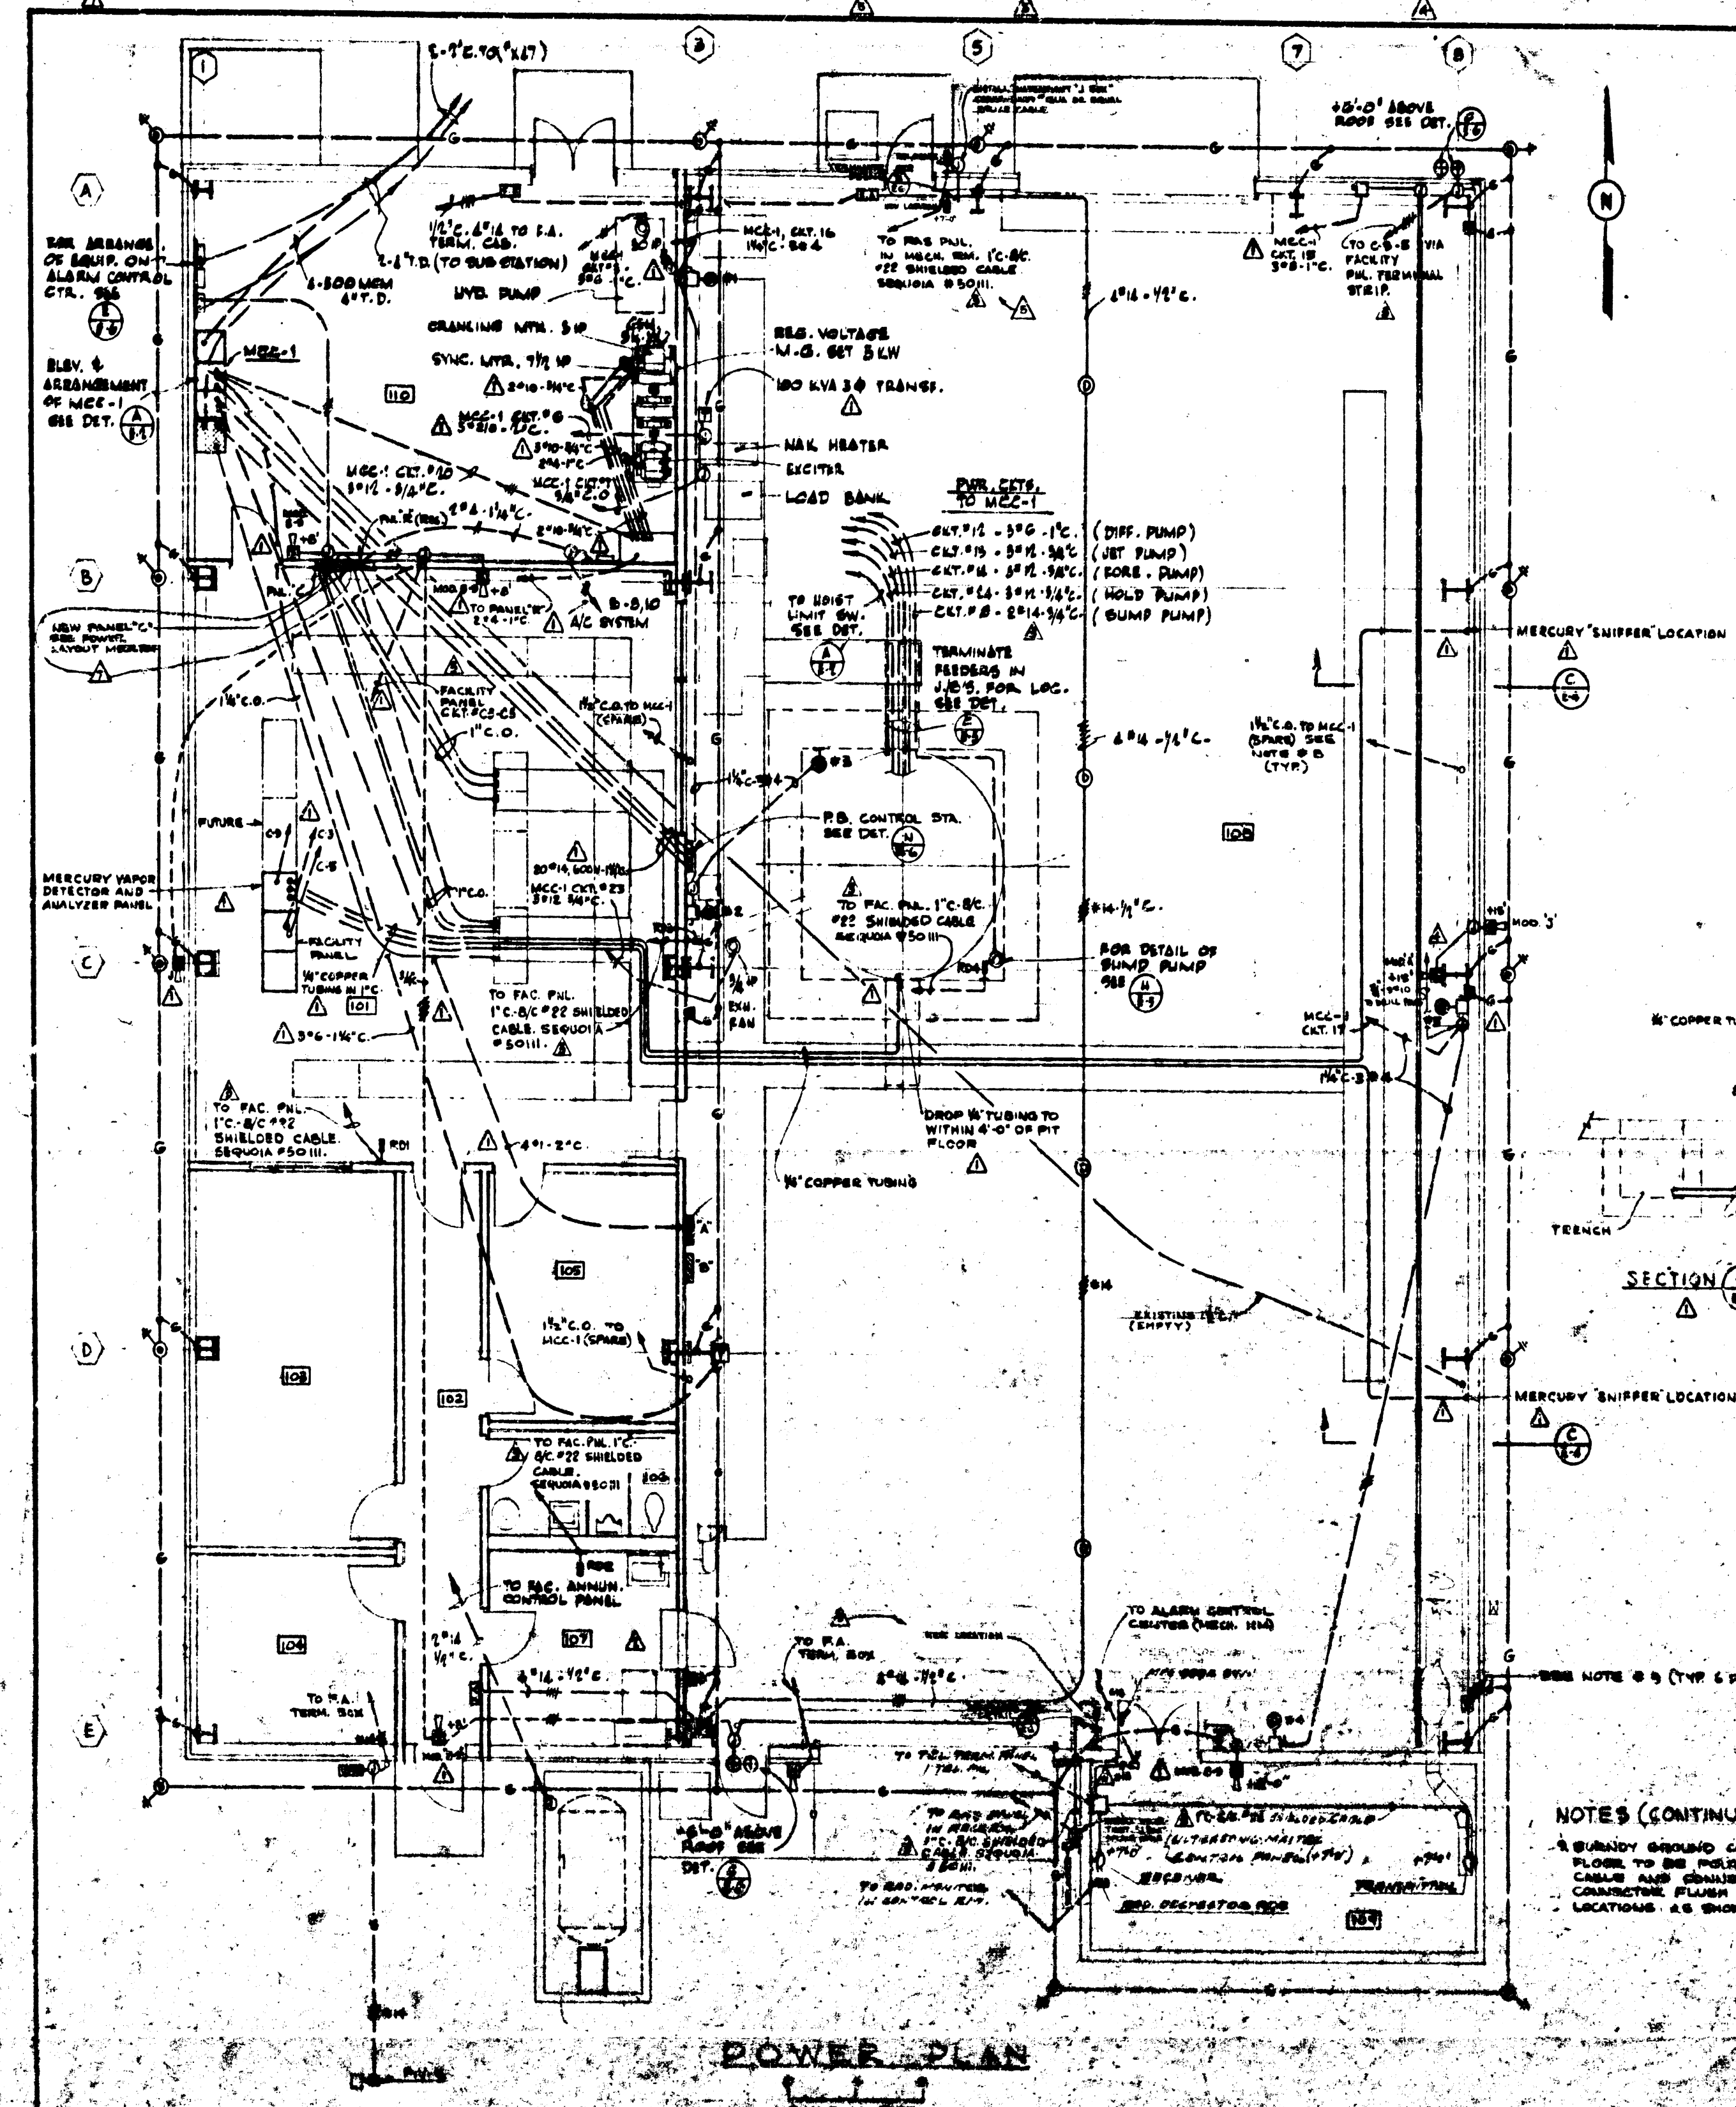

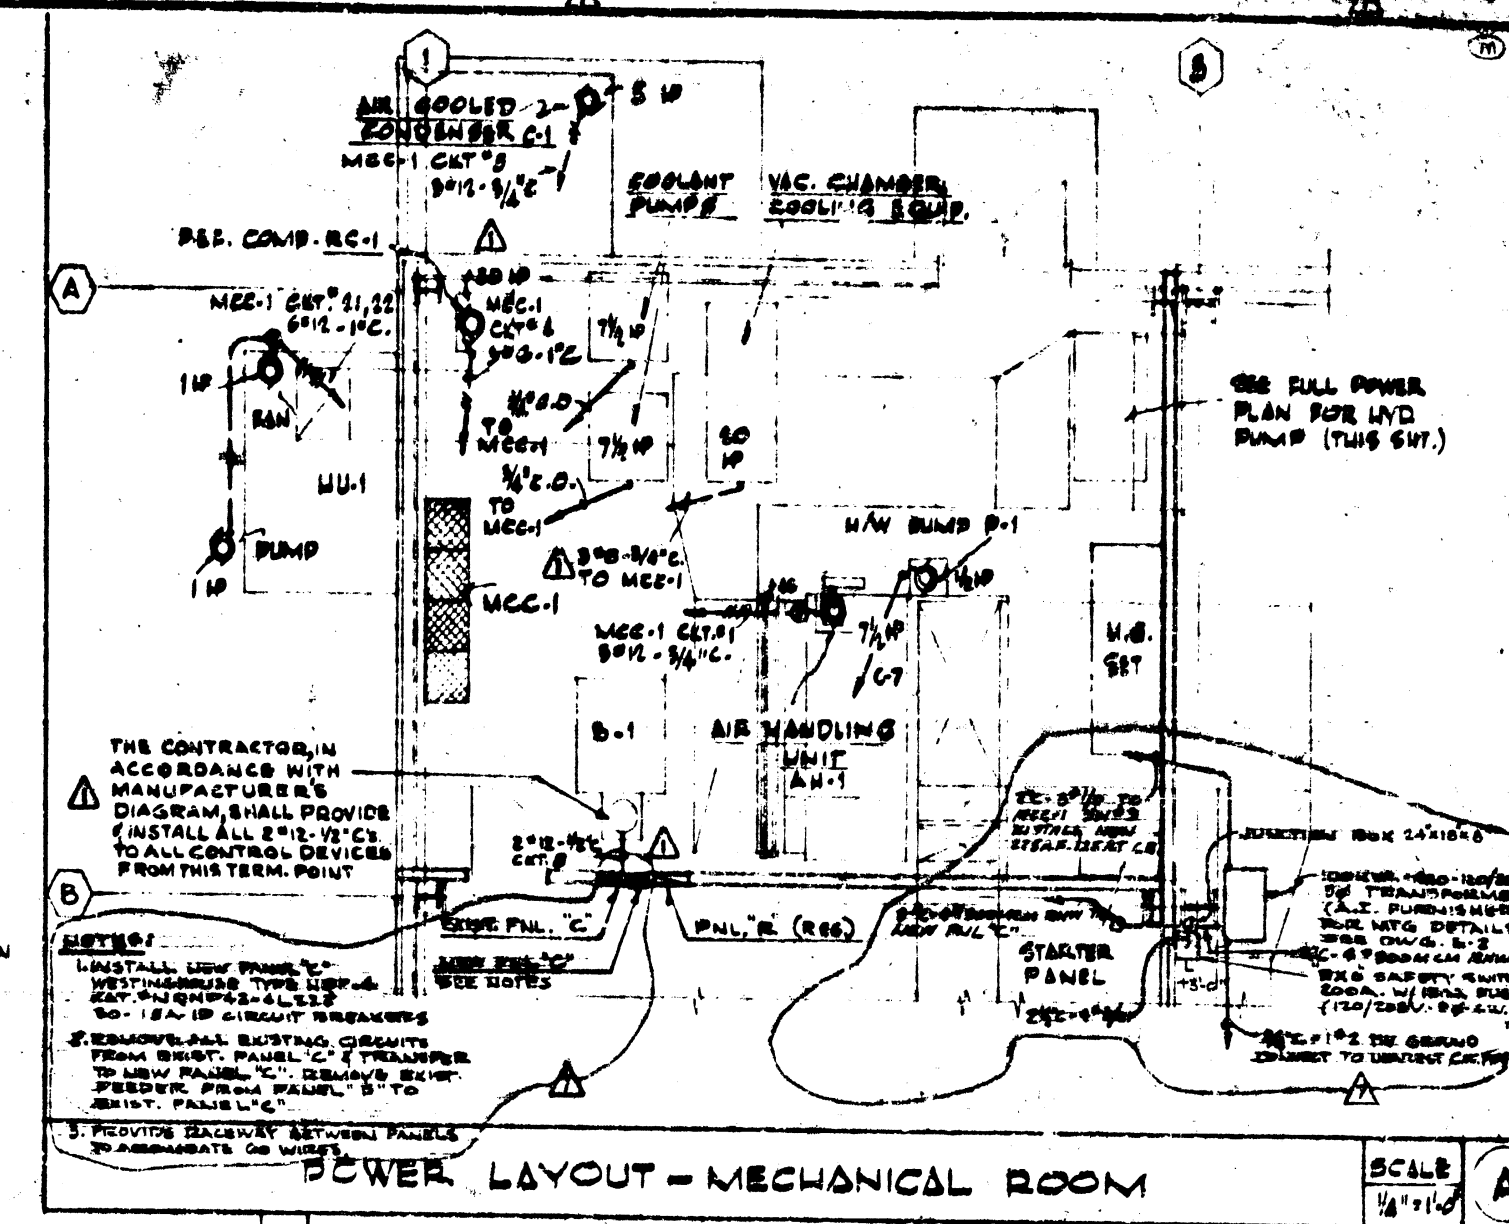

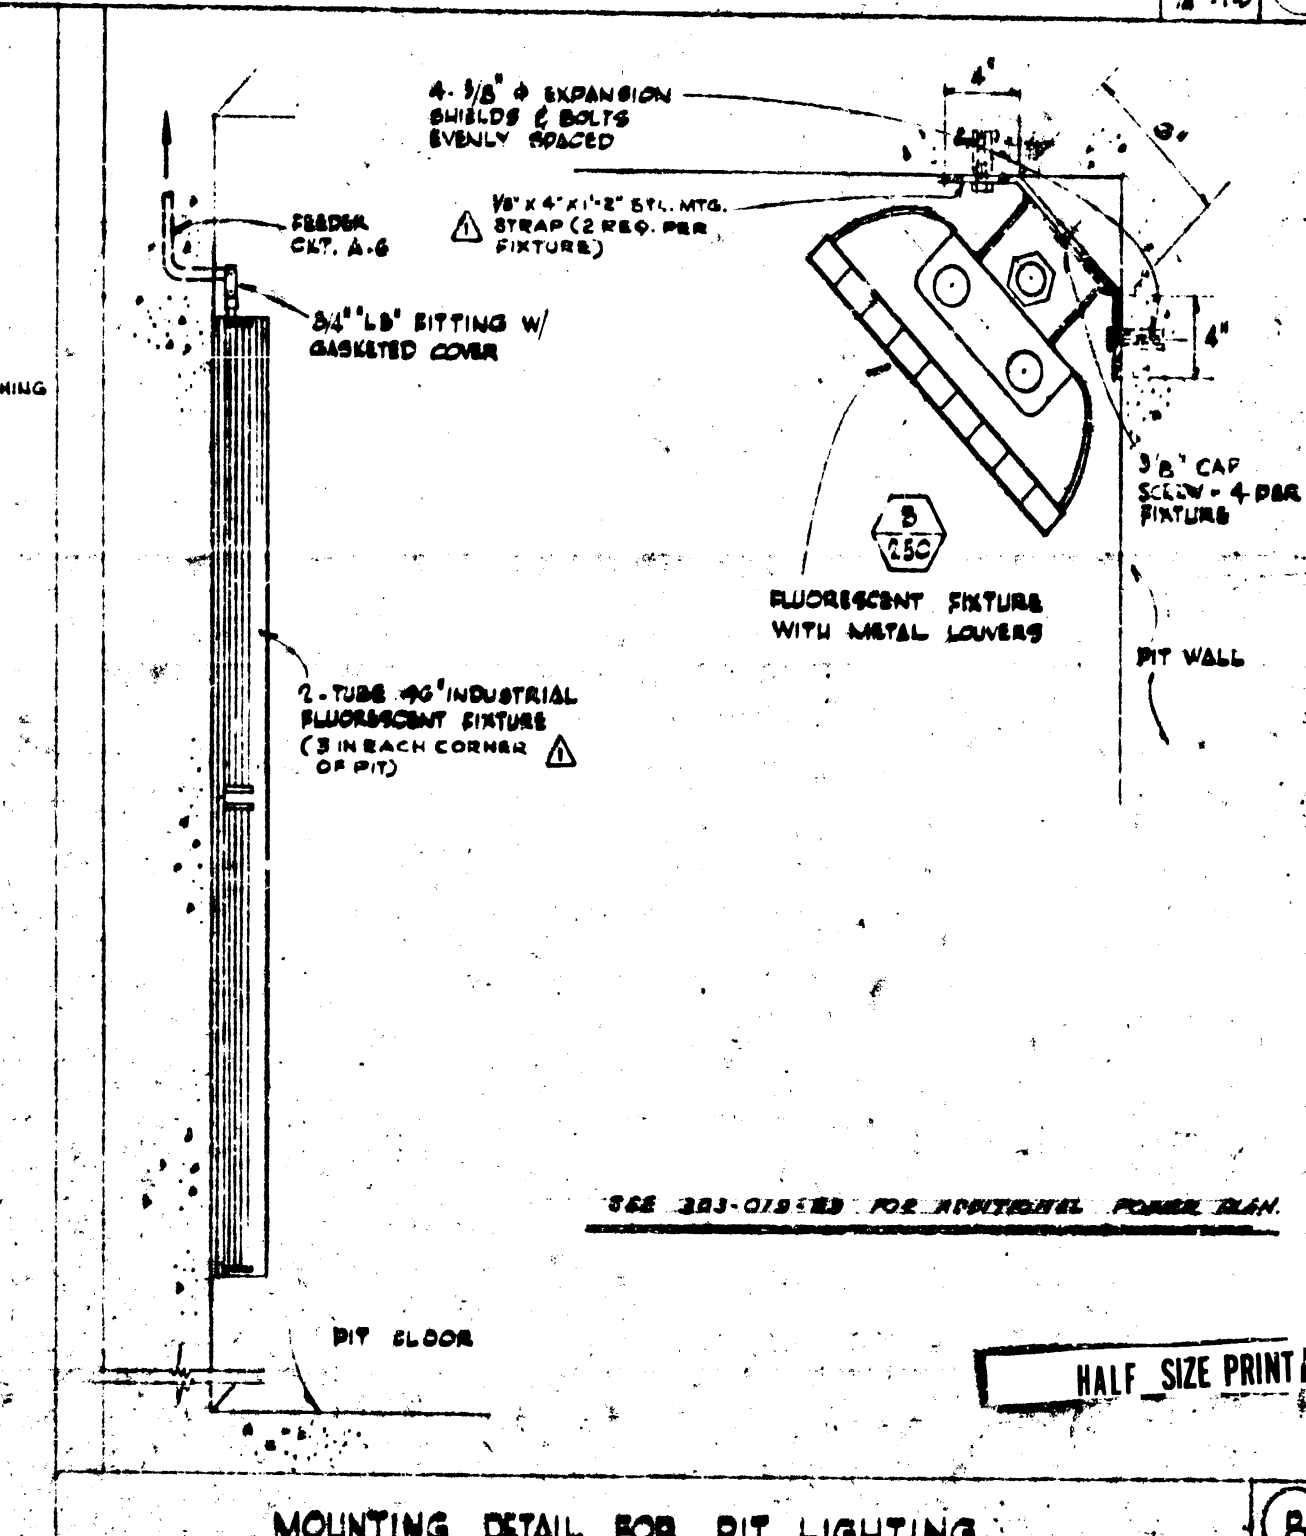

NOTES (CONTINUED)

9. BURNDY GROUND CONNECTOR TYPE GFG. FLOOR TO BE POURED OVER THE CONNECTING CABLE AND CONNECTOR, LEAVING THE TOP OF CONNECTOR FLUSH WITH FINISHED FLOOR LEVEL. LOCATIONS AS SHOWN ON DWG. (TOTAL OF 6)

NOTES:

1. MOUNT 480V. RECEPTACLES 5'-0" ABOVE FLOOR.
2. MOUNT HAD'S ON BTM. SIDE OF ROOF PURLINS IN CENTER OF EACH BAY.
3. TERMINATE CONCRETE ENVELOPE 2'-0" INSIDE OF BLDG. & CONTINUE WITH RIGID STEEL GALV. CONDUIT UNDER FLOOR.
4. TERMINATE ALL CONDUITS 1" INSIDE TRENCH WITH BUSHING.
5. MOUNT RADIATION PROBES 7'-0" ABOVE FLOOR. SEE
6. ALL CONDUIT RUN UNDER THE FLOOR SHALL BE KEPT SUFFICIENTLY LOW TO AVOID TRENCHES.
7. FOR SYMBOL LIST SEE DWG. E-1
8. ALL SPARE CONDUITS SHALL BE STUBBED UP 6" & CAPPED

	REVISED AS PER BULLETIN NO. 1		
	REVISED AS PER ADDENDUM NO. 2		
	REVISED AS PER ADDENDUM NO. 1		

NORMAN ENGINEERING CO.
CONSULTING ENGINEERS
LOS ANGELES, CALIFORNIA

U.S. ATOMIC ENERGY COMMISSION
CHICAGO OPERATIONS OFFICE
SNAP FACILITIES-SANTA SUSANA, CALIFORNIA

BUILDING 019
SNAP FLIGHT SYSTEMS PROTOTYPE
NUCLEAR TEST FACILITY
POWER PLAN

E-4
303-019-E4