REVISIONS			
SYM	DESCRIPTION	DATE	APPROVED
6	INSTALL MASTER CUT-OFF SWITCH FOR VENTILATION SYSTEM PER MEMO 7216-9	5-1-68	J.R.

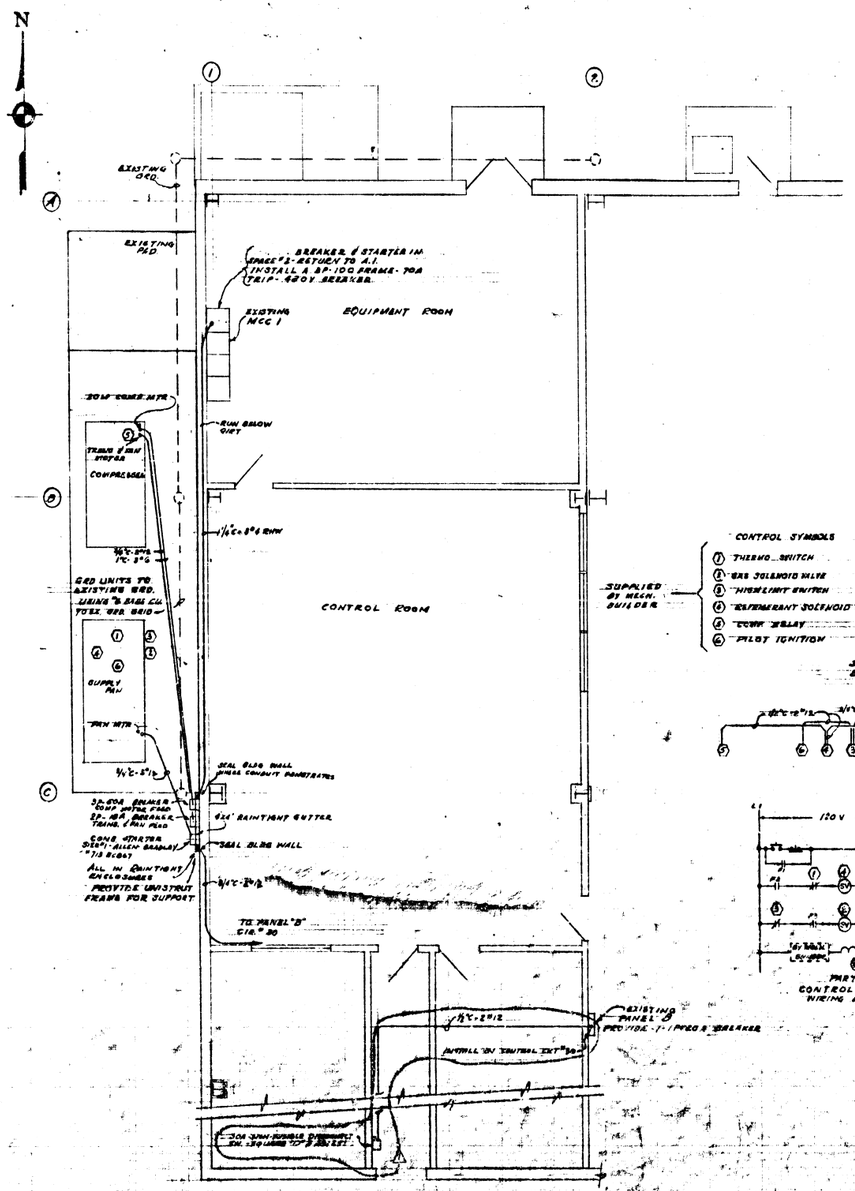

Notes

1. VERIFY ALL CONNECTIONS WITH A/C BUILDER.
2. ELECTRICAL BUILDER SHALL DO ALL CONTROL WIRING AS SHOWN.
3. RAINTIGHT ENCLOSURES & STARTERS SHALL BE SUPPORTED ON A UNISTRUT FRAME WORK.
4. RUN ALL OUTSIDE CONDUIT IN SLAB EXCEPT WHERE IT MUST BE EXPOSED, I.E. BLDG WALL TO BREAKERS ETC.
5. WHERE CONDUIT PENETRATES BLDG WALL - IT SHALL BE MADE WATER PROOF BY SEALING.

FOR FLOW DIAGRAM - SEE 808-019-M6

THR 4/6/68

ATOMICS INTERNATIONAL
A DIVISION OF NORTH AMERICAN AVIATION, INC.
8900 DESOTO AVENUE, CANOGA PARK, CALIF.

SANTA SUSANA FACILITY - BUILDING - 019
SNAP FLIGHT SYSTEM PROTOTYPE
NUCLEAR TEST FACILITY
A/C MODIFICATION - ELECTRICAL POWER PLAN

DRAWN		APPROVED	D
CHECKED		SIZE	303-019-E9
ENGINEER		SCALE	
APPROVED		1/4"=1'	SHEET NO. OF

REDUCED DRAWING