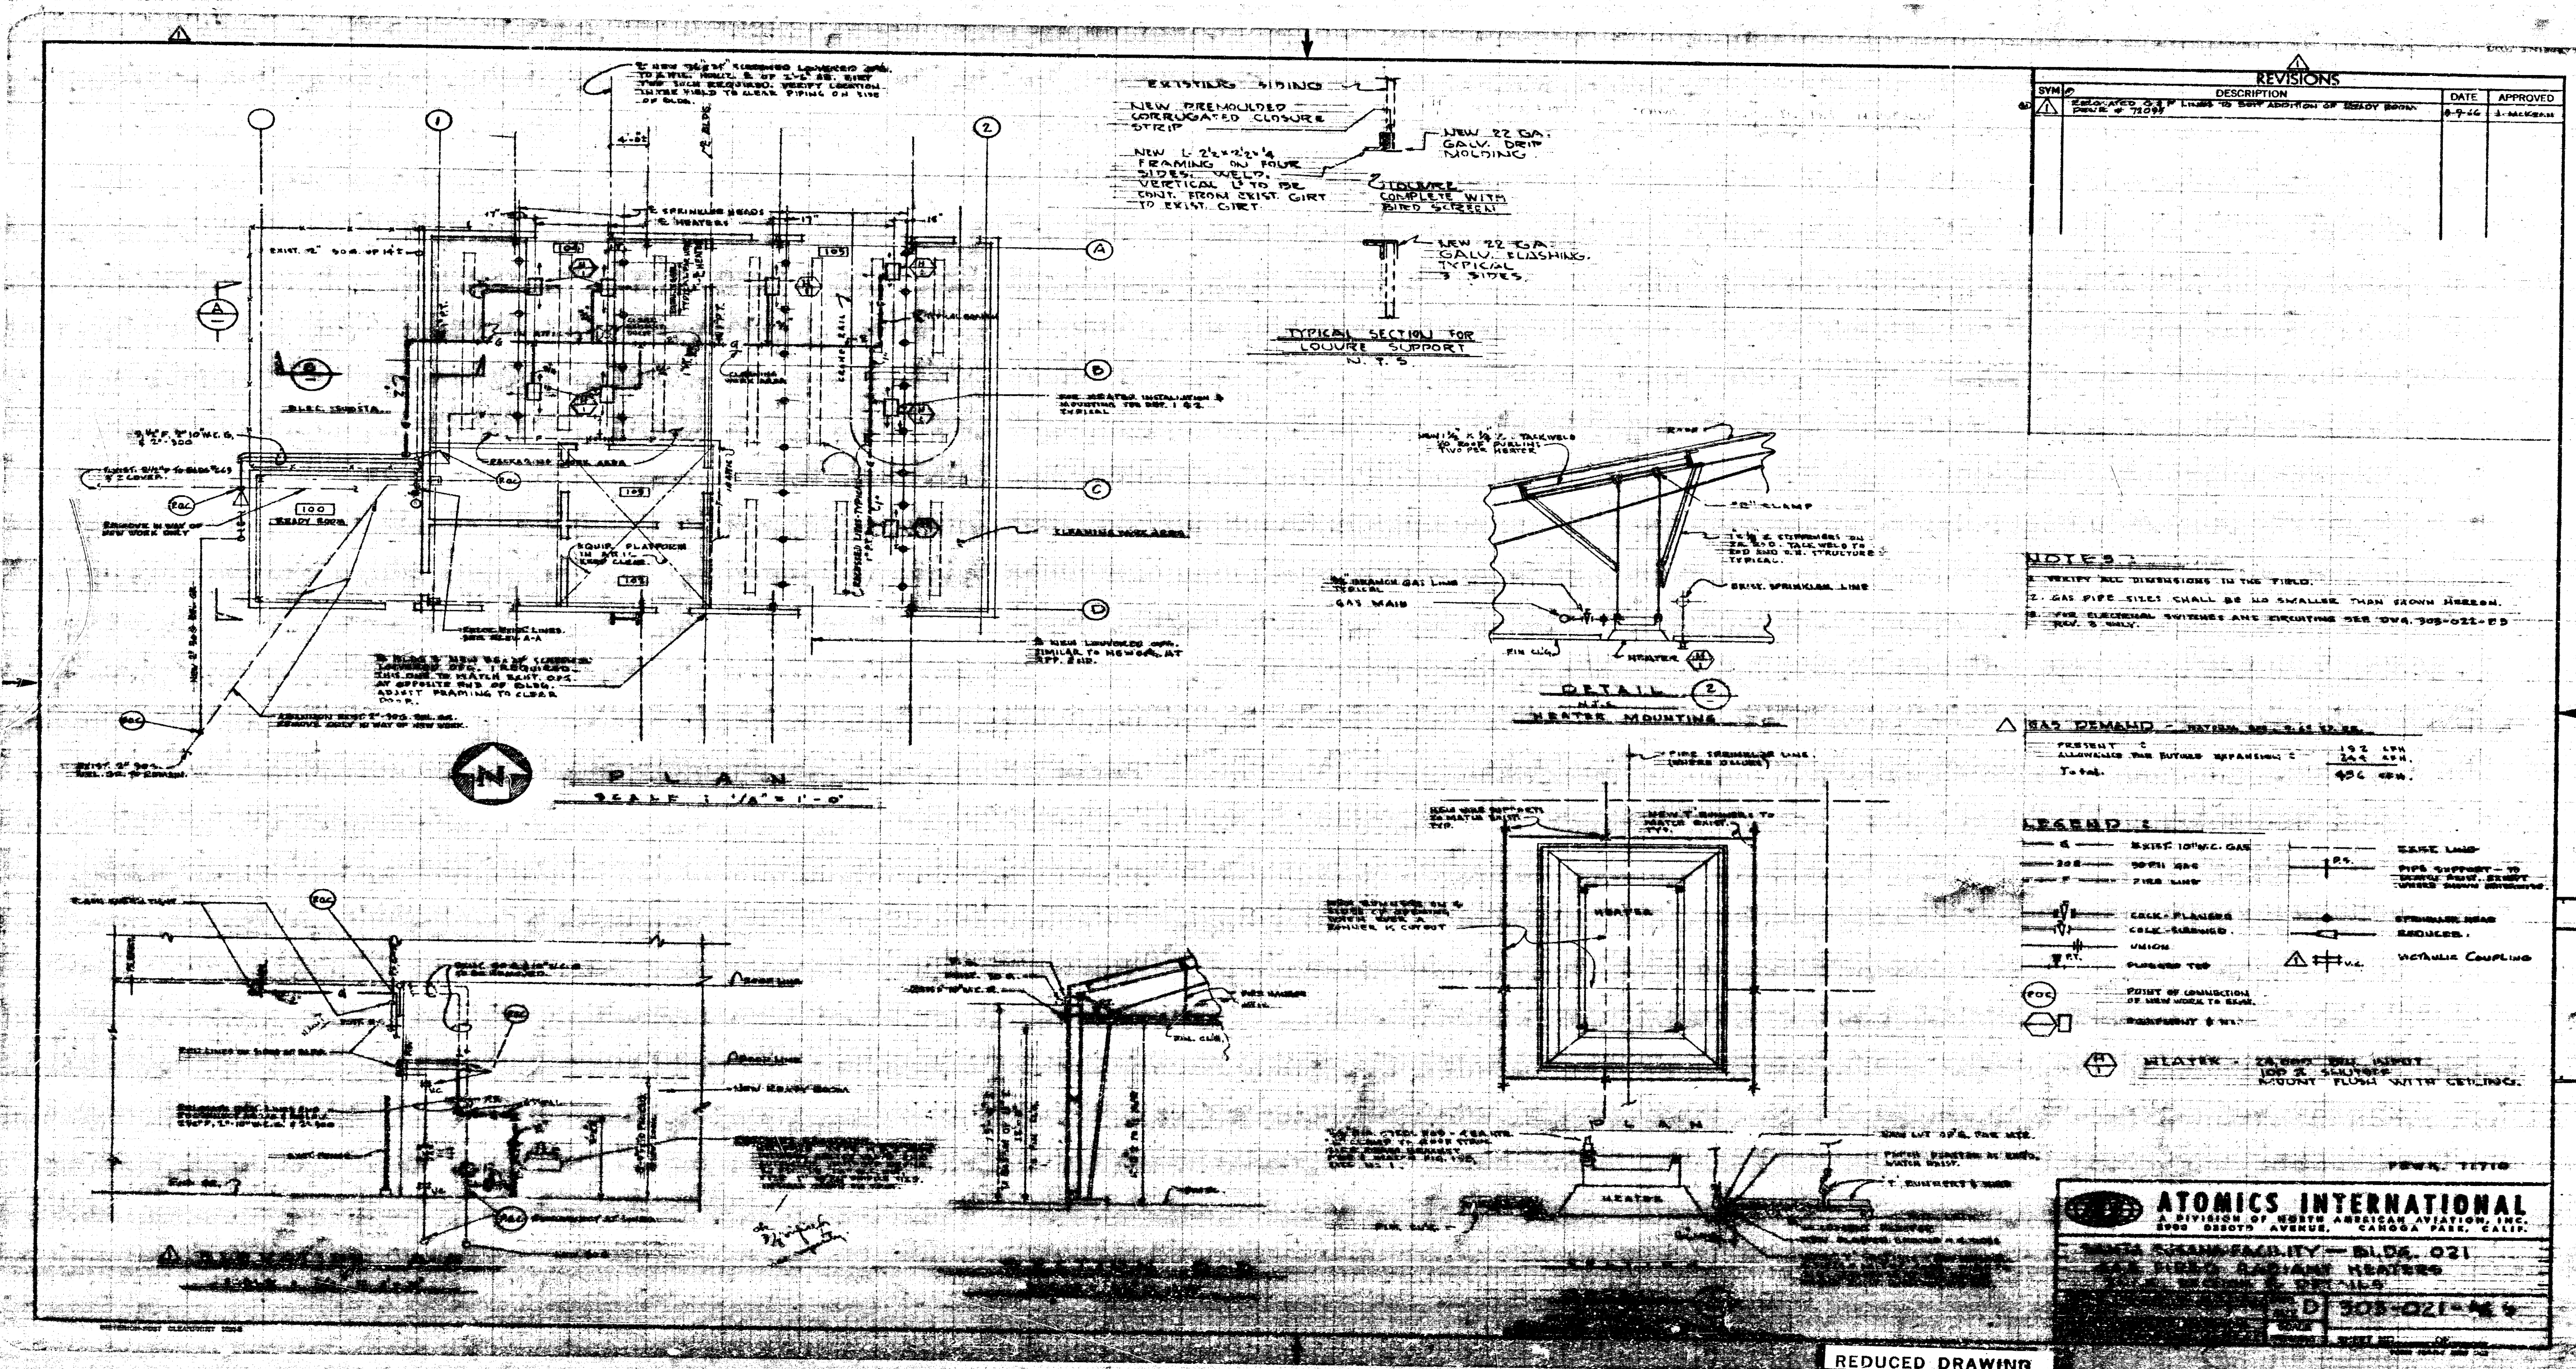
EXISTING SIDING
NEW PREMOULDED CORRUGATED CLOSURE STRIP
NEW 22 GA. GALV. DRIP MOLDING
NEW L 2½×2½×¼ FRAMING ON FOUR SIDES. WELD. VERTICAL L'S TO BE CONT. FROM EXIST. GIRT TO EXIST. GIRT
LOUVRE COMPLETE WITH BIRD SCREEN
NEW 22 GA. GALV. FLASHING. TYPICAL 3 SIDES.
TYPICAL SECTION FOR LOUVRE SUPPORT
N.T.S.
REVISIONS
SYM
DESCRIPTION
DATE
APPROVED
NOTES:
1. VERIFY ALL DIMENSIONS IN THE FIELD.
2. GAS PIPE SIZES SHALL BE NO SMALLER THAN SHOWN HEREON.
3. FOR ELECTRICAL SWITCHES AND CIRCUITING SEE DWG. 303-021-E5 REV. 5 ONLY.
GAS DEMAND
PRESENT: 192 CFH
ALLOWANCE FOR FUTURE EXPANSION: 244 CFH.
Total 436 CFH.
LEGEND:
EXIST. 10" W.C. GAS
FIRE LINE
COCK-FLANGED
COCK-SCREWED
UNION
PLUGGED TEE
SPRINKLER HEAD
REDUCER
VICTAULIC COUPLING
POINT OF CONNECTION OF NEW WORK TO EXIST.
HEATER - 24,000 BTU INPUT
MOUNT FLUSH WITH CEILING.
100 READY ROOM
ELEC. SUBSTA.
PACKAGING WORK AREA
EQUIP. PLATFORM
CLEANING WORK AREA
PLAN
SCALE: 1/8" = 1'-0"
DETAIL 2
N.T.S.
HEATER MOUNTING
HEATER
ATOMICS INTERNATIONAL
A DIVISION OF NORTH AMERICAN AVIATION, INC.
8900 DESOTO AVENUE, CANOGA PARK, CALIF.
SANTA SUSANA FACILITY — BLDG. 021
GAS FIRED RADIANT HEATERS
D
REDUCED DRAWING