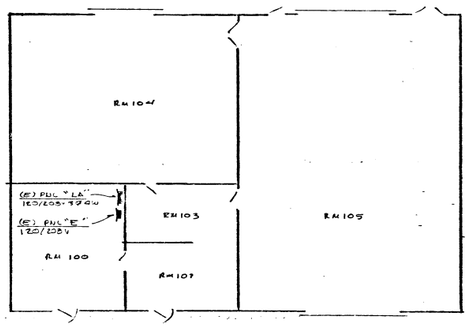

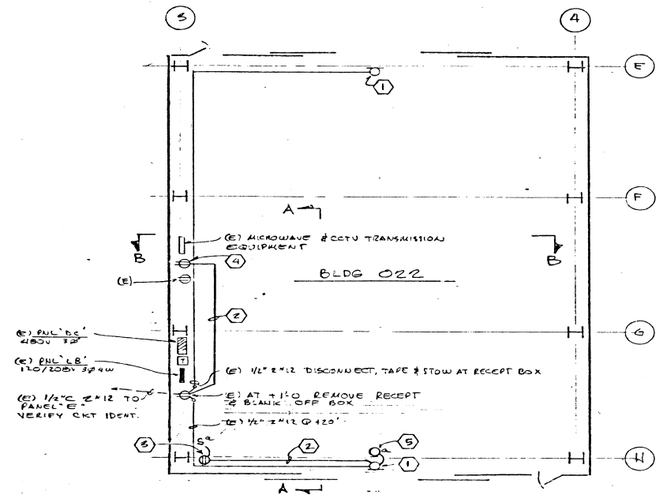

PLAN - BLDGS 021, 022
SCALE 1/8"=1'-0

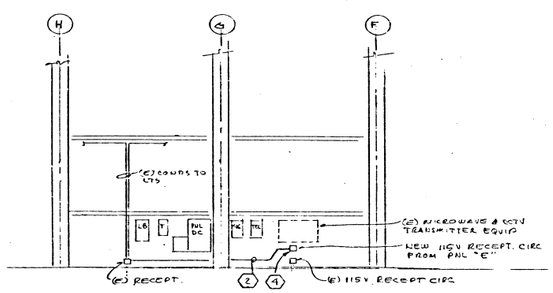

ELEVATION A-A

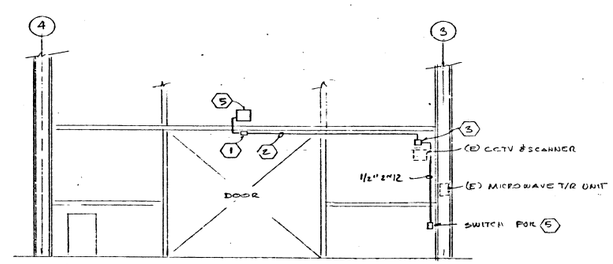

ELEVATION BB

REDUCED DRAWING

SYMBOLS

———	CONDUIT & WIRE EXPOSED
(E)	EXISTING
⊕	JUNCTION BOX
⊖	DUPLEX RECEPTACLE OUTLET 115V, 15A 2P 3W
S	SWITCH 1PST 15A 115V

NOTE

1. REMOVE EXIST LIGHTING FIXTURE, & BLANK OFF OUTLET BOX.
2. EXTEND EMERG CIRCUIT, 1/2" 2#12 TO NEW RECEPT OUTLET
3. PROVIDE RECEPT OUTLET FOR CCTV CAMERA & AUTO SCANNER. PROVIDE NEW CORD & CAP FOR CAMERA & SCANNER
4. PROVIDE RECEPT OUTLET FOR CCTV GRUNDIG TRANSMITTER & MICROWAVE INTRUSION EQUIPMENT, RECONNECT MICROWAVE 1/2"C 2#12 TO EMERG CIRCUIT.
5. LIGHT FIXTURE, WALL MTG. 7415, WIDE SYMMETRICAL DISTRIBUTION, 400W HIGH PRESS SODIUM LAMP. 120V 60HZ BALLAST HOLOPHANE 606-120-EA-WA, WITH SYLVANIA LU400 LUMALUX LAMP
6. PROVIDE IDENTIFYING LEGENDS AT EACH EMERG RECEPT OUTLET & AT LIGHT FIXT

PEWR 75641

REV.	DATE	DESCRIPTION	BY	BY

FACILITIES ENGINEERING — Rockwell International Corporation, Atomics International Division

SANTA SUSANA FACILITY, B 022
EMERG POWER FOR SECURITY SYSTEMS
PLAN & DETAILS

APPROVED BY	DESIGNED BY M. Hagerdorff	RELEASE DATE APRIL 16, 1976	REF. NO. PEWR 75641
APPROVED BY	DRAWN BY M.H.H.	DRAWING NO. 303-022-E7	REV. NO.
APPROVED BY	CHECKED BY		

MICROFILMED