REVISIONS			
SYM	DESCRIPTION	DATE	APPROVED

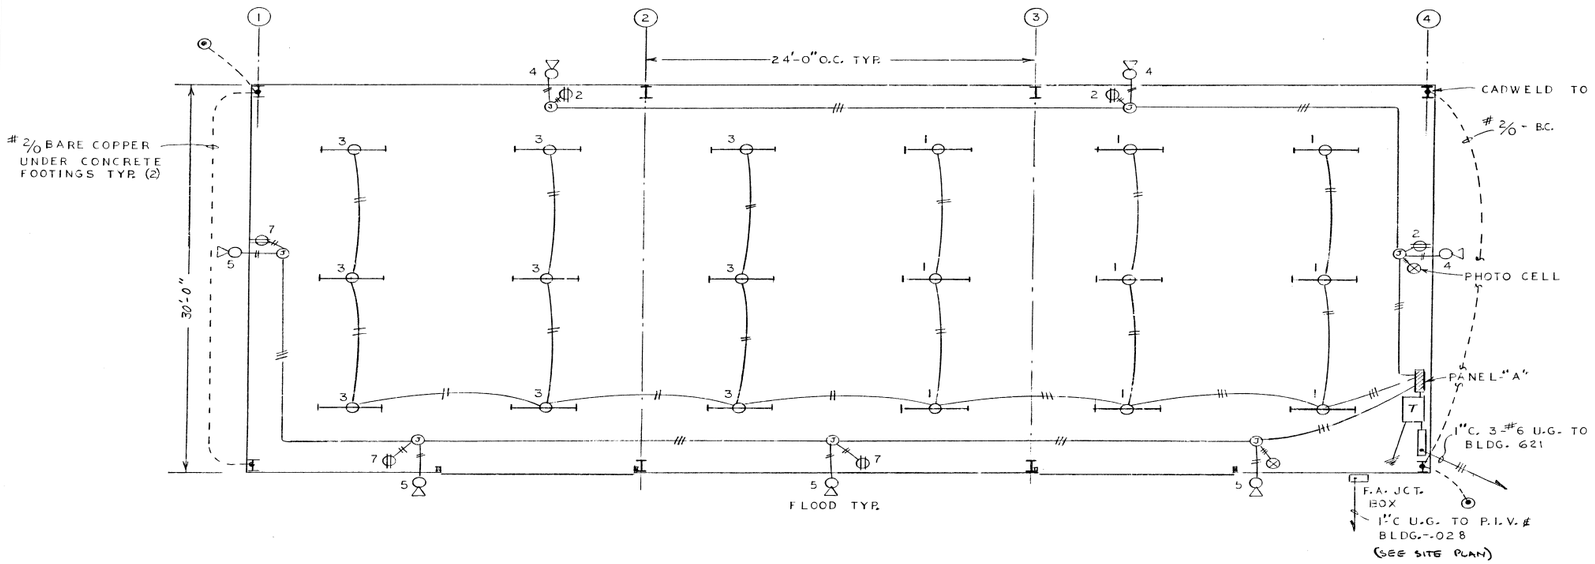

PANEL "A" 120/240 V 1 Ø 3 W.									
DESC.	W.	POL	A.	CIR NO		CIR NO	A.	POL	W.	DESC.
LIGHTS	900	1	20	1		2	20	1	540	RECPT.
"	900	↓	↓	3		4	↓	↓	450	FLOODS
FLOODS	600	↓	↓	5		6	↓	↓		SPARE
RECPT.	540	↓	↓	7		8	↓	↓		"
W. Ø A = 2040			W. Ø B = 1890			TOT. CONN. LOAD = 17 A.				

NOTES

- 4'-0" 2 LAMP IND. FIX. WESTERN NO. 122 - 48 RS
- 150 W. PAR - 38 FLOOD STONCO MTG. HT. +12'-0"
- TRANSFORMER 480V. - 120/240 V. 1 Ø 3W.
- PHOTO CONTROL INTERMATIC NO. - K1611
- DUPLEX RECPT. HUBB. # 5252
- COPPERWELD GRD. ROD 3/4" DIA. X 8'-0" LONG WITH BRONZE CLAMP TYP. FOR (2)

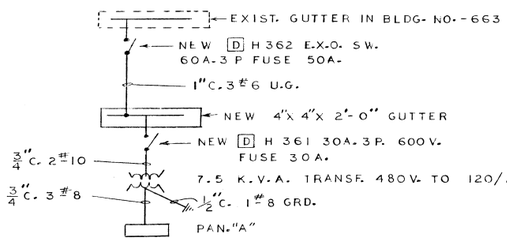

$$F.C. = \frac{\text{LUM. X COEF. UTIL. X MAINT. FACT.}}{\text{SQ. FT.}}$$

$$F.C. = \frac{113400 \times .57 \times .70}{2160} = 20.9 \text{ FT. CANDLES}$$

36-4' LAMPS @ 3150 LUMENS EA. = 113400

PEWR # 63692

ATOMICS INTERNATIONAL
A DIVISION OF NORTH AMERICAN AVIATION, INC.
8900 DESOTO AVENUE, CANOGA PARK, CALIF.

CONTAMINATED EQUIPMENT STORAGE BUILDING - 075 POWER & LIGHTING

DRAWN	R.G.M.	8-71	DWG. SIZE D	303-075 E-2
CHECKED			SCALE 1/4" = 1'-0"	
ENGINEER				
APPROVED			SHEET NO. 1 OF 1	

DIETERICH-POST CLEARPRINT 1020-B

FORM N94-R7 NEW 7-62