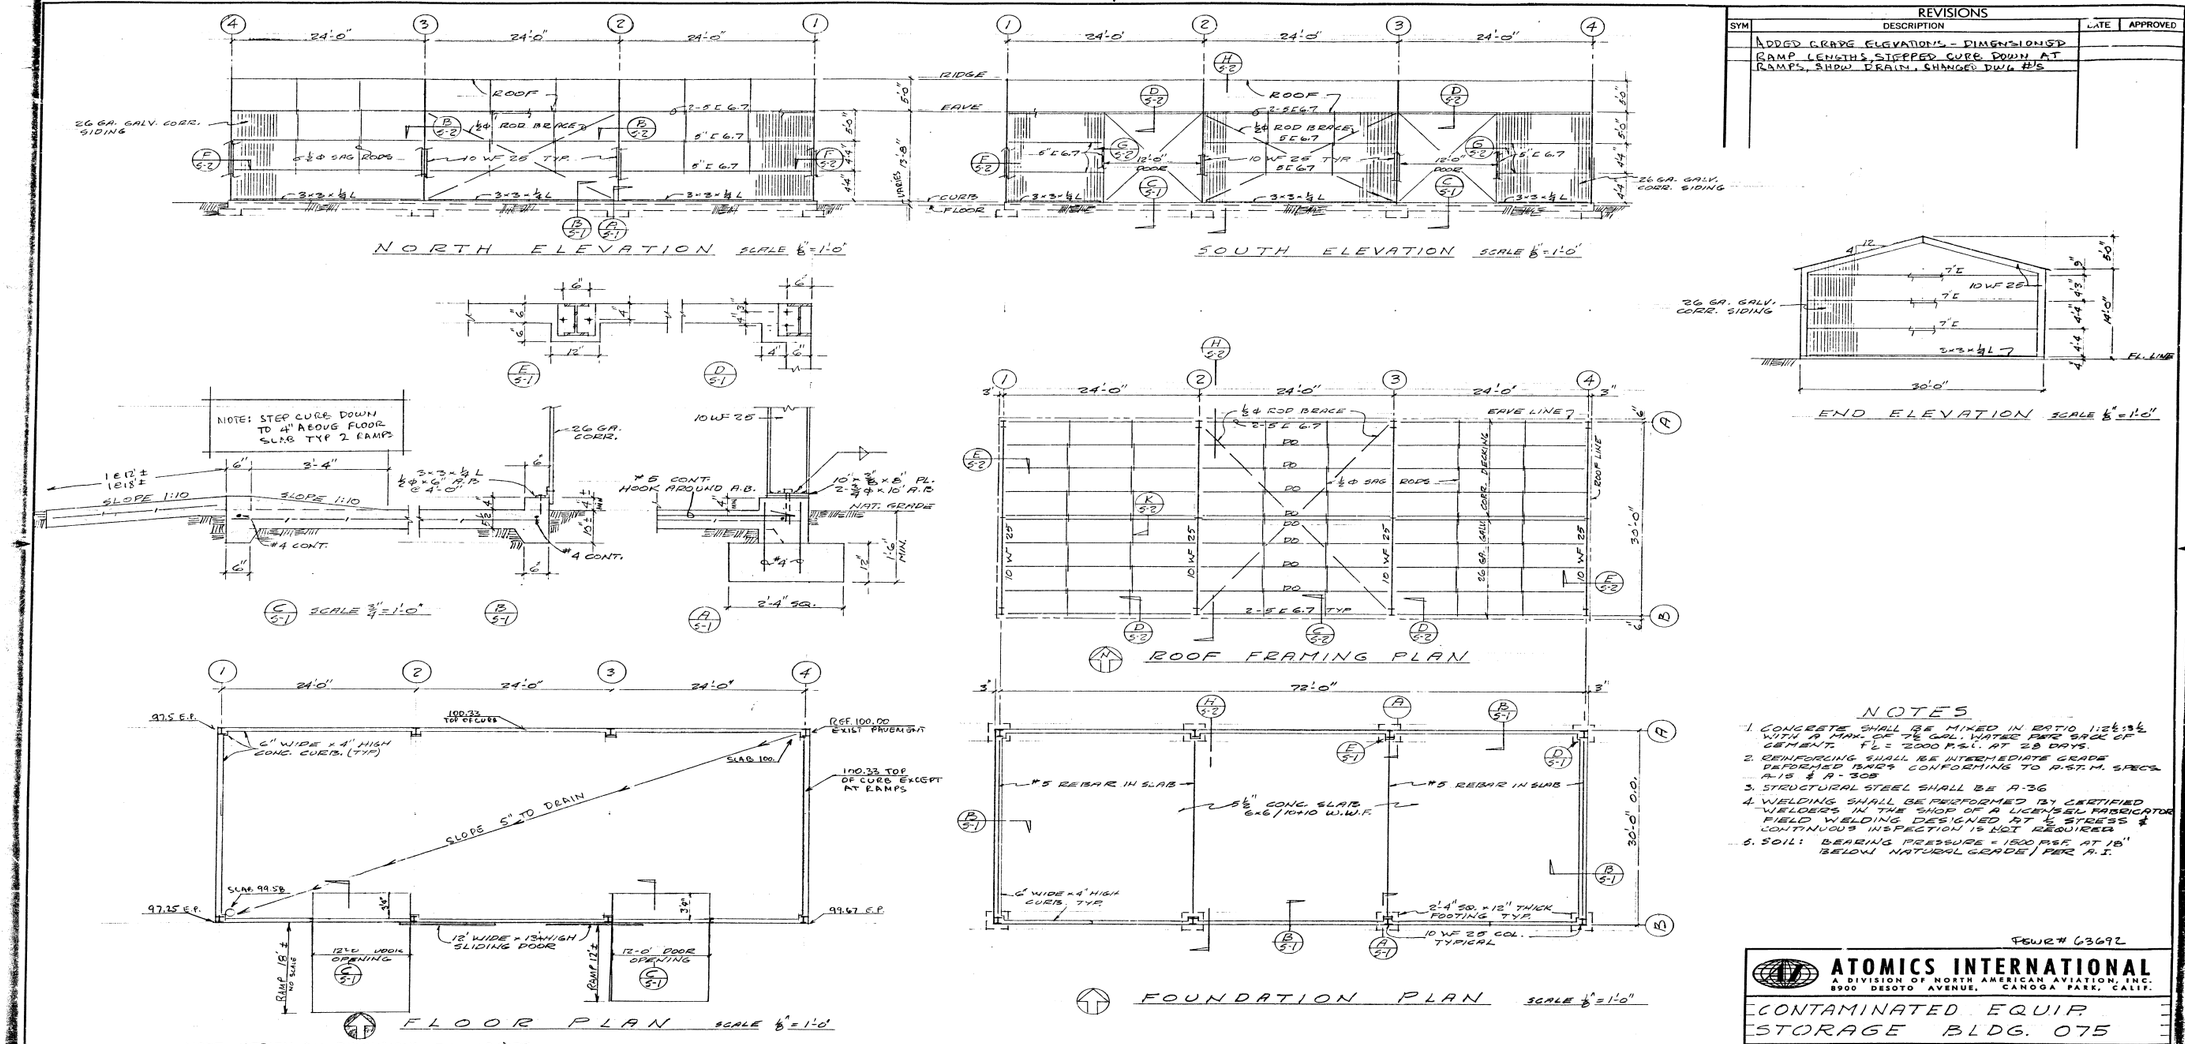

REVISIONS			
SYM	DESCRIPTION	DATE	APPROVED
	ADDED GRADE ELEVATIONS - DIMENSIONED RAMP LENGTHS, STEPPED CURB DOWN AT RAMPS, SHOW DRAIN, CHANGED DWG #'S		

NOTES

1. CONCRETE SHALL BE MIXED IN RATIO 1:2 1/2:3 1/2 WITH A MAX. OF 7 1/2 GAL. WATER PER SACK OF CEMENT. f'_c = 2000 P.S.I. AT 28 DAYS.
2. REINFORCING SHALL BE INTERMEDIATE GRADE DEFORMED BARS CONFORMING TO A.S.T.M. SPECS. A-15 & A-305
3. STRUCTURAL STEEL SHALL BE A-36
4. WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS IN THE SHOP OF A LICENSED FABRICATOR FIELD WELDING DESIGNED AT 1/2 STRESS & CONTINUOUS INSPECTION IS NOT REQUIRED
5. SOIL: BEARING PRESSURE = 1500 PSF AT 18" BELOW NATURAL GRADE / PER A.I.

FSWR# 63692

ATOMICS INTERNATIONAL
A DIVISION OF NORTH AMERICAN AVIATION, INC.
8900 DESOTO AVENUE, CANOGA PARK, CALIF.

CONTAMINATED EQUIP. STORAGE BLDG. 075

DRAWN	J. FRANCIS	5-71	DWG. SIZE D	303-075-S1
CHECKED				
ENGINEER	J. FRANCIS	5-71	SCALE NOTED	SHEET NO. ___ OF ___
APPROVED				

J.H. FRANCIS - 367-8065
STRUCT. ENGR. - 1255

FORM N56-R-7 NEW 74

DIETERICH-POST CLEARPRINT 1020-8