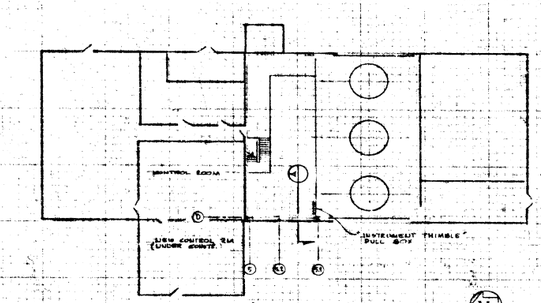

BUILDING PLAN

SCALE 1"=20'-0"

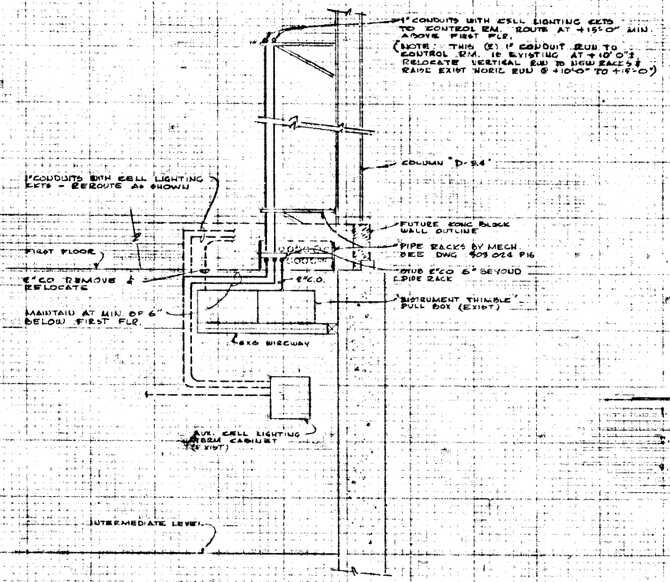

SECTION A

SCALE 3/8"=1'-0"

NOTE CONDUIT SHOWN WITH BROKEN LINES IS EXISTING CONDUIT SHOWN WITH SOLID LINES INDICATES NEW CONDUIT OR RELOCATED EXIST CONDUIT.

REVISIONS			
SYM	DESCRIPTION	DATE	SIGNATURE

NOTES

1. CONDUIT SHALL BE RIGID GALVANIZED TYPE. WIRE SHALL BE TYPE TW. SIZE AS REQD TO MATCH EXIST CKTS.
2. CONDUIT INSTALLATION AT INSTRUMENT THIMBLE PULL BOX SHALL BE ACCOMPLISHED WITHOUT DISTURBING EXIST INSTRUMENTATION WIRING IN BOX.
3. CONDUITS ON RACK SHALL BE GROUPED AS CLOSE TOGETHER AS POSSIBLE TO ALLOW SPACE FOR FUTURE PIPING.

REDUCED DRAWING

TWD. 34222

NOTICE

THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY DESIGN INFORMATION OF ATOMICS INTERNATIONAL, A DIVISION OF NORTH AMERICAN AVIATION, INC. AND AS SUCH IS ESPECIALLY ENTRUSTED TO IT IN CONFIDENCE IN A TRUST RELATIONSHIP. IT IS SUBMITTED WITH THE UNDERSTANDING THAT IT WILL NOT BE USED FOR ANY OTHER PURPOSE, NOR ITS CONTENTS DIVULGED TO ANYONE EXCEPT FOR THAT PURPOSE, NOR COPIED IN WHOLE OR IN PART, NOR ITS SPECIAL FEATURES USED IN OTHER PROJECTS. IT WILL BE RETURNED TO ATOMICS INTERNATIONAL WHEN NO LONGER REQUIRED OR UPON REQUEST.

ATOMICS INTERNATIONAL
A DIVISION OF NORTH AMERICAN AVIATION, INC.
8900 DE SOTO AVENUE, CANOGA PARK, CALIF.

S.E.T.F. BUILDING T024

VACUUM TEST FACILITY 10F61

CONDUIT RELOCATION

DESIGN	M. Hibberd	9-11-62	SIZE D	303 024 E 27
DRAWN				
CHECKED			SCALE 1/8"=1'-0"	
APPROVED				SHEET NO. OF

FORM 1000-0-0 REV. 9-57