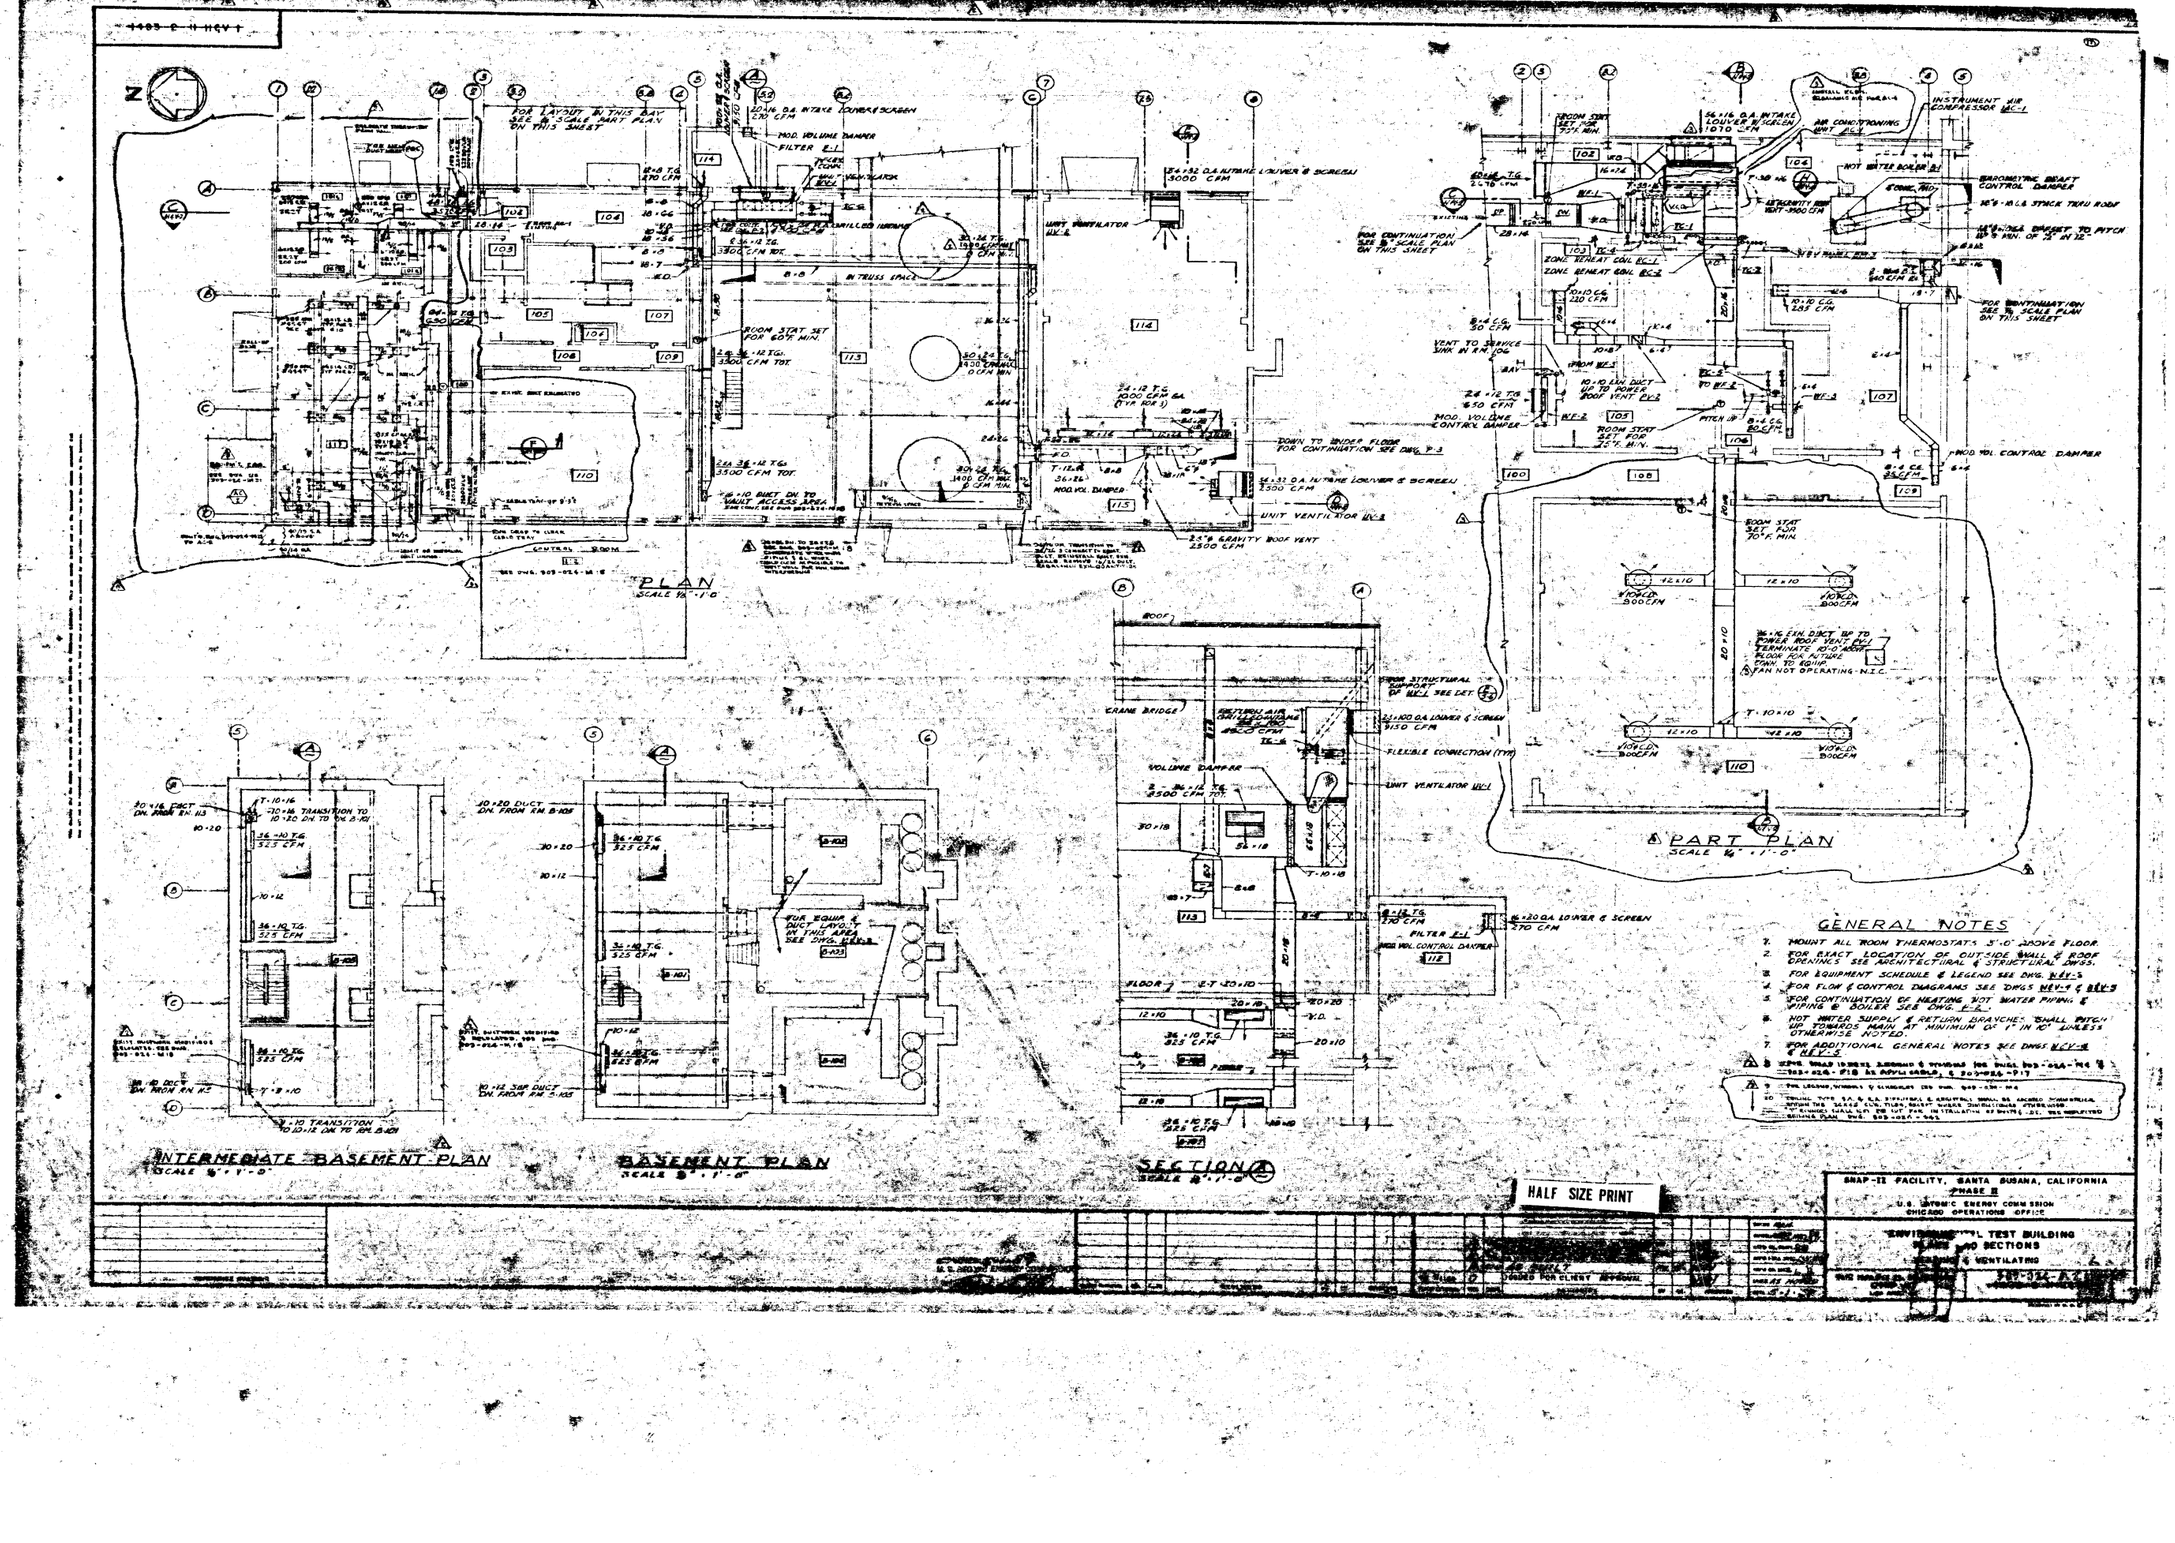
PLAN
SCALE 1/8" = 1'-0"
PART PLAN
SCALE 1/4" = 1'-0"
INTERMEDIATE BASEMENT PLAN
SCALE 1/4" = 1'-0"
BASEMENT PLAN
SCALE 1/4" = 1'-0"
SECTION
SCALE 1/4" = 1'-0"
GENERAL NOTES
1. MOUNT ALL ROOM THERMOSTATS 5'-0" ABOVE FLOOR.
2. FOR EXACT LOCATION OF OUTSIDE WALL & ROOF OPENINGS SEE ARCHITECTURAL & STRUCTURAL DWGS.
3. FOR EQUIPMENT SCHEDULE & LEGEND SEE DWG. M-EV-5
4. FOR FLOW & CONTROL DIAGRAMS SEE DWGS M-EV-1 & M-EV-3
5. FOR CONTINUATION OF HEATING HOT WATER PIPING & PIPING @ BOILER SEE DWG. P-1
6. HOT WATER SUPPLY & RETURN BRANCHES SHALL PITCH UP TOWARDS MAIN AT MINIMUM OF 1" IN 10' UNLESS OTHERWISE NOTED.
7. FOR ADDITIONAL GENERAL NOTES SEE DWGS M-EV-1 & M-EV-3
HALF SIZE PRINT
SNAP-II FACILITY, SANTA SUSANA, CALIFORNIA
PHASE II
U.S. ATOMIC ENERGY COMMISSION
CHICAGO OPERATIONS OFFICE