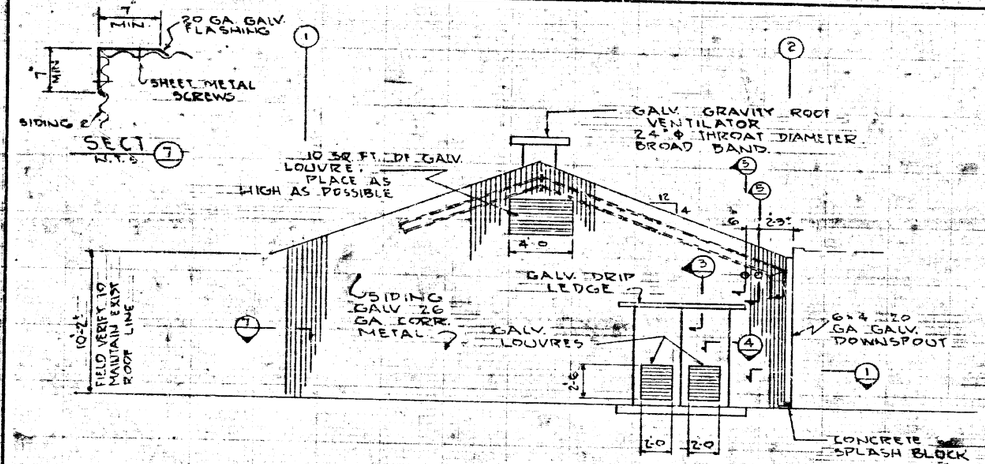

WEST ELEVATION

¼" = 1'-0

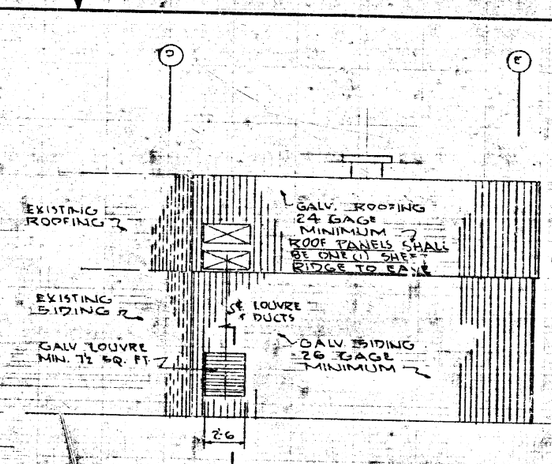

NORTH ELEVATION

¼" = 1'-0

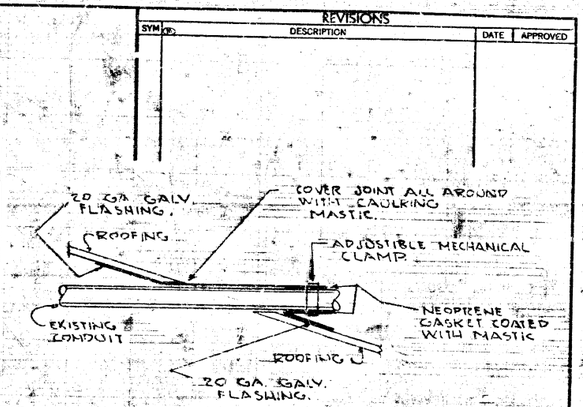

TYP. PENETRATION FOR EXIST. CONDUIT THRU NEW ROOF.

NOTES FOR CORRUGATED METAL SIDING

1. SIDING END LAPS SHALL BE A MIN. OF 6 INCHES & SIDE LAPS A MIN. OF 2½ CORRUGATIONS
2. END LAPS & SIDE LAPS SHALL BE CAULKED WITH A BEAD OF MASTIC.
3. FASTEN TO SUPPORTS WITH #14 CADMIUM PLATED SELF TAPPING FASTENERS WITH NEOPRENE WASHERS SPACED AT NO MORE THAN 6 INCHES O.C. AT ALL END SUPPORTS & 12 INCHES O.C. AT ALL OTHER SUPPORTS.

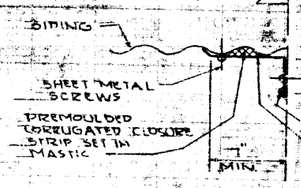

SECT 1

1½" = 1'-0

TYPICAL FOR NEW SIDING ABUTTING EXISTING BLOCK OR CONCRETE WALLS



SECT 2

1½" = 1'-0

TYPICAL FOR LOUVRES

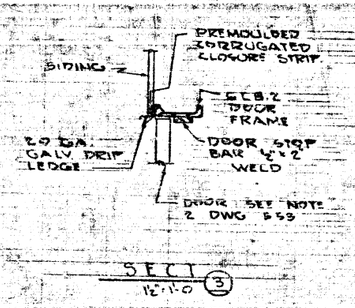

SECT 3

1½" = 1'-0

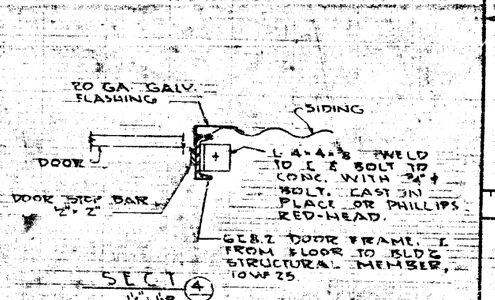

SECT 4

1½" = 1'-0

SEE DET (A) DWG 553

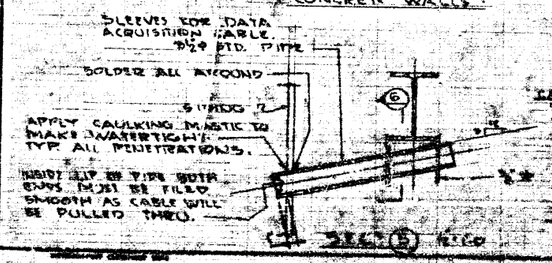

SECT 5

1½" = 1'-0

NOTE: FOR 4" PIPE SLEEVE TO BE INSTALLED AS SHOWN. TIE OTHER 4" PIPE SLEEVE NEEDS TO BE INSTALLED AROUND THE EXISTING DATA CABLE. SPLIT PIPE & TIE ALONG WHOLE PLANT & PLACE ARMOURED CABLE. WELD PIPE TOGETHER WITH ¾" WELDS, 12 LONG EACH END & 12" AT CENTER.

FOR GENERAL NOTES SEE DWG 333 PEWR 7218

ATOMICS INTERNATIONAL	A DIVISION OF NORTH AMERICAN AVIATION, INC. 8900 DE SOTO AVENUE, CANOGA PARK, CALIF.
SANTA SUSANA FACILITY — BLDG. 074	
STORAGE AREA ADDITION	
ELEVATIONS + SECTIONS	
D	303-074-556

REDUCED DRAWING