

BUILDING 462

FINDINGS AND RECOMMENDATIONS

The survey performed from June 17, 1996 through August 21, 1996, in Building 462 located at Rockwell International Corporation, Rocketdyne Division at the Santa Susana Field Laboratory was conducted by ATC AHERA Certified Rebecca Mathes, Cary Rubin, Paul Sullivan, Jamie Tocci, David Bahng, and Richard Weaver assisted by Viviane Domian and Dien Nguyen.

No friable ACM was identified in Building 462. Nonfriable ACM (identified in Table 1 on the following page) was in good condition. Hazard rating (see legend below) and recommended response action are specified for each ACM. Materials sampled in which no asbestos was detected are listed in Table 2.

LEGEND

SF = Square Feet
LF = Linear Feet
E = Each
SY = Square Yards

CF = Cubic Feet
Positive = >0.1% Asbestos Detected
Negative = No Asbestos Detected

HAZARD RATING

- 1 Good condition, low potential for damage
- 2 Good condition, moderate potential for damage
- 3 Good condition, high potential for significant damage
- 4 Fair condition (damaged), low potential for further damage
- 5 Fair condition (damaged), moderate potential for further damage
- 6 Fair condition (damaged), high potential for significant damage
- 7 Poor condition (significantly damaged)

ASBESTOS SURVEY REPORT
 ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
 SANTA SUSANA FIELD LABORATORY - BUILDING 462

TABLE 1 - NONFRIABLE ASBESTOS-CONTAINING MATERIALS

SAMPLE NOS.	FLOOR/ LEVEL	LOCATION	TYPE OF MATERIAL	ASBESTOS TYPE/%	ESTIMATED QUANTITY	HAZARD RATING
1, 2, 3, 4, 5, 6	1st Flr	Office, Hallway, Locker Room	Resilient Floor Tile (12"x12") White w/Gray Streaks & Mastic	Chrysotile 2-10%	750 SF	1
<i>Remarks: This material was found to be in good condition.</i>						
13, 14, 15	1st Flr	Mechanical Room	Resilient Floor Tile (12"x12") White Marble	Chrysotile 2%	50 SF	1
<i>Remarks: This material was found to be in good condition.</i>						
40*, 41*, 42, 43, 44*	1st Flr	Select Areas Throughout	Joint Compound (Exposed) Interior	Chrysotile <1%	4,250 SF	1
<i>Remarks: This material was found to be in good condition.</i>						
127, 128, 129	Roof	North Lower Roof	Roofing Mastic	Chrysotile 10%	4,000 SF	5
<i>Remarks: This material was found to be in good condition.</i>						
130, 131, 132	Roof	High Tower Roof (T-1)	Roofing Mastic	Chrysotile 10%	2,000 SF	5
<i>Remarks: This material was found to be in good condition.</i>						
133, 134, 135	Roof	High Tower Roof (T-2)	Roofing Mastic	Chrysotile 10%	400 SF	5
<i>Remarks: This material was found to be in good condition.</i>						

* No asbestos was detected in this sample; however, other samples from this homogeneous material contain asbestos, thus overriding the results of this sample. For explanation refer to section titled PROCEDURES AND METHODOLOGY, subsection Sampling and Laboratory Analysis Constraints.

ASBESTOS SURVEY REPORT
 ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
 SANTA SUSANA FIELD LABORATORY - BUILDING 462

TABLE 2 - MATERIALS IN WHICH NO ASBESTOS WAS DETECTED

SAMPLE NOS.	FLOOR/ LEVEL	LOCATION	TYPE OF MATERIAL
7, 8, 9, 10, 11, 12	1st Flr	Electrical Room, Control Room	Resilient Floor Tile (2'x2') Red Marble (Self Adhesive)
13, 14, 15	1st Flr	Mechanical Room	Resilient Floor Tile (12"x12") White Marble
16, 17, 18	1st Flr	Office	Acoustical Ceiling Panel (2'x4') Fissures & Dots
19, 20, 21	1st Flr	Control Room, Computer Room	Acoustical Ceiling Panel (2'x4') Rough Texture
22, 23, 24	1st Flr	Office, Hallway, Computer Room	Baseboard Mastic
25, 26, 27, 28, 29	1st Flr	Test Bay	Wallboard (Perimeter)
30, 31, 32, 33, 34	1st Flr	Test Bay	Joint Compound (Exposed) Perimeter
35, 36, 37, 38, 39,	1st Flr	Select Areas in Computer Room, Electrical Room, Locker Room, Restroom, Control Room	Wallboard (Interior)
45, 46, 47, 48	1st Flr	Test Bay	Wallboard (Interior) and Joint Compound (Exposed) Perimeter
49, 50, 51, 52, 53, 54	1st Flr	Test Bay	Storage Tank/Exchanger Insulation & Jacket
55, 56, 57, 58, 59, 60	2nd Flr	Test Bay	Pipe Run Insulation & Jacket 24" O.D.
61, 62, 63, 64, 65, 66	2nd Flr	Test Bay	Pipe Fitting Insulation & Jacket 9" O.D.

ASBESTOS SURVEY REPORT
 ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
 SANTA SUSANA FIELD LABORATORY - BUILDING 462

TABLE 2 - MATERIALS IN WHICH NO ASBESTOS WAS DETECTED (contd.)

SAMPLE NOS.	FLOOR/ LEVEL	LOCATION	TYPE OF MATERIAL
67, 68, 69, 70, 71, 72	2nd Flr	Test Bay	Pipe Fitting Insulation & Jacket 9" O.D.
73, 74, 75, 76, 77, 78	2nd Flr	Test Bay	Pipe Run Insulation & Jacket 9" O.D.
79, 80, 81, 82, 83, 84	2nd Flr	Test Bay	Pipe Run Insulation & Jacket 9" O.D.
85, 86, 87, 88, 89, 90	2nd Flr	Test Bay	Pipe Run Insulation & Jacket 6" O.D.
91, 92, 93, 94, 95, 96	2nd Flr	Test Bay	Pipe Fitting Insulation & Jacket 6" O.D.
97, 98, 99, 100, 101, 102	2nd Flr	Test Bay	Pipe Run Insulation & Jacket 24" O.D.
103, 104, 105, 106, 107, 108	2nd Flr	Test Bay	Pipe Run Insulation & Jacket 18" O.D.
109, 110, 111, 112, 113, 114	2nd Flr	Test Bay	Pipe Fitting Insulation & Jacket 18" O.D.
115, 116, 117	2nd Flr	Test Bay	Pipe Run Insulation 9" O.D. Exposed
118, 119, 120, 121, 122, 123	5th Flr	Test Bay	Tank Insulation & Jacket
124, 125, 126	2nd Flr	Room Above Office	Pipe Fitting Insulation

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/ Level	Sample Location	Pos/ Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
1	Resilient Floor Tile (12"x12") - White with Grey Specks	750 SF	1	Office	P	2 Chrysotile	Nonfriable Good	Low High Low
2	Resilient Floor Tile (12"x12") - White with Grey Specks	(R1)	1	Hallway	P	2 Chrysotile	Nonfriable Good	Low High Low
3	Resilient Floor Tile (12"x12") - White with Grey Specks	(R1)	1	Locker Room	P	2 Chrysotile	Nonfriable Good	Low High Low
4	Mastic (Floor Tile)	750 SF	1	Office	P	10 Chrysotile	Nonfriable Good	Low Low Low
5	Mastic (Floor Tile)	(R4)	1	Hallway	P	10 Chrysotile	Nonfriable Good	Low Low Low
6	Mastic (Floor Tile)	(R4)	1	Locker Room	P	10 Chrysotile	Nonfriable Good	Low Low Low
7	Resilient Floor Tile (2'x 2') - Pink Marble (Self Adhesive)	SF	1	Electrical Room	N	ND		
8	Resilient Floor Tile (2'x 2') - Pink Marble (Self Adhesive)	(R7)	1	Electrical Room	N	ND		
9	Resilient Floor Tile (2'x 2') - Pink Marble (Self Adhesive)	(R7)	1	Electrical Room	N	ND		
10	Resilient Floor Tile (2'x 2') - Red Marble (Self Adhesive)	50 SF	1	Control Room	N	ND		

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION

SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
11	Resilient Floor Tile (2'x 2') - Red Marble (Self Adhesive)	(R10)	1	Control Room	N ND			
12	Resilient Floor Tile (2'x 2') - Red Marble (Self Adhesive)	(R10)	1	Control Room	N ND			
13	Resilient Floor Tile (12"x12") - White Marble	50 SF	1	Mechanical Room	P 2	Chrysotile	Nonfriable Good	Low Moderate Low
14	Resilient Floor Tile (12"x12") - White Marble	(R13)	1	Mechanical Room	P 2	Chrysotile	Nonfriable Good	Low Moderate Low
15	Resilient Floor Tile (12"x12") - White Marble	(R13)	1	Mechanical Room	P 2	Chrysotile	Nonfriable Good	Low Moderate Low
16	Acoustical Panel (2'x4') - Fissures & Dots	300 SF	1	Office	N ND			
17	Acoustical Panel (2'x4') - Fissures & Dots	(R16)	1	Office	N ND			
18	Acoustical Panel (2'x4') - Fissures & Dots	(R16)	1	Office	N ND			
19	Acoustical Panel (2'x4') - Rough Texture	SF	1	Control Room	N ND			
20	Acoustical Panel (2'x4') - Rough Texture	(R19)	1	Computer Room	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos

** = Sample Not Analyzed - Assumed Positive

(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION

SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
21	Acoustical Panel (2'x4') - Rough Texture	(R19)	1	Computer Room	N	ND		
22	Mastic (Baseboard)	SF	1	Office	N	ND		
23	Mastic (Baseboard)	(R22)	1	Hallway	N	ND		
24	Mastic (Baseboard)	(R22)	1	Computer Room	N	ND		
25	Wallboard - Perimeter	9,800 SF	1	Test Bay	N	ND		
26	Wallboard - Perimeter	(R25)	1	Test Bay	N	ND		
27	Wallboard - Perimeter	(R25)	1	Test Bay	N	ND		
28	Wallboard - Perimeter	(R25)	1	Test Bay	N	ND		
29	Wallboard - Perimeter	(R25)	1	Test Bay	N	ND		
30	Joint Compound (Exposed) - Perimeter	9,600 SF	1	Test Bay	N	ND		

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
 (R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION

SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
31	Joint Compound (Exposed) - Perimeter	(R30)	1	Test Bay	N ND			
32	Joint Compound (Exposed) - Perimeter	(R30)	1	Test Bay	N ND			
33	Joint Compound (Exposed) - Perimeter	(R30)	1	Test Bay	N ND			
34	Joint Compound (Exposed) - Perimeter	(R30)	1	Test Bay	N ND			
35	Wallboard - Interior	4,200 SF	1	Computer Room	N ND			
36	Wallboard - Interior	(R35)	1	Electrical Room	N ND			
37	Wallboard - Interior	(R35)	1	Locker Room	N ND			
38	Wallboard - Interior	(R35)	1	Restroom	N ND			
39	Wallboard - Interior	(R35)	1	Control Room	N ND			
40	Joint Compound (Exposed) - Interior	4,200 SF	1	Computer Room	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
 (R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/ Level	Sample Location	Pos/ Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
41	Joint Compound (Exposed) - Interior	(R40)	1	Electrical Room	N ND			
42	Joint Compound (Exposed) - Interior	(R40)	1	Locker Room	P <1	Chrysotile	Nonfriable Good	Low Moderate Low
43	Joint Compound (Exposed) - Interior	(R40)	1	Restroom	P <1	Chrysotile	Nonfriable Good	Low Moderate Low
44	Joint Compound (Exposed) - Interior	(R40)	1	Control Room	N ND			
45	Wallboard - Perimeter	(R25)	1	Test Bay	N ND			
46	Wallboard - Perimeter	(R25)	1	Test Bay	N ND			
47	Joint Compound (Exposed) - Perimeter	(R30)	1	Test Bay	N ND			
48	Joint Compound (Exposed) - Perimeter	(R30)	1	Test Bay	N ND			
49	Storage Tank/Exchanger Insulation	600 SF	1	Test Bay	N ND			
50	Storage Tank/Exchanger Insulation	(R49)	1	Test Bay	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
51	Storage Tank/Exchanger Insulation	(R49)	1	Test Bay	N ND			
52	Storage Tank/Exchanger Insul Jacket	600 SF	1	Test Bay	N ND			
53	Storage Tank/Exchanger Insul Jacket	(R52)	1	Test Bay	N ND			
54	Storage Tank/Exchanger Insul Jacket	(R52)	1	Test Bay	N ND			
55	Pipe Run Insulation - 24" O.D.	500 LF	2	Test Bay	N ND			
56	Pipe Run Insulation - 24" O.D.	(R55)	2	Test Bay	N ND			
57	Pipe Run Insulation - 24" O.D.	(R55)	2	Test Bay	N ND			
58	Pipe Run Insulation Jacket - 24" O.D.	500 LF	2	Test Bay	N ND			
59	Pipe Run Insulation Jacket - 24" O.D.	(R58)	2	Test Bay	N ND			
60	Pipe Run Insulation Jacket - 24" O.D.	(R58)	2	Test Bay	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION

SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
61	Pipe Fitting Insulation - 9" O.D. (TE)	30 EA	2	Test Bay	N ND			
62	Pipe Fitting Insulation - 9" O.D. (TE)	(R61)	2	Test Bay	N ND			
63	Pipe Fitting Insulation - 9" O.D. (TE)	(R61)	2	Test Bay	N ND			
64	Pipe Fitting Insulation Jacket - 9" O.D. (TE)	30 EA	2	Test Bay	N ND			
65	Pipe Fitting Insulation Jacket - 9" O.D. (TE)	(R64)	2	Test Bay	N ND			
66	Pipe Fitting Insulation Jacket - 9" O.D. (TE)	(R64)	2	Test Bay	N ND			
67	Pipe Fitting Insulation - 9" O.D. (BT)	12 EA	2	Test Bay	N ND			
68	Pipe Fitting Insulation - 9" O.D. (BT)	(R67)	2	Test Bay	N ND			
69	Pipe Fitting Insulation - 9" O.D. (BT)	(R67)	2	Test Bay	N ND			
70	Pipe Fitting Insulation Jacket - 9" O.D. (BT)	12 EA	2	Test Bay	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
 (R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
71	Pipe Fitting Insulation Jacket - 9" O.D. (BT)	(R70)	2	Test Bay	N ND			
72	Pipe Fitting Insulation Jacket - 9" O.D. (BT)	(R70)	2	Test Bay	N ND			
73	Pipe Run Insulation - 9" O.D. (BT)	30 LF	2	Test Bay	N ND			
74	Pipe Run Insulation - 9" O.D. (BT)	(R73)	2	Test Bay	N ND			
75	Pipe Run Insulation - 9" O.D. (BT)	(R73)	2	Test Bay	N ND			
76	Pipe Run Insulation Jacket - 9" O.D. (BT)	30 LF	2	Test Bay	N ND			
77	Pipe Run Insulation Jacket - 9" O.D. (BT)	(R76)	2	Test Bay	N ND			
78	Pipe Run Insulation Jacket - 9" O.D. (BT)	(R76)	2	Test Bay	N ND			
79	Pipe Run Insulation Jacket - 9" O.D. (TE)	650 LF	2	Test Bay	N ND			
80	Pipe Run Insulation Jacket - 9" O.D. (TE)	(R79)	2	Test Bay	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log								
Sample No.	Type of Material	Estimated Quantity	Floor/ Level	Sample Location	Pos/ Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
81	Pipe Run Insulation Jacket - 9" O.D. (TE)	(R79)	2	Test Bay	N	ND		
82	Pipe Run Insulation - 9" O.D. (TE)	650 LF	2	Test Bay	N	ND		
83	Pipe Run Insulation - 9" O.D. (TE)	(R82)	2	Test Bay	N	ND		
84	Pipe Run Insulation - 9" O.D. (TE)	(R82)	2	Test Bay	N	ND		
85	Pipe Run Insulation - 6" O.D.	110 LF	2	Test Bay	N	ND		
86	Pipe Run Insulation - 6" O.D.	(R85)	2	Test Bay	N	ND		
87	Pipe Run Insulation - 6" O.D.	(R85)	2	Test Bay	N	ND		
88	Pipe Run Insulation Jacket - 6" O.D.	110 LF	2	Test Bay	N	ND		
89	Pipe Run Insulation Jacket - 6" O.D.	(R88)	2	Test Bay	N	ND		
90	Pipe Run Insulation Jacket - 6" O.D.	(R88)	2	Test Bay	N	ND		

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
91	Pipe Fitting Insulation - 6" O.D.	16 EA	2	Test Bay	N ND			
92	Pipe Fitting Insulation - 6" O.D.	(R91)	2	Test Bay	N ND			
93	Pipe Fitting Insulation - 6" O.D.	(R91)	2	Test Bay	N ND			
94	Pipe Fitting Insulation Jacket - 6" O.D.	16 EA	2	Test Bay	N ND			
95	Pipe Fitting Insulation Jacket - 6" O.D.	(R94)	2	Test Bay	N ND			
96	Pipe Fitting Insulation Jacket - 6" O.D.	(R94)	2	Test Bay	N ND			
97	Pipe Run Insulation - 24" O.D.	20 LF	2	Test Bay	N ND			
98	Pipe Run Insulation - 24" O.D.	(R97)	2	Test Bay	N ND			
99	Pipe Run Insulation - 24" O.D.	(R97)	2	Test Bay	N ND			
100	Pipe Run Insulation Jacket - 24" O.D.	20 LF	2	Test Bay	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
101	Pipe Run Insulation Jacket - 24" O.D.	(R100)	2	Test Bay	N ND			
102	Pipe Run Insulation Jacket - 24" O.D.	(R100)	2	Test Bay	N ND			
103	Pipe Run Insulation - 18" O.D.	370 LF	2	Test Bay	N ND			
104	Pipe Run Insulation - 18" O.D.	(R103)	2	Test Bay	N ND			
105	Pipe Run Insulation - 18" O.D.	(R103)	2	Test Bay	N ND			
106	Pipe Run Insulation Jacket - 18" O.D.	370 LF	2	Test Bay	N ND			
107	Pipe Run Insulation Jacket - 18" O.D.	(R106)	2	Test Bay	N ND			
108	Pipe Run Insulation Jacket - 18" O.D.	(R106)	2	Test Bay	N ND			
109	Pipe Fitting Insulation - 18" O.D.	27 EA	2	Test Bay	N ND			
110	Pipe Fitting Insulation - 18" O.D.	(R109)	2	Test Bay	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT

ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
111	Pipe Fitting Insulation - 18" O.D.	(R109)	2	Test Bay	N ND			
112	Pipe Fitting Insulation Jacket - 18" O.D.	27 EA	2	Test Bay	N ND			
113	Pipe Fitting Insulation Jacket - 18" O.D.	(R112)	2	Test Bay	N ND			
114	Pipe Fitting Insulation Jacket - 18" O.D.	(R112)	2	Test Bay	N ND			
115	Pipe Run Insulation - 9" O.D. Exposed/No Jacket	20 LF	2	Test Bay	N ND			
116	Pipe Run Insulation - 9" O.D. Exposed/No Jacket	(R115)	2	Test Bay	N ND			
117	Pipe Run Insulation - 9" O.D. Exposed/No Jacket	(R115)	2	Test Bay	N ND			
118	Tank Insulation	50 SF	5	Test Bay	N ND			
119	Tank Insulation	(R118)	5	Test Bay	N ND			
120	Tank Insulation	(R118)	5	Test Bay	N ND			

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT
ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg %	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
121	Tank Insulation Jacket	50 SF	5	Test Bay	N ND			
122	Tank Insulation Jacket	(R121)	5	Test Bay	N ND			
123	Tank Insulation Jacket	(R121)	5	Test Bay	N ND			
124	Pipe Fitting Insulation	9 EA	2	Room Above Office	N ND			
125	Pipe Fitting Insulation	(R124)	2	Room Above Office	N ND			
126	Pipe Fitting Insulation	(R124)	2	Room Above Office	N ND			
127	Roofing Mastic	4,000 SF	Roof	North Lower Roof	P 10	Chrysotile	Nonfriable Fair	High Low Low
128	Roofing Mastic	(R127)	Roof	North Lower Roof	P 10	Chrysotile	Nonfriable Fair	High Low Low
129	Roofing Mastic	(R127)	Roof	North Lower Roof	P 10	Chrysotile	Nonfriable Fair	High Low Low
130	Roofing Mastic	2,000 SF	Roof	T-1 High Tower Roof	P 10	Chrysotile	Nonfriable Fair	High Low Low

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

ASBESTOS SURVEY REPORT


ROCKWELL INTERNATIONAL CORPORATION - ROCKETDYNE DIVISION
SANTA SUSANA FIELD LABORATORY - BUILDING 462

Bulk Sample Log

Sample No.	Type of Material	Estimated Quantity	Floor/Level	Sample Location	Pos/Neg	%	Asbestos Type	Friability; Condition	Air Erosion; Contact; Vibration
131	Roofing Mastic	(R130)	Roof	T-1 High Tower Roof	P	10	Chrysotile	Nonfriable Fair	High Low Low
132	Roofing Mastic	(R130)	Roof	T-1 High Tower Roof	P	10	Chrysotile	Nonfriable Fair	High Low Low
133	Roofing Mastic	400 SF	Roof	T-2 High Tower Roof	P	10	Chrysotile	Nonfriable Fair	High Low Low
134	Roofing Mastic	(R133)	Roof	T-2 High Tower Roof	P	10	Chrysotile	Nonfriable Fair	High Low Low
135	Roofing Mastic	(R133)	Roof	T-2 High Tower Roof	P	10	Chrysotile	Nonfriable Fair	High Low Low

* = PLM Sample Analysis <1% Asbestos; Re-Analysis by Point Count ≤ 0.1% Asbestos ** = Sample Not Analyzed - Assumed Positive
(R#) denotes that the estimated material quantity for the area has been included in referenced sample number.

PLANS DEPICTING
SAMPLE LOCATIONS

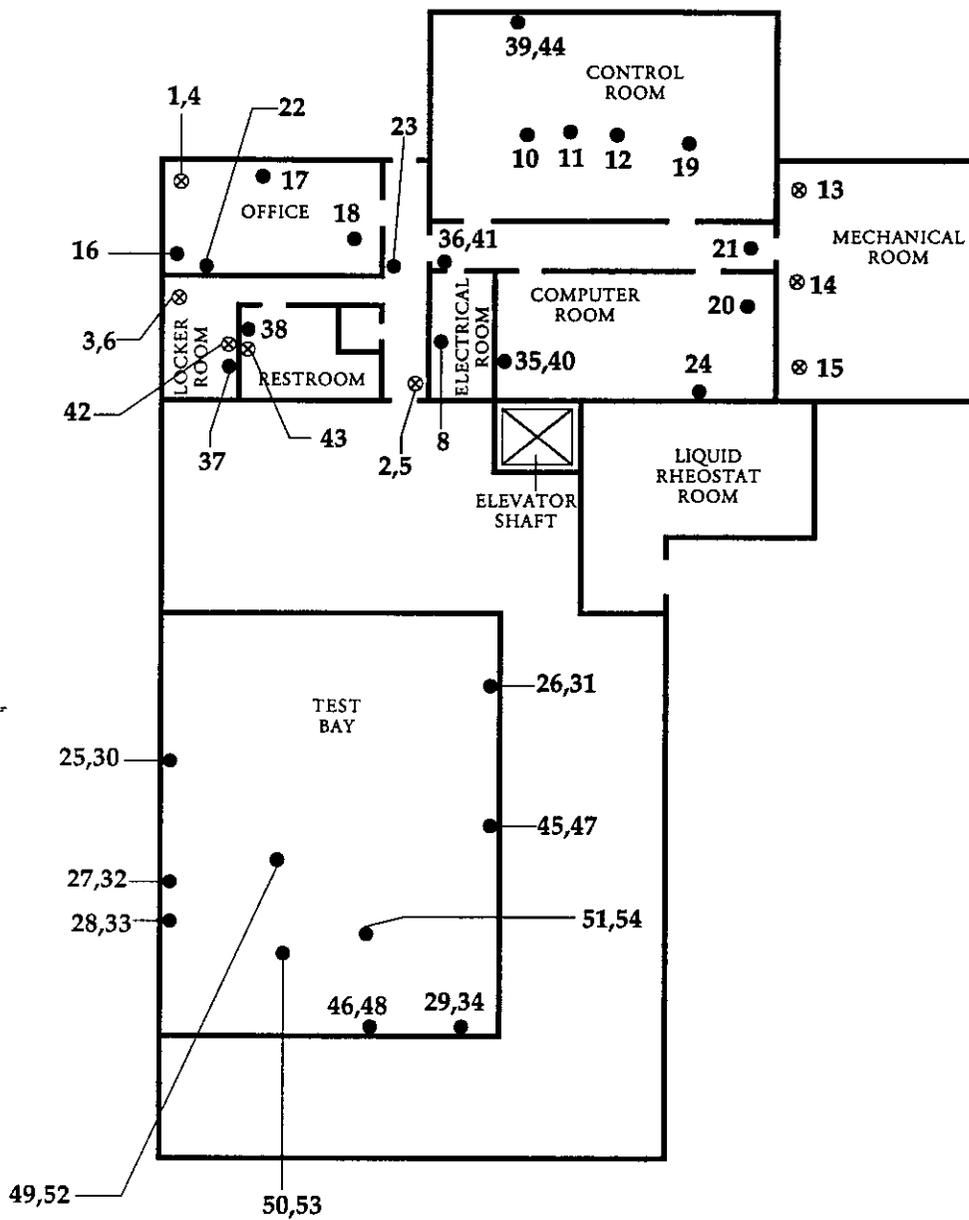

BUILDING 462
FIRST FLOOR PLAN
 NOT TO SCALE




ASBESTOS SAMPLES LEGEND:
 ⊗ POSITIVE SAMPLE LOCATION
 ● NEGATIVE SAMPLE LOCATION

PROJECT NAME: ASBESTOS SURVEY REPORT
 ROCKWELL INTERNATIONAL CORP.
 ROCKETDYNE DIVISION
 SANTA SUSANA, FIELD LABORATORY
 SANTA SUSANA, CALIFORNIA

PROJECT NO. 08977.0087

ATC ENVIRONMENTAL INC.
Solutions For Environmental Concerns
 50 East Foothill Blvd., Arcadia, California 91006

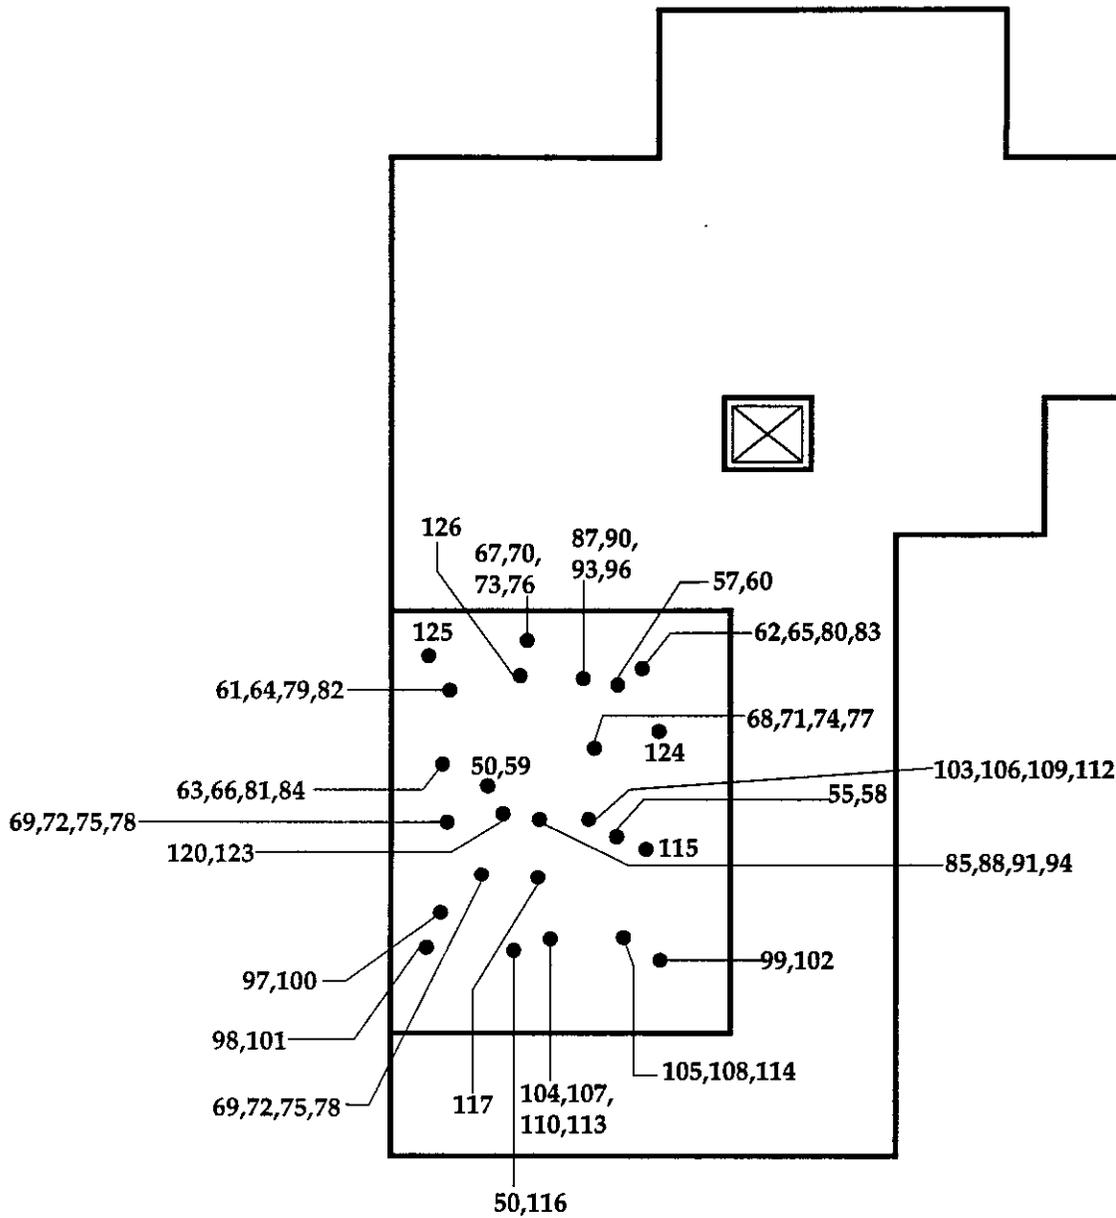

BUILDING 462
SECOND FLOOR PLAN
 NOT TO SCALE




ASBESTOS SAMPLES LEGEND:
 ⊗ POSITIVE SAMPLE LOCATION
 ● NEGATIVE SAMPLE LOCATION

PROJECT NAME: ASBESTOS SURVEY REPORT
 ROCKWELL INTERNATIONAL CORP.
 ROCKETDYNE DIVISION
 SANTA SUSANA, FIELD LABORATORY
 SANTA SUSANA, CALIFORNIA

PROJECT NO. 08977.0087

ATC ENVIRONMENTAL INC.
Solutions For Environmental Concerns
 50 East Foothill Blvd., Arcadia, California 91006

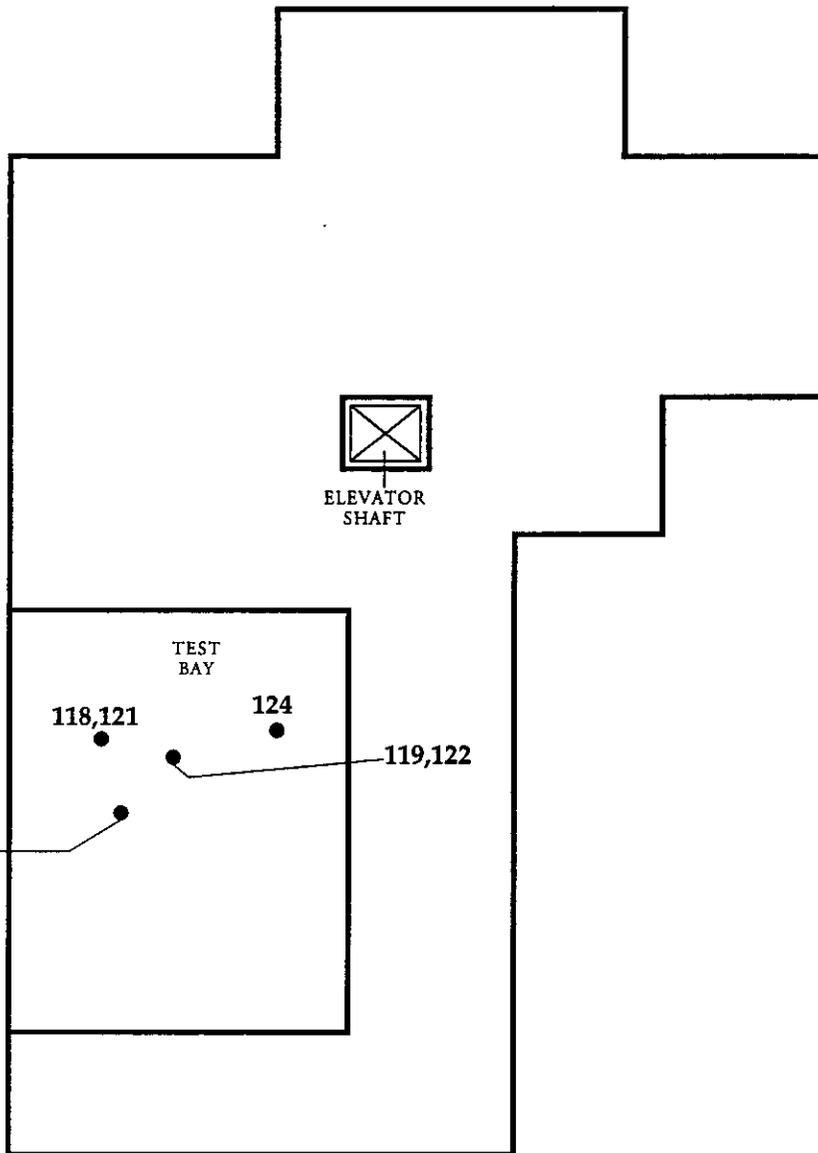

BUILDING 462
FIFTH FLOOR PLAN
 NOT TO SCALE




ASBESTOS SAMPLES LEGEND:
 ⊗ POSITIVE SAMPLE LOCATION
 ● NEGATIVE SAMPLE LOCATION

PROJECT NAME: ASBESTOS SURVEY REPORT
 ROCKWELL INTERNATIONAL CORP.
 ROCKETDYNE DIVISION
 SANTA SUSANA, FIELD LABORATORY
 SANTA SUSANA, CALIFORNIA

PROJECT NO. 08977.0087

ATC ENVIRONMENTAL INC.
Solutions For Environmental Concerns
 50 East Foothill Blvd., Arcadia, California 91006

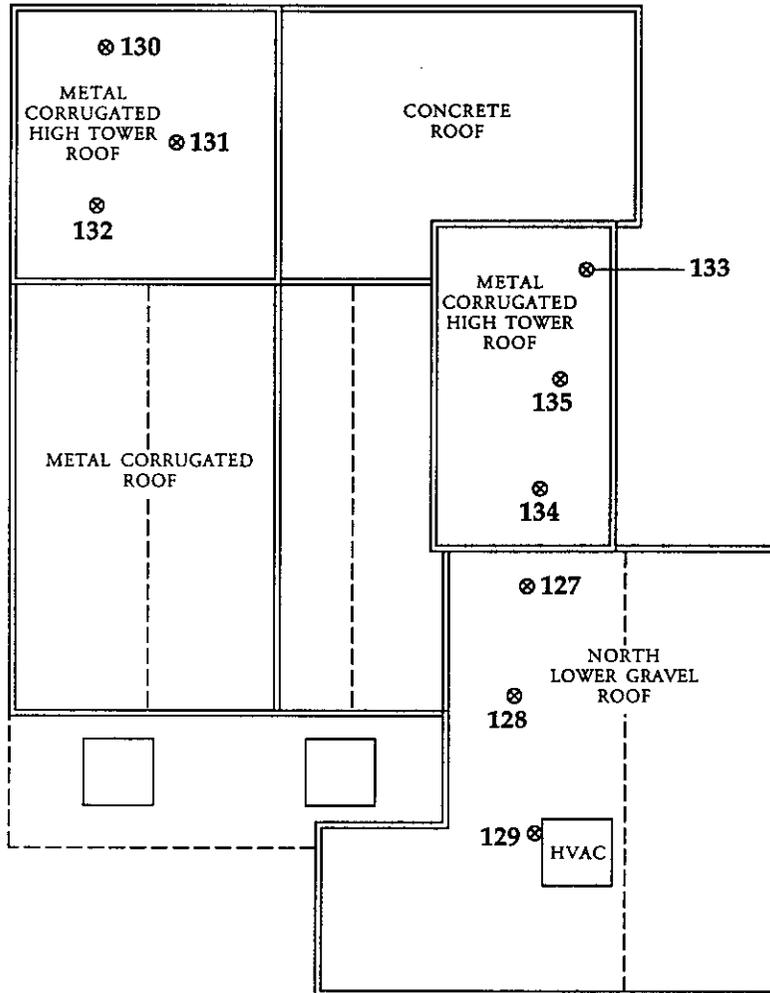

BUILDING 462
ROOF PLAN
 NOT TO SCALE



ASBESTOS SAMPLES LEGEND:
 ⊗ POSITIVE SAMPLE LOCATION
 ● NEGATIVE SAMPLE LOCATION

PROJECT NAME: ASBESTOS SURVEY REPORT
 ROCKWELL INTERNATIONAL CORP.
 ROCKETDYNE DIVISION
 SANTA SUSANA, FIELD LABORATORY
 SANTA SUSANA, CALIFORNIA

PROJECT NO. 08977.0087

ATC ENVIRONMENTAL INC.
Solutions For Environmental Concerns
 50 East Foothill Blvd., Arcadia, California 91006