GENERAL NOTES

1. REFER TO 5/H9410002-F-0012 FOR CONDENSATE PIPING AT ALL AIR HANDLING UNITS.

SHEET KEYNOTES

1. INSTALL CIRCUIT SETTERS ON EACH PTWR LINE AS NEEDED TO BALANCE RETURN FLOW

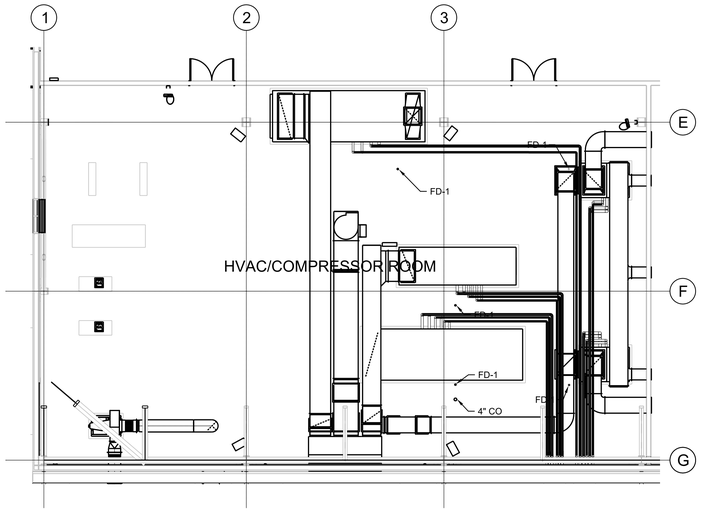

1 SECOND FLOOR HVAC/COMPRESSOR ROOM PLAN EL 927
1/8"=1'-0"

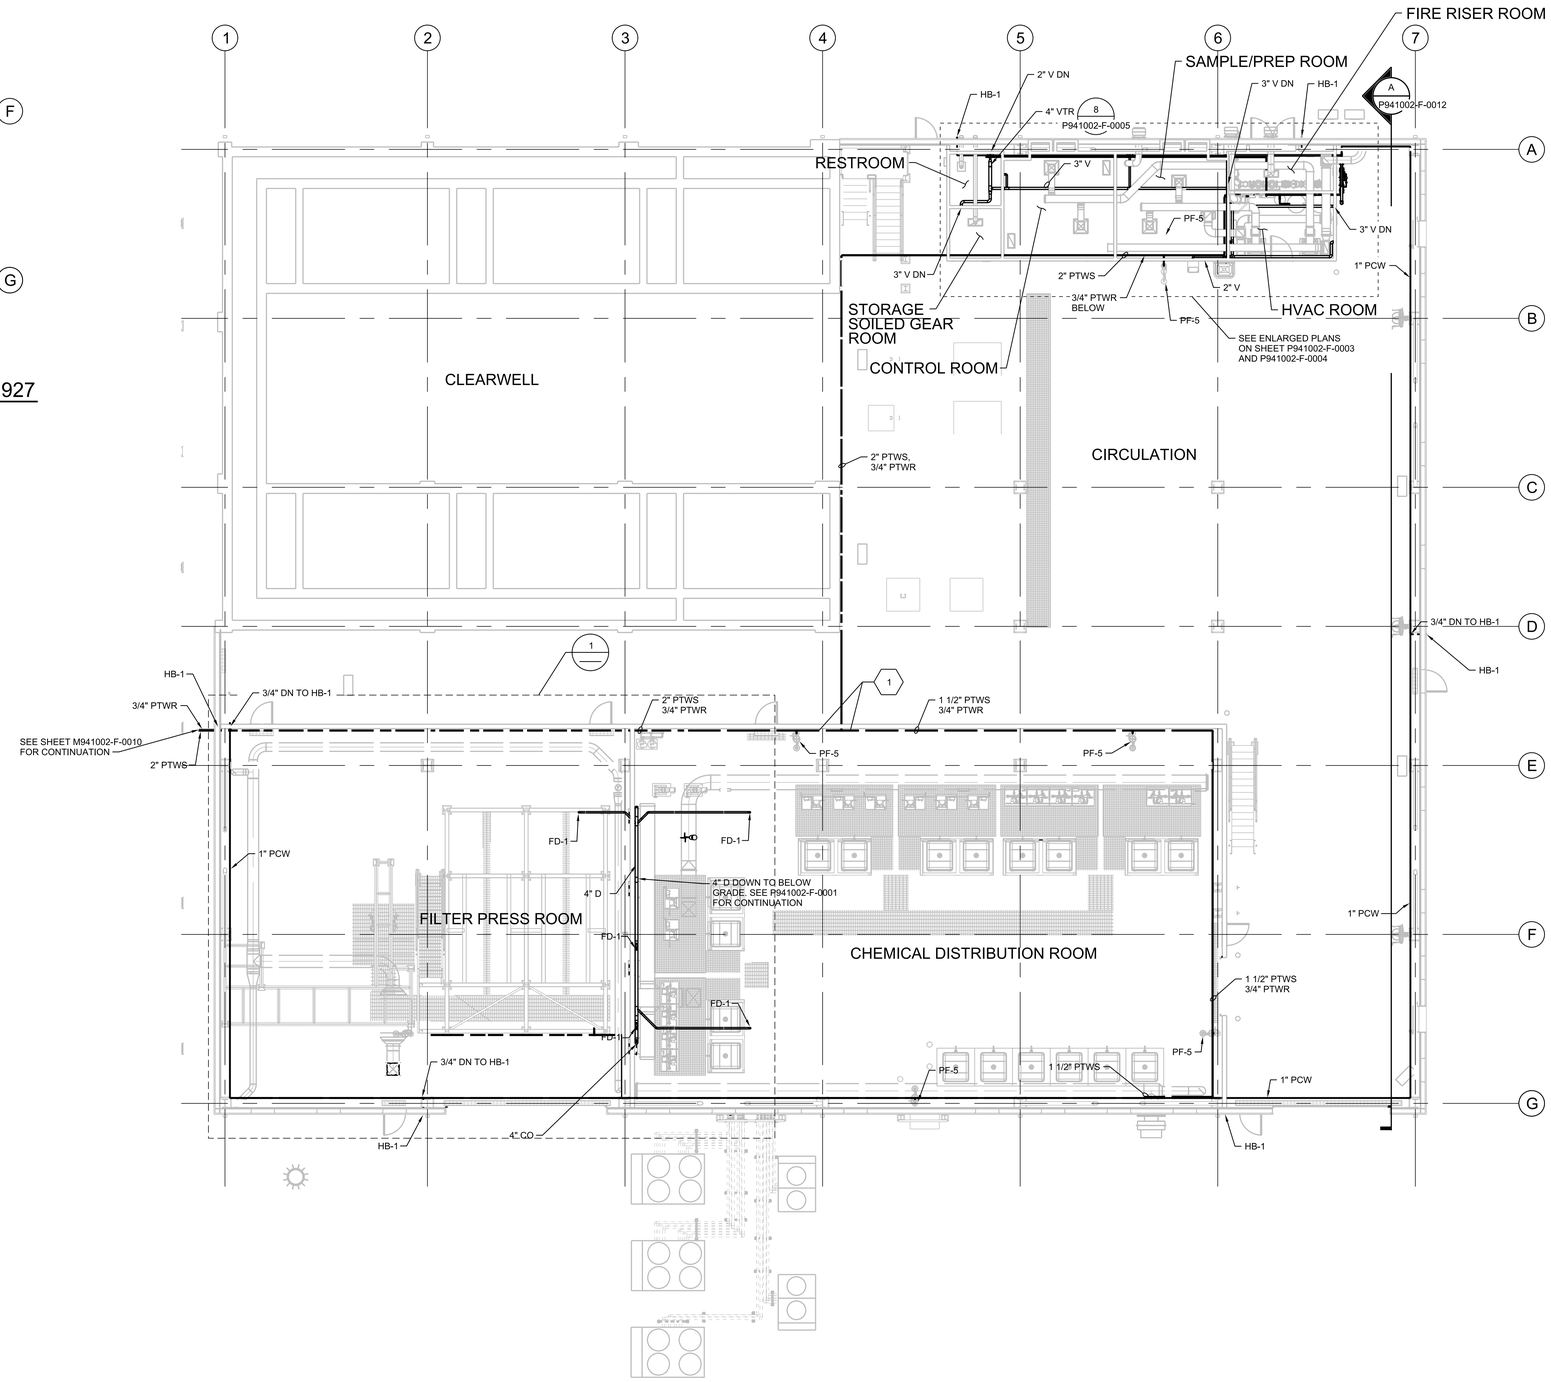

NOTE: PLAN SHOWS DRAINS FROM UPPER LEVEL FOR CLARITY.

N

PLUMBING FLOOR PLAN - LOWER LEVEL EL 951.25
1/8"=1'-0"

PART	REV	DESCRIPTION	DRW	CHKR	DE	DVR	DM	DATE
	0	ISSUED FOR CONSTRUCTION	JP		TP		LE	06/2017

REVISION OR ISSUE PURPOSE

REVISION APPROVALS: PE, DATE

SQUAD CHECK: WE, AR, CV, ST, HV, EM, FP, PD, EE, IE, M, NP

RPE		
DRW	J PIGMAN	06/16/17
CHKR	J McMURREN	06/16/17
DE	T PRICE	06/16/17
DVR		
DM	L ELLIS	06/16/17
PE	Teresa J. Pierce, P.E.	

REV. DATE

DRAWING APPROVALS — DATE

UCOR URS | CH2M Oak Ridge LLC

OF200 Mercury Treatment Facility
Designed by URS|CH2M Oak Ridge LLC (UCOR) for the Department of Energy
Oak Ridge Office of Environmental Management
under U. S. Government contract DE-SC-0004645

Y-12 National Security Complex managed and operated by Consolidated Nuclear Security, LLC for the Department of Energy under U.S. Government contract DE-NA0001942
« Oak Ridge, Tennessee »

PROJECT NAME:
OF200 MERCURY TREATMENT FACILITY

PLUMBING
TREATMENT FACILITY
LOWER LEVEL FLOOR PLAN

USE	DISC	DT	DC	CM	SYSTEM	STAT	SIZE	BLDG	FL	CLASS
3	P	X	X	NC	FAC	AR	E	9410-02	1	U

SH.	OF	TYPE		PART	REV
1	1	DD	P941002-F-0002	000	0

662886

ISSUED FOR CONSTRUCTION

THIS DRAWING IS LOANED FOR SOLE USE OF THE INTENDED RECIPIENT AND ONLY FOR THE LIMITED PURPOSES FOR WHICH IT WAS PROVIDED. USE BY OTHER ENTITIES OR FOR OTHER PURPOSES IS PROHIBITED AND AT THE USER'S OWN RISK. DRAWINGS ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING RECIPIENT.

6/29/2017 6:58:40 PM
P941002-F-0002.dgn