GENERAL NOTES

A. FOR LEGEND, ABBREVIATIONS AND PROJECT GENERAL NOTES SEE E947001-F-0001 AND E941001-F-0002.

B. FOR LUMINAIRE SCHEDULE AND LUMINAIRE NOTES SEE SHEET E941001-F-0005.

C. ALL ELECTRICAL LOADS ON THIS SHEET ARE SERVED BY MTF-PNLK-B1, UON

D. UPPERCASE LETTERS ADJACENT TO LUMINAIRE CIRCUITING REPRESENT EACH RESPECTIVE LIGHTING CONTROL. FOR ADDITIONAL INFOAMTION SEE THE LIGHTING CONTROL DIAGRAM, SHEE E941002-F-0067.

SHEET KEYNOTES

1. SUSPEND EXIT LIGHT UNDER PLATFORM AT 10' AFF.
2. SUSPEND FIXTURES AT 9' AFF, UON.
3. SURFACE MOUNT FIXTURE ABOVE MAN DOOR.
4. MOTOR -RATED SWITCHES WITH PILOT LIGHTS.
5. FED FROM PANEL MTF-PNL-A.
6. FED FROM PANEL MTF-PNL-B.
7. SWITCH FOR BAY LIGHTING FIXTURES, SEE DRAWING E941002-F-0014.

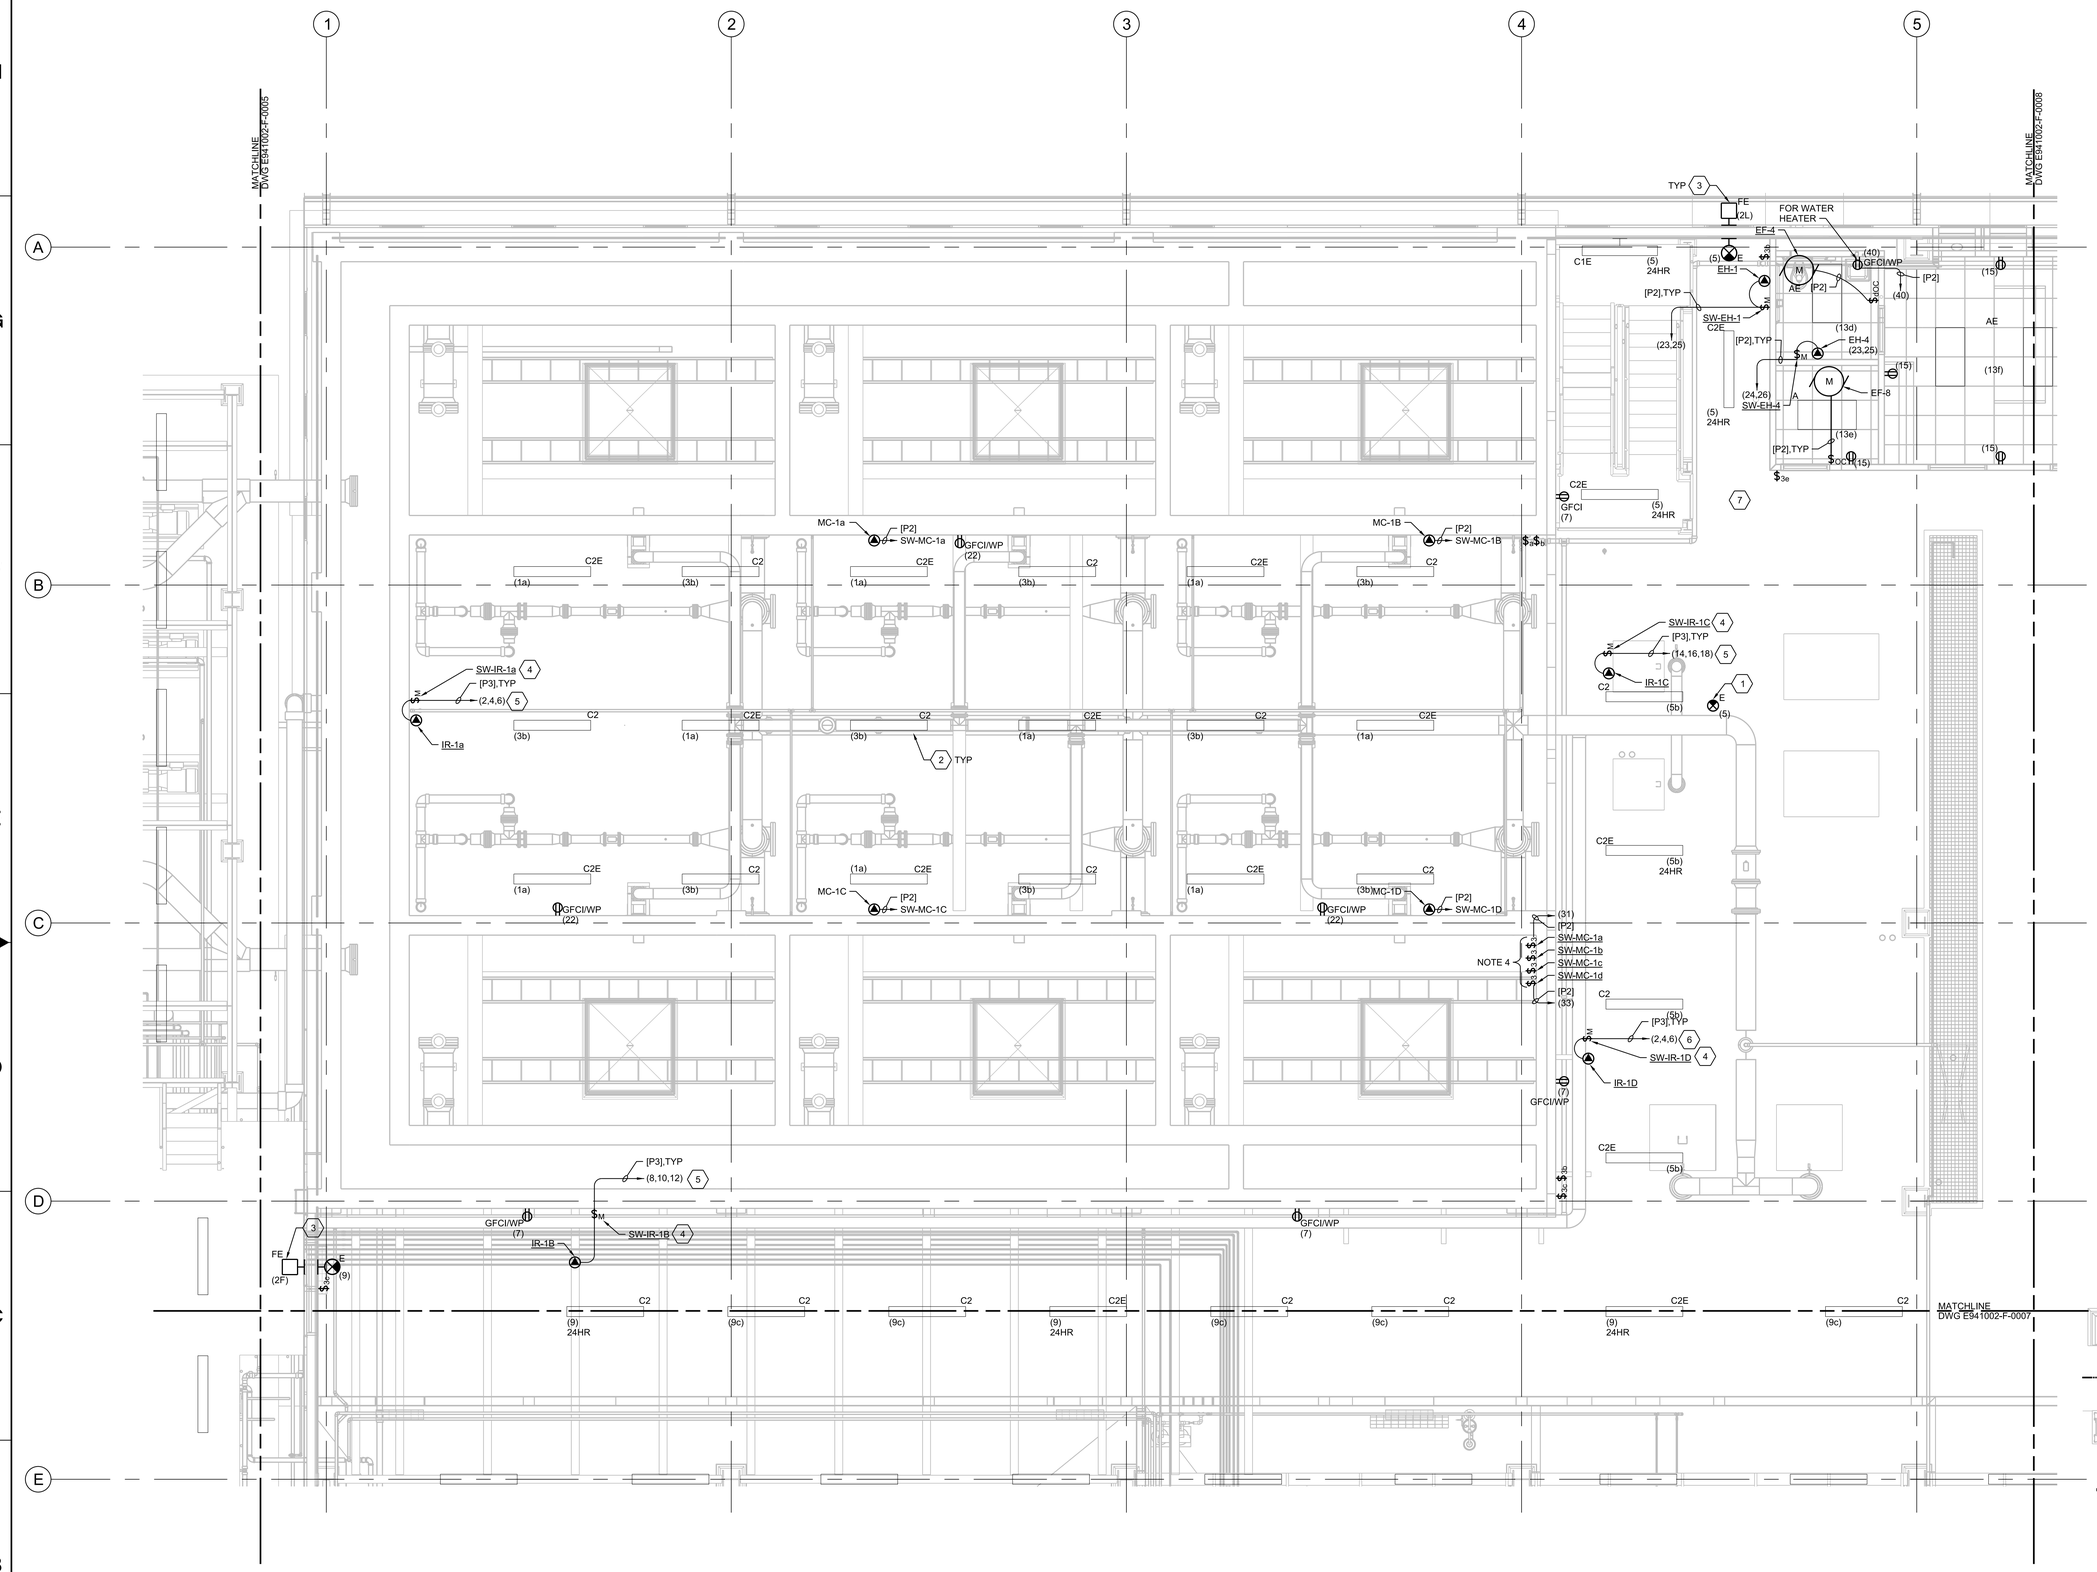

INTERMEDIATE FACILITY PLAN - AREA C

1/4"=1'-0"

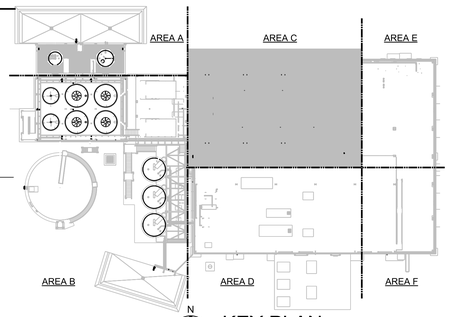

KEY PLAN

UCOR
URS | CH2M Oak Ridge LLC

OF200 Mercury Treatment Facility
Designed by URS|CH2M Oak Ridge LLC (UCOR) for the Department of Energy
Oak Ridge Office of Environmental Management
under U. S. Government contract DE-SC-0004645

Y-12 National Security Complex managed and operated by Consolidated Nuclear Security, LLC for the Department of Energy under U.S. Government contract DE-NA0001942
a Oak Ridge, Tennessee a

DRW	M WILSON	06/16/17
CHKR	B WILKINSON	06/16/17
DE	G KLOSSNER	06/16/17
DVR		
DM	L ELLIS	06/16/17
PE	Teresa J. Pierce, P.E.	

RPE

PROJECT NAME:
OF200 MERCURY TREATMENT FACILITY

ELECTRICAL
TREATMENT FACILITY
INTERMEDIATE FACILITY PLAN AREA C

USE	DISC	DT	DC	CM	SYSTEM	STAT	SIZE	BLDG	FL	CLASS
3	E	L	L	NC	FAC	AR	E	9410-02	2	U

SH.	OF	TYPE		PART	REV
1	1	DD	E941002-F-0006	000	0

662886

PART	REV	DESCRIPTION	DRW	CHKR	DE	DVR	DM	DATE
	0	ISSUED FOR CONSTRUCTION	MW	BW	GK		LE	06/2017

REVISION OR ISSUE PURPOSE — REVISION APPROVALS — SQUAD CHECK — DRAWING APPROVALS

PE	DATE	WE	AR	CV	ST	HV	EM	FP	PD	EE	IE	M	NP

ISSUED FOR CONSTRUCTION

THIS DRAWING IS LOANED FOR SOLE USE OF THE INTENDED RECIPIENT AND ONLY FOR THE LIMITED PURPOSES FOR WHICH IT WAS PROVIDED. USE BY OTHER ENTITIES OR FOR OTHER PURPOSES IS PROHIBITED AND AT THE USER'S OWN RISK. DRAWINGS ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING RECIPIENT.

6/22/2017 10:49:09 AM
E941002-F-0006.dgn