GENERAL NOTES

1. ALL AIR HANDLING UNITS CONDENSATE DRAIN TRAPS SHALL BE PER DETAIL 5/H941002-F-0012.
2. ALL DUCTWORKS SUPPORT SHALL BE PER THE SPECIFICATIONS AND PER DETAIL 6/H941002-F-0012.
3. FLOOR AND WALL DUCT PENETRATIONS SHALL BE PER DETAIL 10/H941002-F-0012.
4. ALL EQUIPMENT LOCATION DIMENSIONS ARE FOR REFERENCE ONLY. ACTUAL EQUIPMENT LOCATIONS SHALL BE COORDINATED IN THE FIELD.
5. REFER TO SHEET H941002-F-0017 FOR EQUIPMENT SCHEDULES.

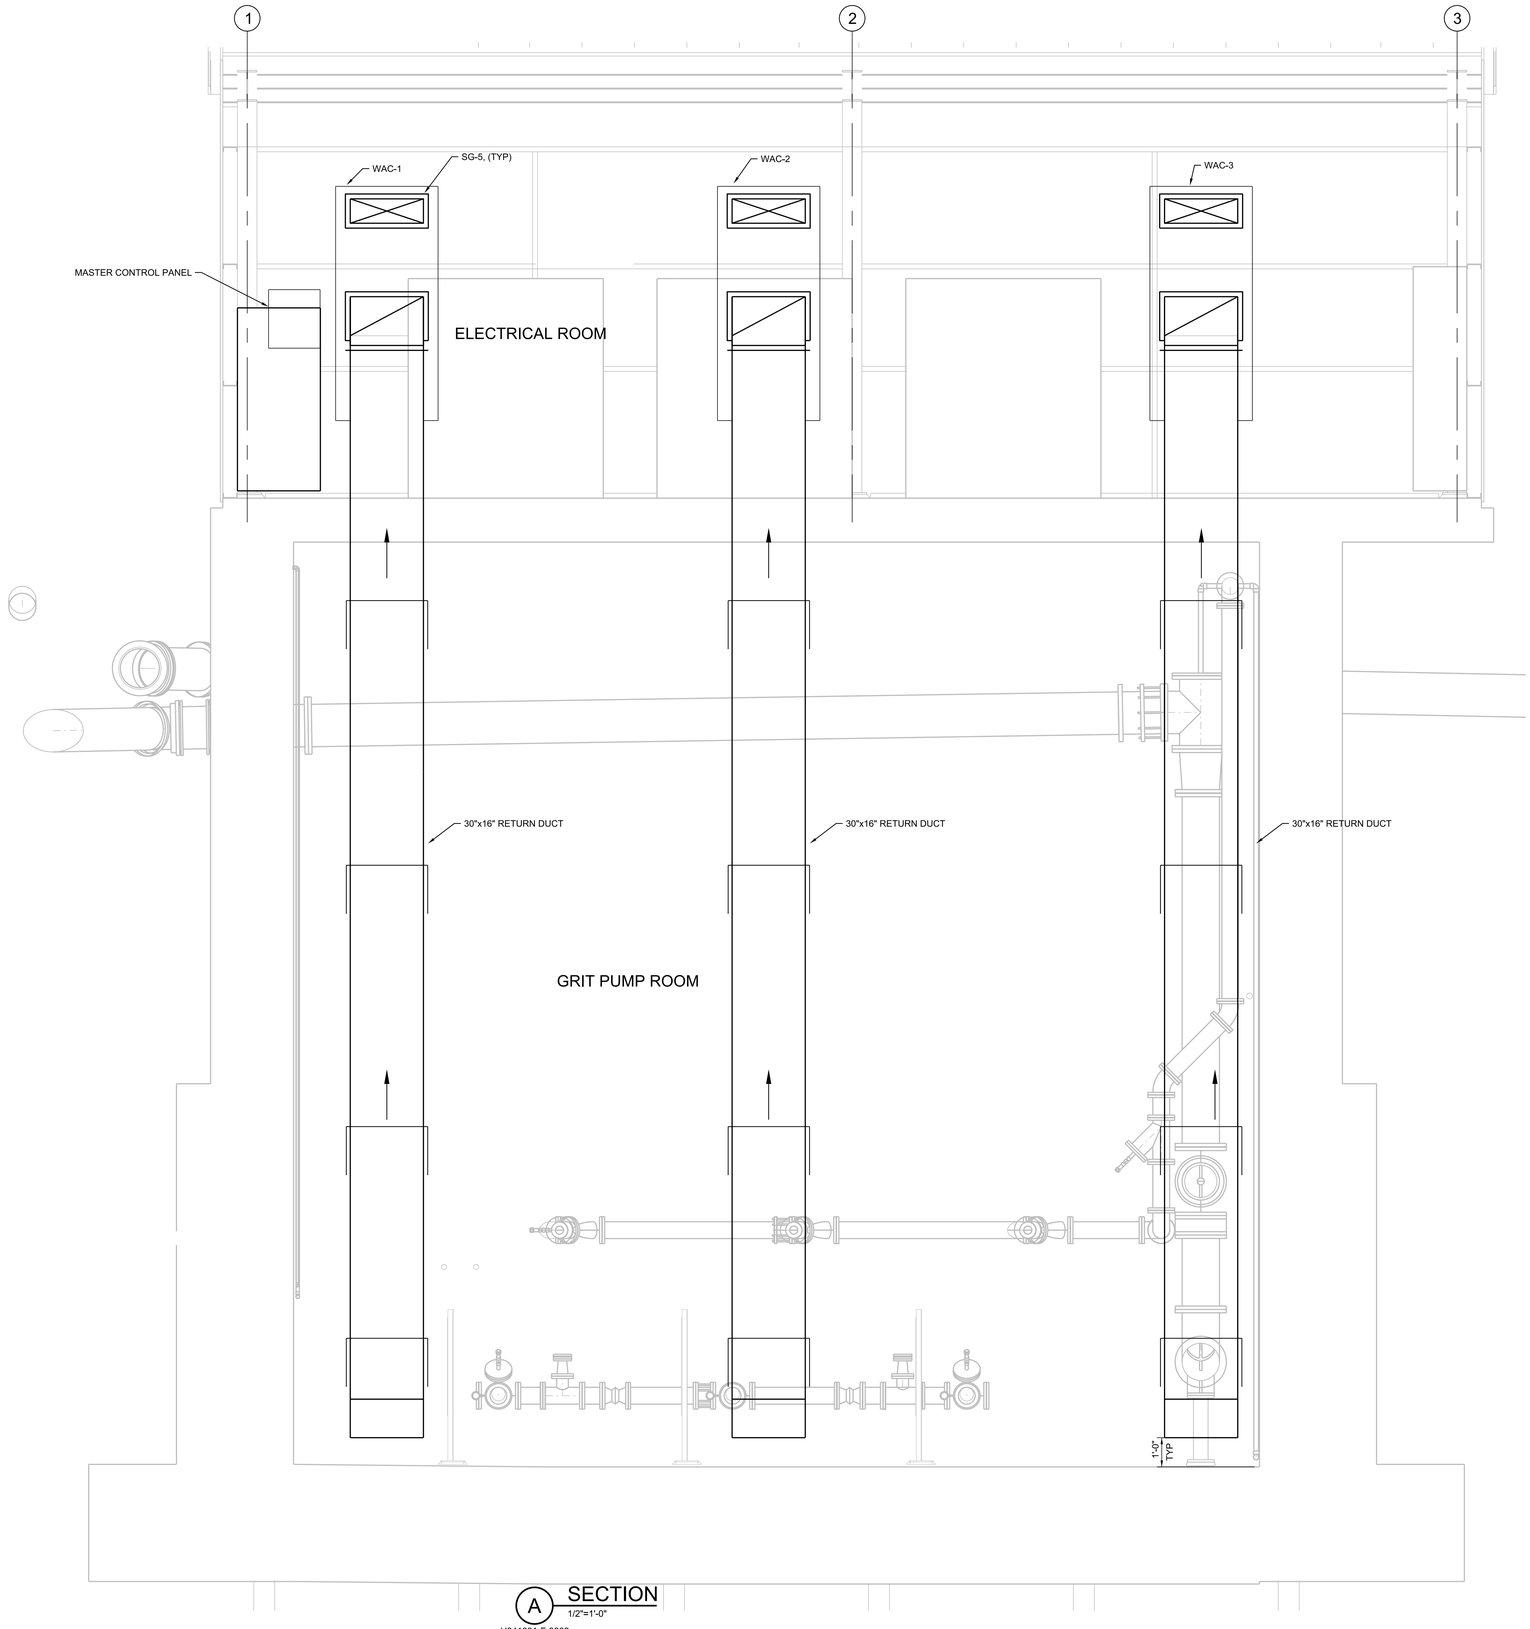

A SECTION
1/2"=1'-0"
H941001-F-0002
H941001-F-0003

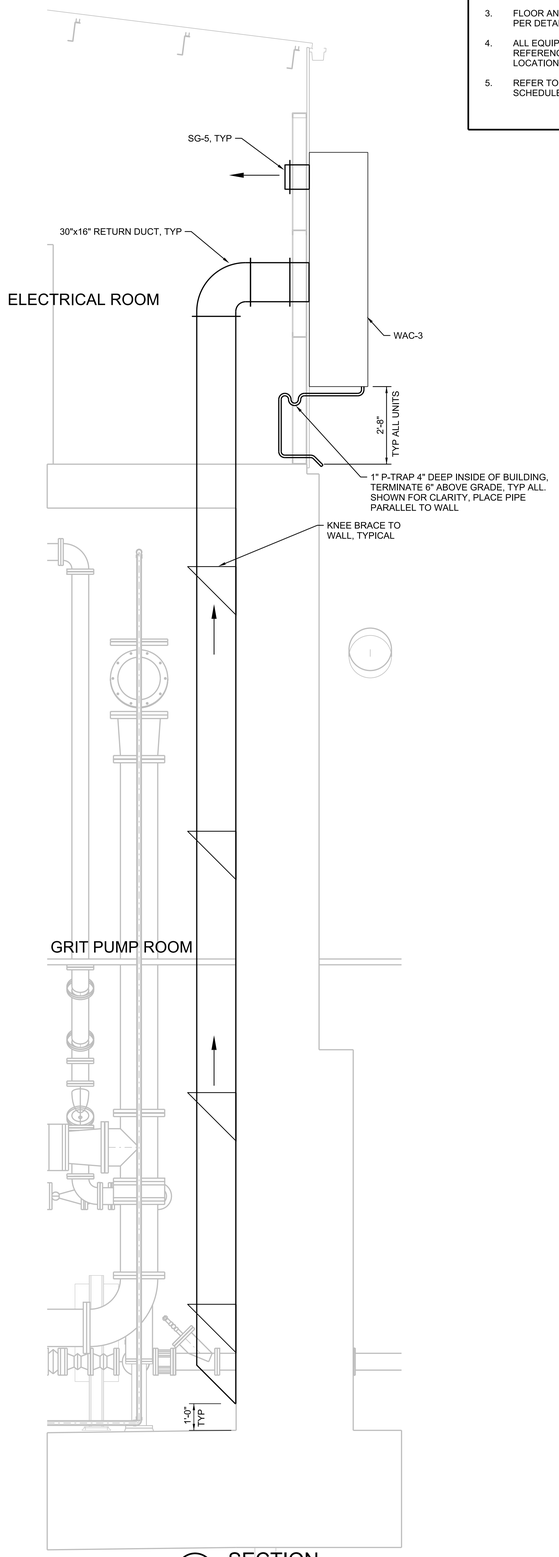

B SECTION
1/2"=1'-0"
H941001-F-0002

UCOR URS | CH2M Oak Ridge LLC

OF200 Mercury Treatment Facility
Designed by URS|CH2M Oak Ridge LLC (UCOR) for the Department of Energy
Oak Ridge Office of Environmental Management
under U. S. Government contract DE-SC-0004645

Y-12 National Security Complex managed and operated by Consolidated Nuclear Security, LLC for the Department of Energy under U.S. Government contract DE-NA0001942 • Oak Ridge, Tennessee •

DRW	J PIGMAN	06/16/17
CHKR	J McMURREN	06/16/17
DE	T PRICE	06/16/17
DVR		
DM	L ELLIS	06/16/17
PE	Teresa J. Pierce, P.E.	

RPE

PROJECT NAME:
OF200 MERCURY TREATMENT FACILITY
HVAC
HEADWORKS
HVAC SECTIONS

USE	DISC	DT	DC	CM	SYSTEM	STAT	SIZE	BLDG	FL	CLASS
3	H	A	D	NC	FAC	AR	E	9410-01	X	U

SH.	OF	TYPE		PART	REV
1	1	DD	H941001-F-0004	000	0

662886

PART	REV	DESCRIPTION	DRW	CHKR	DE	DVR	DM	DATE
	0	ISSUED FOR CONSTRUCTION	JP	JM	TP		LE	06/2017

REVISION OR ISSUE PURPOSE

PE	DATE

REVISION APPROVALS

WE	AR	CV	ST	HV	EM	FP	PD	EE	IE	M	NP

SQUAD CHECK

REV. DATE
DRAWING APPROVALS
DATE

ISSUED FOR CONSTRUCTION

THIS DRAWING IS LOANED FOR SOLE USE OF THE INTENDED RECIPIENT AND ONLY FOR THE LIMITED PURPOSES FOR WHICH IT WAS PROVIDED. USE BY OTHER ENTITIES OR FOR OTHER PURPOSES IS PROHIBITED AND AT THE USER'S OWN RISK. DRAWINGS ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING RECIPIENT.

6/29/2017 8:50:25 PM
H941001F0004.dgn